


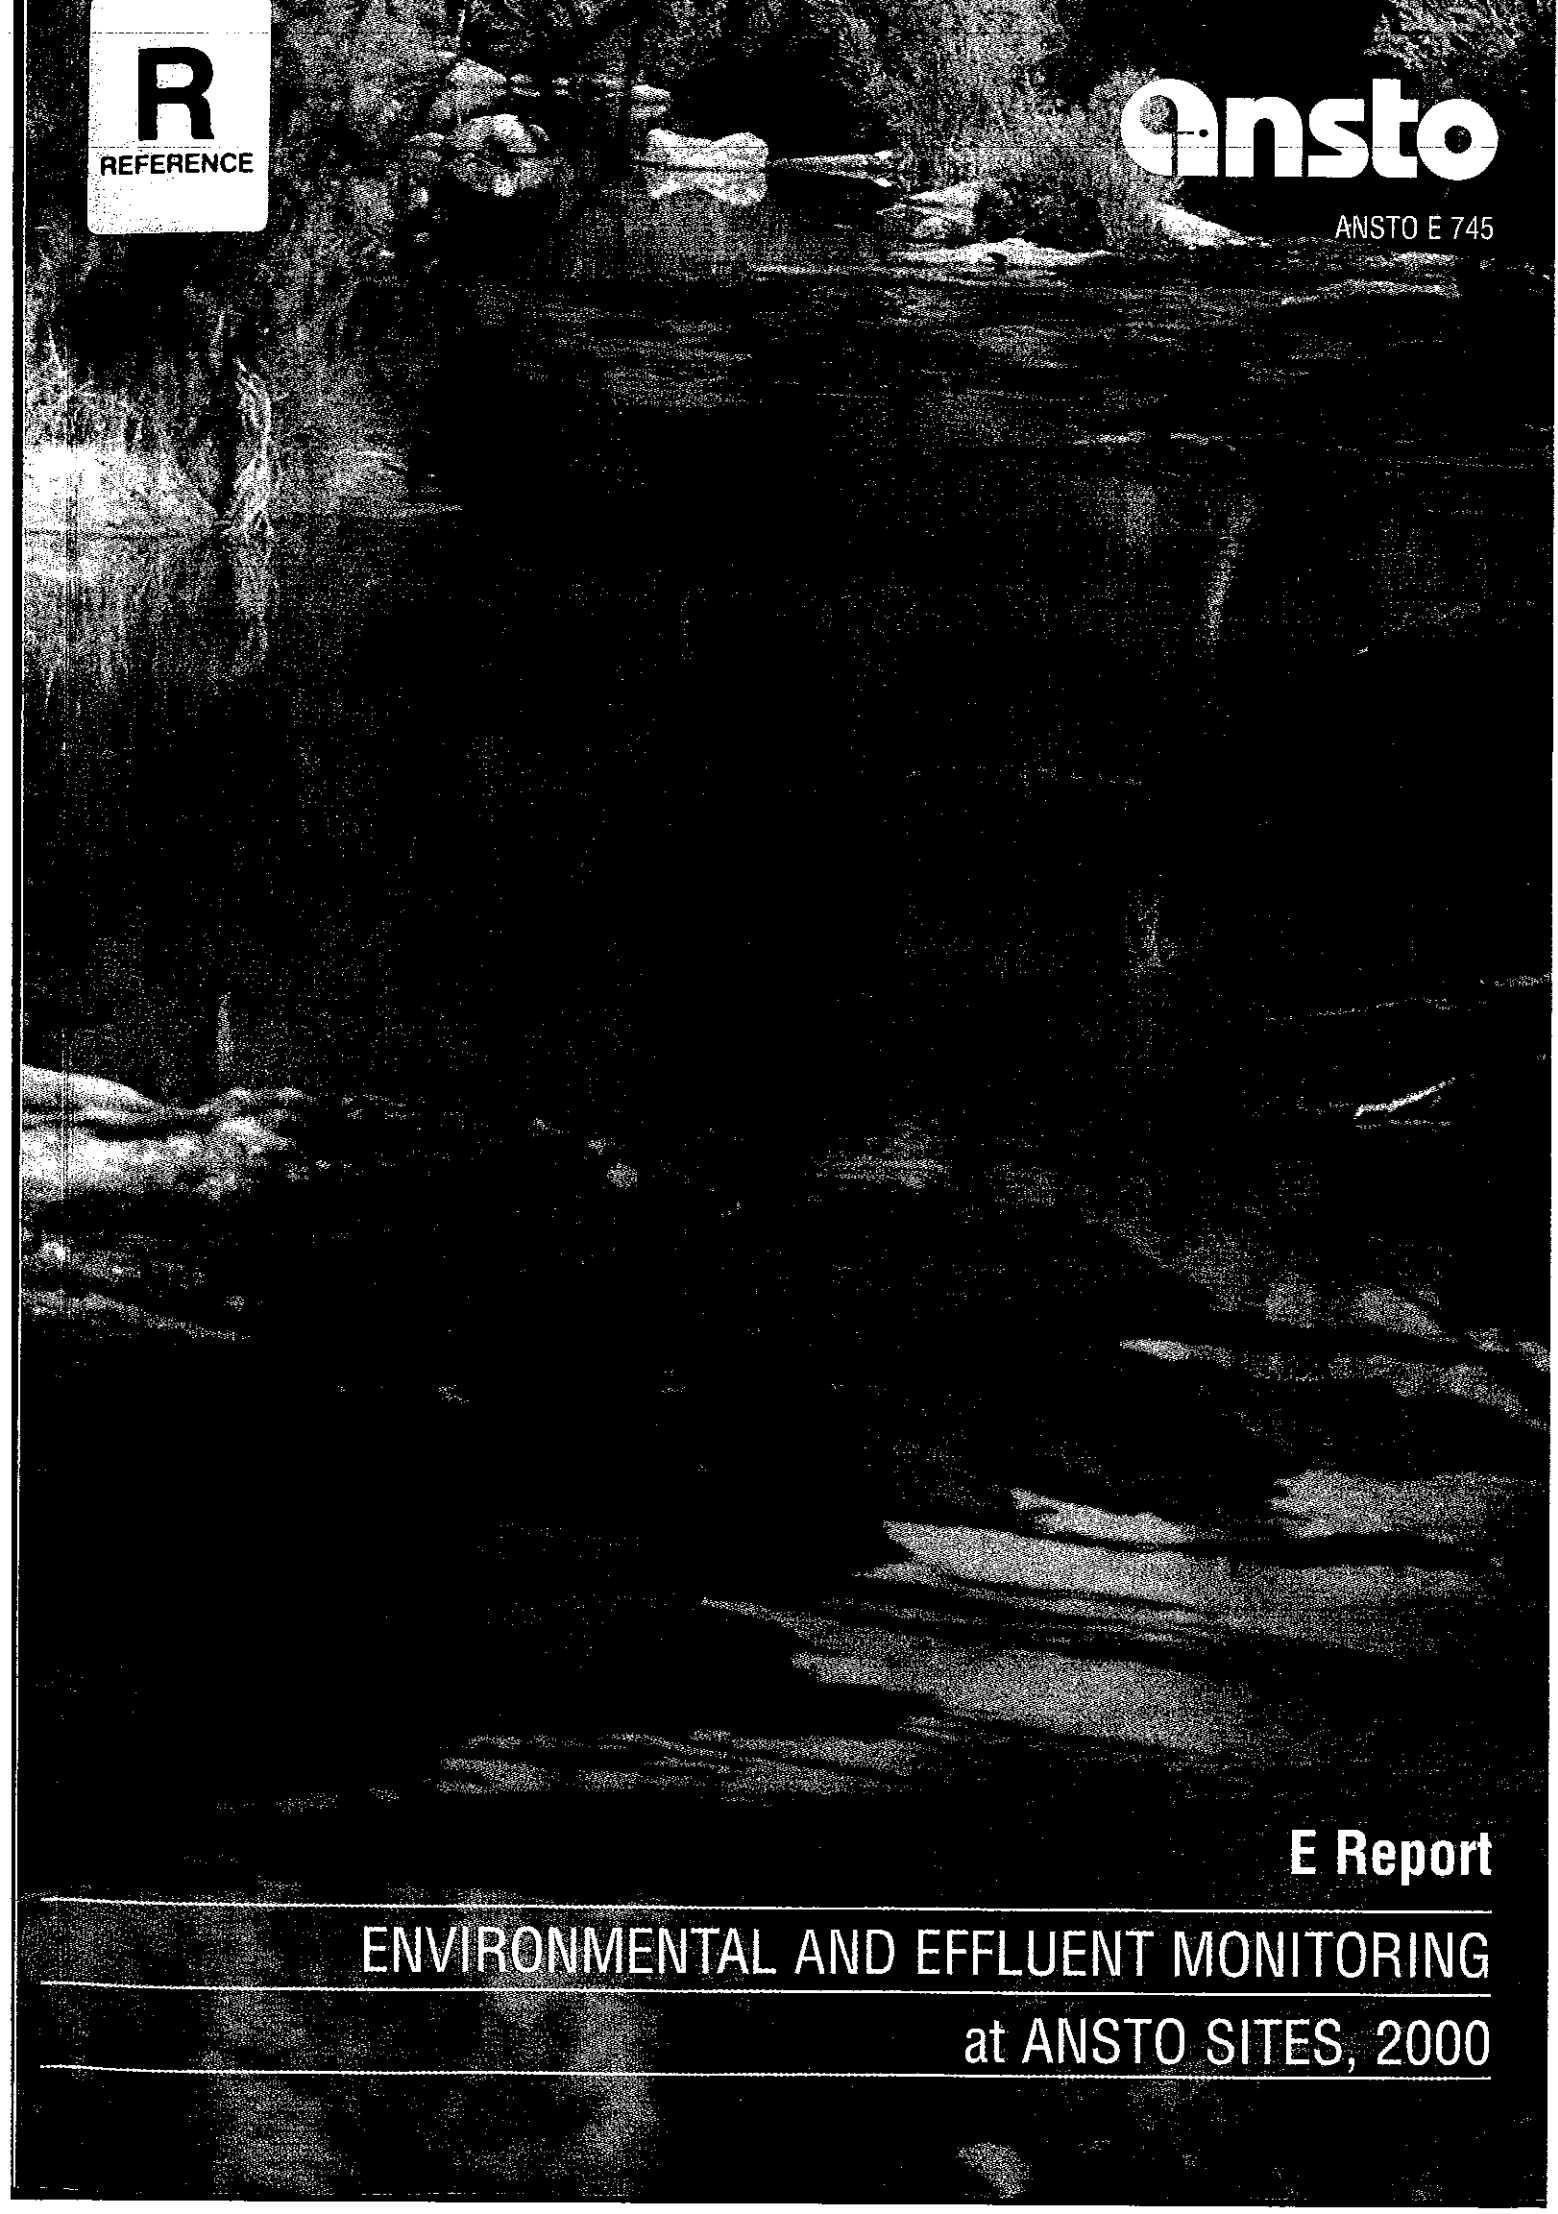

R

REFERENCE

ansto

ANSTO E 745

E Report

ENVIRONMENTAL AND EFFLUENT MONITORING

at ANSTO SITES, 2000

GENERAL CONTACT DETAILS

Street Address: Lucas Heights Science and Technology Centre (LHSTC)
New Illawarra Road, Lucas Heights
NSW 2234

Postal Address: ANSTO Private Mail Bag 1
Menai NSW 2234
Australia

Telephone: + 61 (2) 9717 3111

Facsimile: + 61 (2) 9543 5097

Email: enquiries@ansto.gov.au

Internet: ANSTO Home Page:
<http://www.ansto.gov.au>

Guided tours of the LHSTC site and laboratories are available to individuals, groups and schools. For bookings and information telephone (02) 9717 3168.

This work is copyright. It may be reproduced in whole or part subject to the inclusion of an acknowledgement of the source and no commercial usage or sale. Reproduction for purposes other than those indicated above, require the written permission of the Commonwealth, available through AusInfo. Requests and enquiries should be addressed to the Manager, Legislative Services, AusInfo, GPO Box 1920, Canberra ACT 2601.

Front Cover: South West Arm Creek in The Royal National Park,
Sutherland Shire, Sydney.

Photography: Tim Tapsell, ANSTO

ANSTO Report No.: ANSTO/E-745

ISSN 1030 7745


ISBN 0 642 59986 6

© Commonwealth of Australia 2001.

ENVIRONMENTAL AND EFFLUENT MONITORING AT ANSTO SITES, 2000

LUCAS HEIGHTS SCIENCE AND TECHNOLOGY CENTRE AND
THE NATIONAL MEDICAL CYCLOTRON

E.L. HOFFMANN, T. LOOSZ, L. MOKHBER-SHAHIN

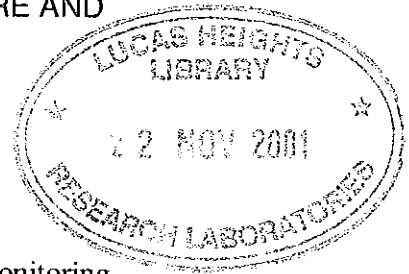

ABSTRACT

Results are presented of environmental surveillance and effluent monitoring conducted in the calendar year 2000 at the two sites owned and operated by ANSTO, at the Lucas Heights Science and Technology Centre (LHSTC) and the National Medical Cyclotron (NMC). All low-level liquid and gaseous effluent discharges complied with existing discharge authorisations and relevant environmental regulations. Potential effective doses to the general public from LHSTC controlled airborne discharges were estimated for 2000 using the PC-Cream atmospheric dispersion and dosimetry code. The potential effective doses to the public in 2000 were estimated to be less than 0.01 mSv/year for all receptor locations on the LHSTC 1.6 km buffer zone boundary or beyond. This value represents 1% of the 1 millisievert (mSv) per year dose limit for long term exposure that is recommended by the National Health and Medical Research Council and 3.3% of the LHSTC site dose constraint of 0.3 mSv/year. It is concluded that there is no impact on the health of the community, staff or the environment as a consequence of operations at the Lucas Heights Science and Technology Centre or the National Medical Cyclotron.

INIS DESCRIPTORS

The following descriptors have been selected from the INIS Thesaurus to describe the subject matter of this report for information retrieval purposes. For further details please refer to IAEA-INIS-12 (INIS Manual for Indexing) and IAEA-INIS-13 (INIS Thesaurus) published in Vienna by the International Atomic Energy Agency.

Airborne Particulates, Algae, Alpha Decay Radioisotopes, Alpha Particles, Americium-241, ANSTO, Argon-41, Australia, Beryllium-7, Beta Decay Radioisotopes, Cesium-134, Cesium-137, Chemical Effluents, Cobalt-57, Cobalt-60, Contamination, Cyclotrons, Dose Equivalents, Dose-Constraint, Dose Limits, Drinking Water, Environmental Exposure Pathway, Environmental Impacts, Evaluated Data, Fishes, Fission Product Release, Gallium-67, Gamma Radiation, Gaseous Wastes, Ground Water, Iodine-123, Iodine-131, Iodine-132, Iodine-133, Liquid Wastes, Low Level Counting, Measuring Methods, Noble Gases, Plutonium-239, Potassium-40, Public Health, Radiation Doses, Radiation Monitoring, Radioactive Effluents, Natural Radioactivity, Rivers, Sampling, Seawater, Sediments, Soils, Stack Disposal, Standards, Statistics, Strontium-90, Surface Waters, Thallium-201, Thorium-232, Thermoluminescent Dosimetry, Tritium, Uranium-238, Water Quality, Wind, Zinc-65.

CONTENTS

	PAGE NUMBER
ABSTRACT	I
EXECUTIVE SUMMARY	V
FIGURES	IX
1 INTRODUCTION	1
2 ENVIRONMENTAL EXPOSURE PATHWAYS - LHSTC	2
2.1 Atmospheric Discharges from LHSTC	3
2.2 Low-Level Liquid Effluent Discharges from LHSTC	4
2.3 The Little Forest Burial Ground	4
3 DISCHARGE AUTHORISATIONS	5
3.1 Low-Level Liquid Effluent - LHSTC	6
3.2 Atmospheric Discharges - LHSTC	8
3.3 Surface Waters Near LHSTC	10
4 MEASUREMENT OF RADIOACTIVITY	10
4.1 Types of Radioactivity Measured	10
4.2 Natural Radioactivity in Environmental Samples	12
4.3 Quality Management	12
5 ENVIRONMENTAL MONITORING AT LHSTC	13
5.1 Woronora River	14
5.2 Forbes Creek	14
5.3 Potter Point Biological Monitoring	14
5.4 Stormwater	16
5.5 Surface Waters	18
5.6 Gamma Survey of Effluent Discharge Pipeline	19
5.7 Little Forest Burial Ground (LFBG)	19
5.8 Iodine-131 in Air	22
5.9 Meteorological Monitoring at LHSTC	22
5.10 External Gamma Radiation	24
6 EFFLUENT MONITORING AT LHSTC	25
6.1 Airborne Effluent Stack Discharges	25
6.2 Low-Level Liquid Effluent Discharges	27
7 POTTER POINT OFFSHORE MONITORING	29
7.1 June 2000 - Effluent Study	29
7.2 December 2000 - Effluent Study	30
8 THE NATIONAL MEDICAL CYCLOTRON	31
8.1 NMC Environmental Pathways & Discharge Limits	32

	PAGE NUMBER
8.2 NMC Effluent Monitoring Results	32
9 POTENTIAL RADIATION EXPOSURE TO MEMBERS OF THE PUBLIC FROM OPERATIONS AT ANSTO SITES	32
9.1 LHSTC Airborne Emissions	33
9.2 Low-Level Liquid Effluent from LHSTC	34
9.3 External Radiation at LHSTC	34
9.4 The Little Forest Burial Ground	34
9.5 The National Medical Cyclotron	35
10 ACKNOWLEDGMENTS	35
11 REFERENCES & BIBLIOGRAPHY	36
TABLES	40
APPENDICES	70
GLOSSARY OF TERMS	85
LIST OF FIGURES	
Figure 1 Location of LHSTC and Off-site Sampling Points	
Figure 2 Location of Stormwater, Air and External Radiation Monitoring Points at LHSTC	
Figure 3 Little Forest Burial ground - Location of Trenches and Groundwater Bores	
Figure 4 Location of Sampling Zones at Potter Point Ocean Outfall and The Royal National Park	
LIST OF TABLES	
Table 1 Environmental Monitoring Schedule, 2000	
Table 2 Tritium in Woronora Estuary Water Station E5.9, 2000	
Table 3 Tritium in Forbes Creek Water Samples, 2000	
Table 4 Radioactivity in Fish from Potter Point Ocean Outfall, 2000	
Table 5 Radioactivity in Algae from Potter Point Ocean Outfall, 2000	
Table 6 Radioactivity in Barnacles from Potter Point Ocean Outfall, 2000	
Table 7a Tritium in Composite Water Samples from LHSTC Stormwater Bunds, 2000	
Table 7b Tritium in Weekly Water Samples from MDP Bund C, 2000	
Table 7c Radioactivity in Composite Water Samples from MDP Bund C, 2000	
Table 8 Radioactivity in Sediment from Stormwater Bunds, 2000	
Table 9a Tritium in Weekly Water Samples from MDP+ 60m, 2000	
Table 9b Radioactivity in Composite Water Samples from MDP+ 60m, 2000	
Table 10 Radioactivity in Water from SPCC Sampling Points, 2000	
Table 11 Tritium in Water from Bardens Creek Weir, 2000	
Table 12 Gamma Dose-Rate Survey of Effluent Discharge Pipeline, 2000	
Table 13 Gamma Dose-Rate Survey of Burial Trenches at Little Forest Burial Ground, 2000	

Table 14a	Radioactivity in Soils from Little Forest Burial Ground, 2000
Table 14b	Radioactivity in Groundwater from Little Forest Burial Ground, 2000
Table 15	Radioactivity in Creeks North of the Little Forest Burial Ground, 2000
Table 16	Particulates in Air at Little Forest Burial Ground, 2000
Table 17	Ambient Iodine-131 in Air at LHSTC, 2000
Table 18a	External Gamma Radiation at LHSTC (ARPANSA Dosimeter Results), 1996 to 2000
Table 18b	External Gamma Radiation at LHSTC, Comparison of ARPANSA and ANSTO Dosimeter Results, 2000
Table 19a	Airborne Radioactivity Discharges from Individual Discharge Points at LHSTC, January - March 2000
Table 19b	Airborne Radioactivity Discharges from Individual Discharge Points at LHSTC, April - June 2000
Table 19c	Airborne Radioactivity Discharges from Individual Discharge Points at LHSTC, July - September 2000
Table 19d	Airborne Radioactivity Discharges from Individual Discharge Points at LHSTC, October - December 2000
Table 20	Radioactivity in Groundwater from the Vicinity of Building 27, 2000
Table 21	Radioactivity in Liquid Effluent Discharged from LHSTC to the Sydney Water Sewer, 2000
Table 22	Non-Radioactive Component of Liquid Effluent Discharged from LHSTC to the Sydney Water Sewer, 1997 to 2000
Table 23a	Airborne Emissions of Iodine-123 from the National Medical Cyclotron, 2000
Table 23b	Average Concentration of Radionuclides in Liquid Effluent from the National Medical Cyclotron, 2000
Table 24	Estimated Effective Doses from LHSTC Airborne Discharges, 2000
Table 25	Annual Effective Doses to Adults from Natural Sources

LIST OF APPENDICES

Appendix A	Previous Environmental Survey Reports
Appendix B	Stack Discharges of Radioactivity at Lucas Heights
Appendix C	Symbols & Prefixes
Appendix D	Environmental Sample Collection and Analytical Procedures
Appendix E	Airborne Effluent Sample Collection and Analysis
Appendix F	ANSTO Health, Safety and Environment Policy
Appendix G	ANSTO Quality Policy
Appendix H	Errata

ENVIRONMENTAL AND EFFLUENT MONITORING AT ANSTO SITES, 2000

EXECUTIVE SUMMARY

The Australian Nuclear Science and Technology Organisation (ANSTO) is an agency of the Australian Commonwealth Government, providing services to government, industry, the research and development community and the wider community. ANSTO operates two sites incorporating several national facilities, including the HIFAR research reactor, the Australian National Tandem Accelerator for Applied Research (ANTARES) and the National Medical Cyclotron (NMC). The ANSTO sites are both located in Sydney, New South Wales:

- ♦ the main site at Lucas Heights, known as the Lucas Heights Science and Technology Centre (LHSTC); and
- ♦ The National Medical Cyclotron, adjacent to the Royal Prince Alfred Hospital in inner city Sydney.

ANSTO operations, which involve radiation or radioactive material, are regulated under the Australian Radiation Protection and Nuclear Safety Act 1998, the object of which is to protect the health and safety of people and to protect the environment from the harmful effects of radiation. The Australian Radiation Protection and Nuclear Safety Agency (ARPANSA) has been established to implement the provisions of the Act and the associated regulations. Under the Act ARPANSA has the authority to undertake independent audits of the effluent and environmental monitoring programs at ANSTO sites.

ANSTO has a Health, Safety and Environment Policy that commits the Organisation to undertaking its activities in a manner that protects human health and the environment, and is consistent with national and international standards. The Policy further mandates that all procedures are in accordance with Commonwealth legislation and take account of relevant NSW regulations and Australian and international standards on environmental management and quality systems. ANSTO is committed to providing verifiable evidence of the fulfilment of the policy through a program of monitoring and audit.

The environmental and effluent monitoring results for 2000 show that ANSTO operations complied with effluent discharge authorisations and relevant environmental regulations for both the LHSTC and the NMC sites.

The National Medical Cyclotron

The radiopharmaceutical products made at the National Medical Cyclotron are relatively short-lived with half-lives ranging from minutes to hours. As a consequence the small amounts of liquid and airborne emissions from the NMC have limited impact on the environment or humans. All emissions met the prescribed discharge limits in 2000.

Liquid Effluent from LHSTC

ANSTO has an Agreement (No.4423) with Sydney Water Corporation which allows ANSTO to discharge treated liquid effluent from LHSTC to the sewer as long as the discharges comply with:

- ♦ the World Health Organisation (WHO) 1993 Guidelines for Drinking-Water Quality at Cronulla Sewage Treatment Plant (CSTP); and

- ♦ concentration limits for non-radiological components of the effluent.

During 2000, radionuclide concentrations in liquid effluent discharged to the sewer were below the limits specified in the Sydney Water Trade Wastewater Agreement. The average monthly concentration quotients for gross alpha, gross beta and tritium radioactivity in liquid effluent ranged from 0.09 to 0.61 with an average for the year of 0.29, which is around 30% of the required limit. Concentrations of the non-radioactive components of liquid effluent discharged to the Sydney Water sewer also met the standards for acceptance specified in the Trade Wastewater Agreement.

Airborne Discharges from LHSTC

Potential effective doses to local members of the public from controlled airborne discharges in 2000 were estimated to be less than 0.01 mSv per year, for receptor locations on the 1.6 kilometre radius LHSTC buffer zone boundary. This represents less than 1% of the annual dose limit of 1 mSv for members of the public recommended by the National Health and Medical Research Council (NH&MRC) and 3.3% of the site dose constraint of 0.3 mSv per year.

The estimated potential doses to members of the general public from airborne discharges at LHSTC are only a very small fraction, less than half a percent, of the radiation dose received by everyone each year from naturally occurring sources of radiation.

Stormwater and Surface Waters - LHSTC

Stormwater drainage from the LHSTC complied with the NSW Protection of the Environment Operations Act (1997) limits for gross alpha and gross beta radioactivity. Sampling included the on-site stormwater bunds and off-site sampling points on the three small creeks receiving most of the run-off from the site. Levels of tritium and gamma activity found in stormwater were low in comparison with WHO (1993) drinking water guidelines.

Surface water samples collected off-site at the confluence of Mill and Bardens Creeks, from the Woronora River and Forbes Creek, contained only background levels of radioactivity.

Since the levels of detected activity are very low and stormwater does not enter any known human drinking water supply, it is concluded that there are no environmental or health consequences to humans from the measured radioactivity in LHSTC stormwater.

Little Forest Burial Ground

Groundwater monitoring of fifteen bores at the Little Forest Burial Ground (LFBG) indicated that radioactivity levels were similar to those of previous years.

The gross alpha and gross beta concentrations in LFBG groundwater were below the levels prescribed for Class C waters in the regulations associated with the Protection of the Environment Operations Act (1997). In fact, the gross alpha and gross beta results were also at, or below the more restrictive Australian Drinking Water Guidelines levels, with the exception of bore MB16 (near the centre of the trench area).

Gamma spectrometry of LFBG groundwater samples showed only small concentrations of natural potassium-40 and low levels of cobalt-60 in MB16, at less than 2% of the WHO drinking water reference concentration. The extremely low levels of radioactivity found in groundwater are of no consequence to the health of humans.

A high-volume air sampler was used to monitor airborne particulates at the LFBG in 2000. Quarterly samples of airborne particles were collected on filters by sampling for approximately 5 hours every two weeks. Dry, relatively windy sampling days were chosen to maximise the chance of particulate collection. The nuclides of interest are stable beryllium and plutonium, however neither were detected in LFBG airborne particulates during 2000.

Extra monitoring of soil, air and dose rates was undertaken in response to a trespassing incident at the LFBG, however the results showed no measurable radioactivity above natural background levels.

The LFBG has an established vegetation cover and rarely experiences winds capable of significant particle suspension. The radiological exposures to members of the public from the LFBG continue to be negligible.

External Gamma Radiation

During the year, thermoluminescent dosimeters measured ambient gamma radiation at various locations around the LHSTC perimeter fence and at three private residences in the nearby suburbs of Barden Ridge, Engadine and Woronora. Measurements at the three local residences showed an average external dose of about 0.8 mSv/year. The local absorbed doses in air were consistent with levels recorded in Australian capital cities (using similar dosimeters) in surveys carried out by the then Australian Radiation Laboratory and reported by the United Nations Scientific Committee on the Effects of Atomic Radiation (UNSCEAR, 1993). These results indicate that the external gamma radiation levels at residential locations in the vicinity of the LHSTC are not noticeably affected by the operations at the LHSTC.

The absorbed dose to air at location 2 on the southern sector of the LHSTC perimeter fence was, as in previous years, affected by nearby stored radioactive material. This part of the site is not readily accessed by the general public and is approximately 1.8 kilometres away from any residential areas. Other locations exhibited normal background dose rates.

Potter Point Ocean Outfall

Biological and seawater monitoring continued at the Potter Point ocean outfall during 2000. Treated sewage effluent for the Sutherland Shire, including low-level effluent from the LHSTC, passes through the Cronulla Sewage Treatment Plant and is discharged at Potter Point. The seawater and biological sampling programs are aimed at assessing potential doses to members of the public who may swim in the ocean off Potter Point and/or eat fish caught in the vicinity of the outfall.

Three types of marine biota were collected from Potter Point in order to maximise the chances of detecting radionuclides in the marine environment: blackfish (luderick), filamentous green algae (seaweed) and surf barnacles.

Most of the radionuclides detected in marine biota were of natural origin, however very low concentrations of caesium-137, cobalt-60 and iodine-131 were also found. Caesium-137 (from atmospheric nuclear test fallout) is also found at comparable levels in other types of fish caught in Australian regional waters (Aarkrog *et al.*, 1997). Hence, cobalt-60 and iodine-131 were the only radionuclides found in these samples that might be attributed to ANSTO. Note that iodine-131 also enters the Sutherland Shire sewage system through local use of nuclear medicines.

The small concentrations of caesium-137, iodine-131 and cobalt-60 found in marine biota from Potter Point were of no radiological significance. Cobalt-60 has not been detected in blackfish sampled at Potter Point since 1995, even though this species is known to eat algae of the type analysed.

The tritium levels in seawater near the Potter Point ocean outfall were investigated in June and December 2000. None of the 126 samples taken within 250 metres of the outfall showed detectable levels of tritium. The time taken for wastewater to flow from Lucas Heights to the Cronulla Sewage Treatment Plant was approximately 10 hours. The estimated in-line dilution factor based on flow rate measurements was 52. These results are consistent with values obtained in previous studies, undertaken since 1993.

The monitoring results from Potter Point confirm that the potential radiation dose to members of the general public as a result of ANSTO's discharges to the sewer is very low. The potential dose is at least a factor of 1000 below the NH&MRC recommended dose limits for members of the public.

It is concluded that there is no impact on the health of the community, staff or the environment as a consequence of operations at the Lucas Heights Science and Technology Centre or the National Medical Cyclotron.

Under its Health, Safety and Environment Policy, ANSTO is committed to on-going dialogue with the community on the implementation of the monitoring program. As a contribution to fulfilling this commitment, ANSTO will analyse samples from the local community for environmental radioactivity levels. Contact the ANSTO Communications Manager on (02) 9717 3770 for further information.

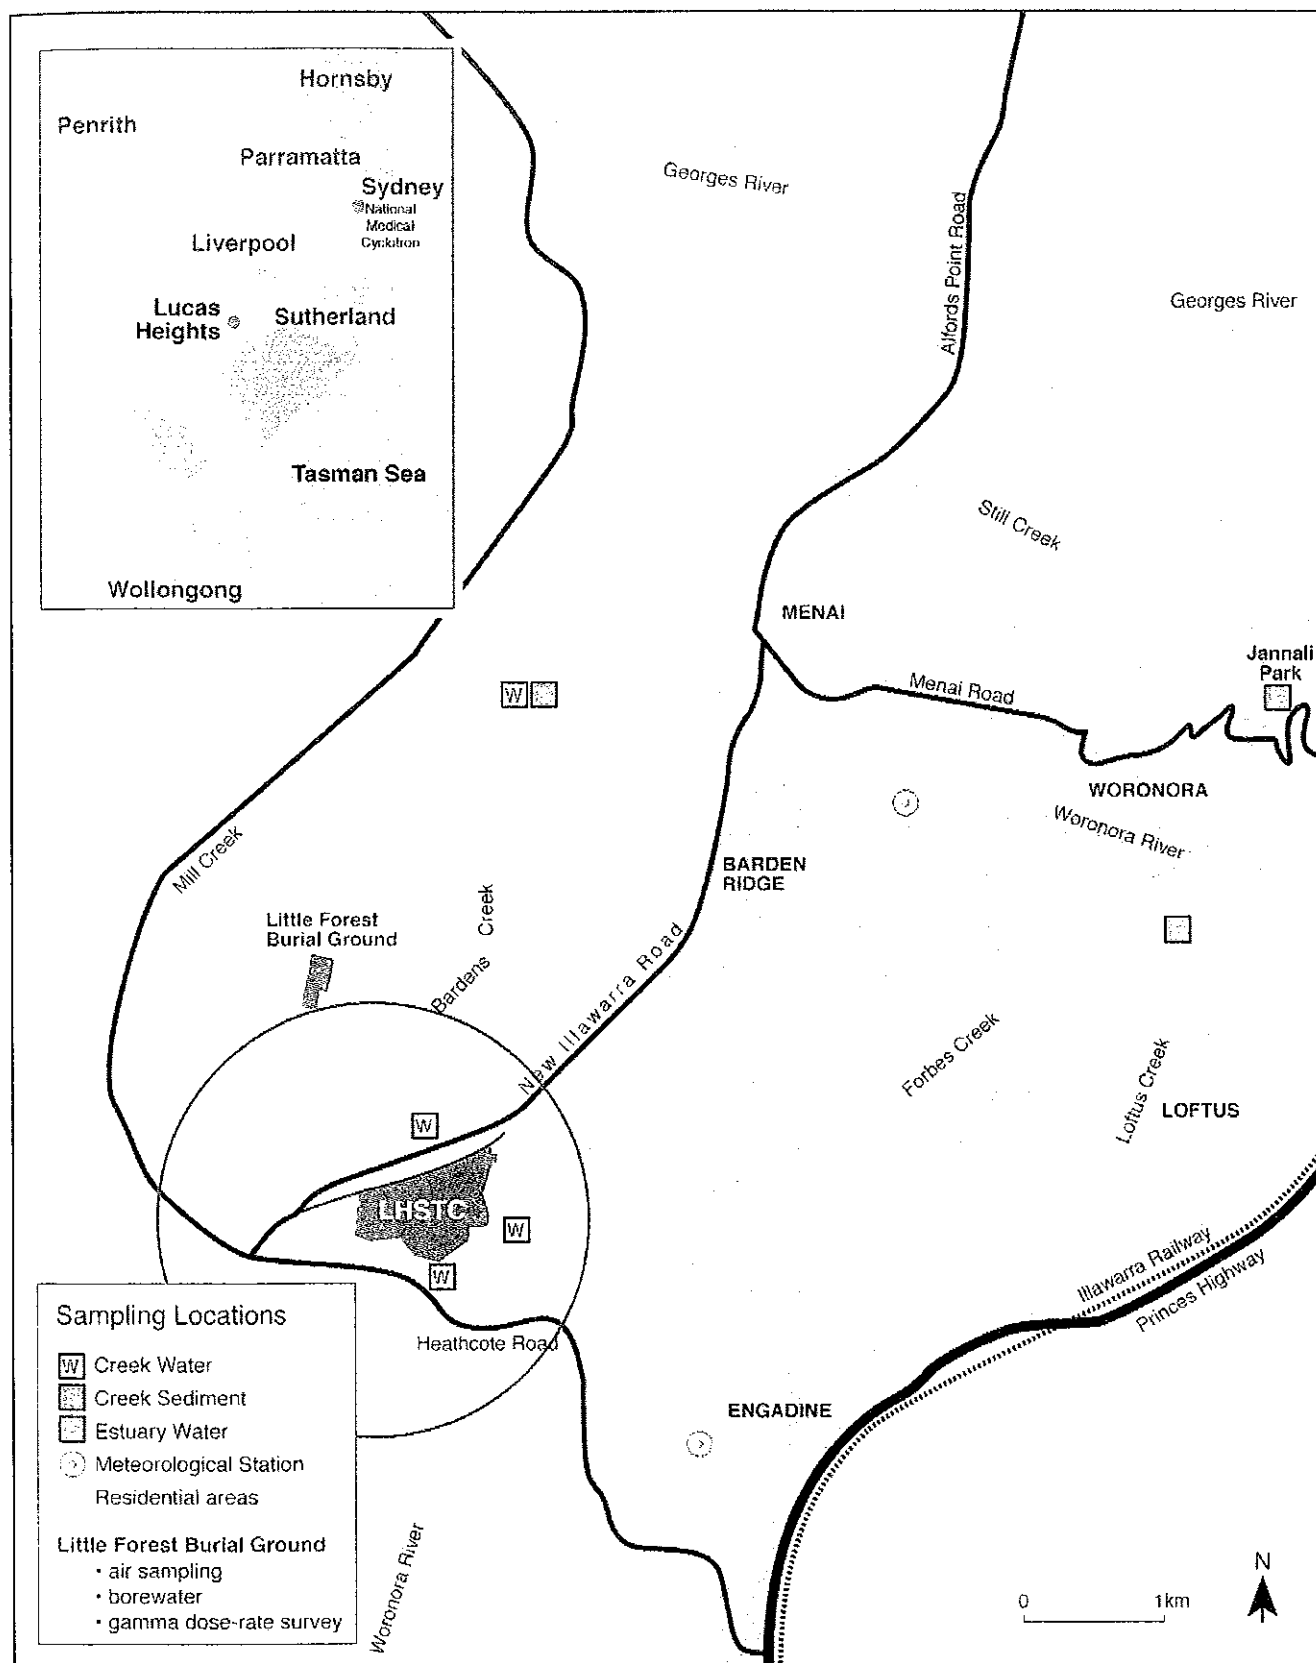


FIGURE 1
Location of LHSTC & Offsite Sampling points

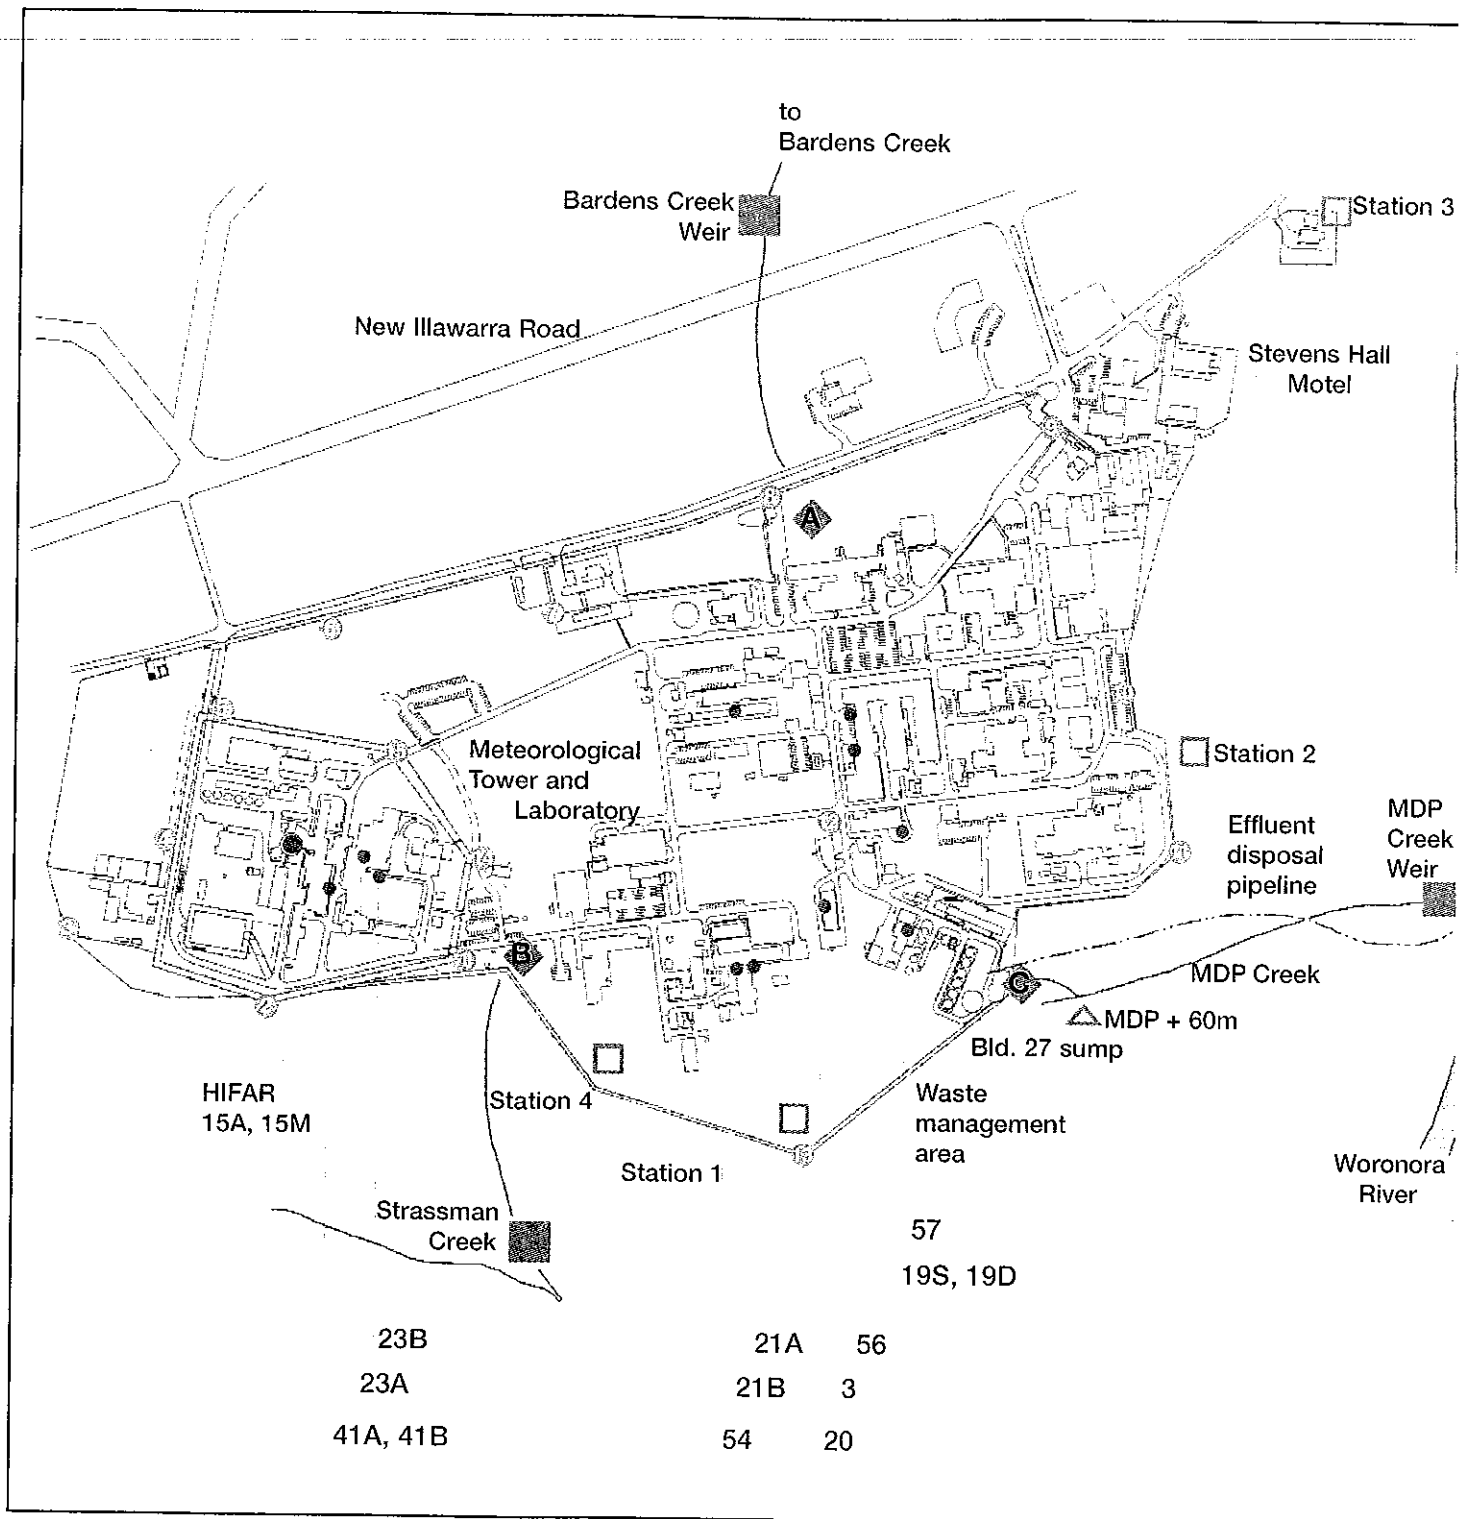


FIGURE 2

Locations of Stormwater, Air and External Radiation Monitoring Points at LHSTC

Stormwater and air sampling points

Stormwater retention bunds

- Continuous air sampling stations
- SPCC sampling point (water)
- △ MDP + 60m (water)
- ◆ Behind building 1
- ◆ Opposite meteorological tower
- ◆ MDP
- Airborne effluent release stacks
- ② External radiation dosimeters (TLDs)

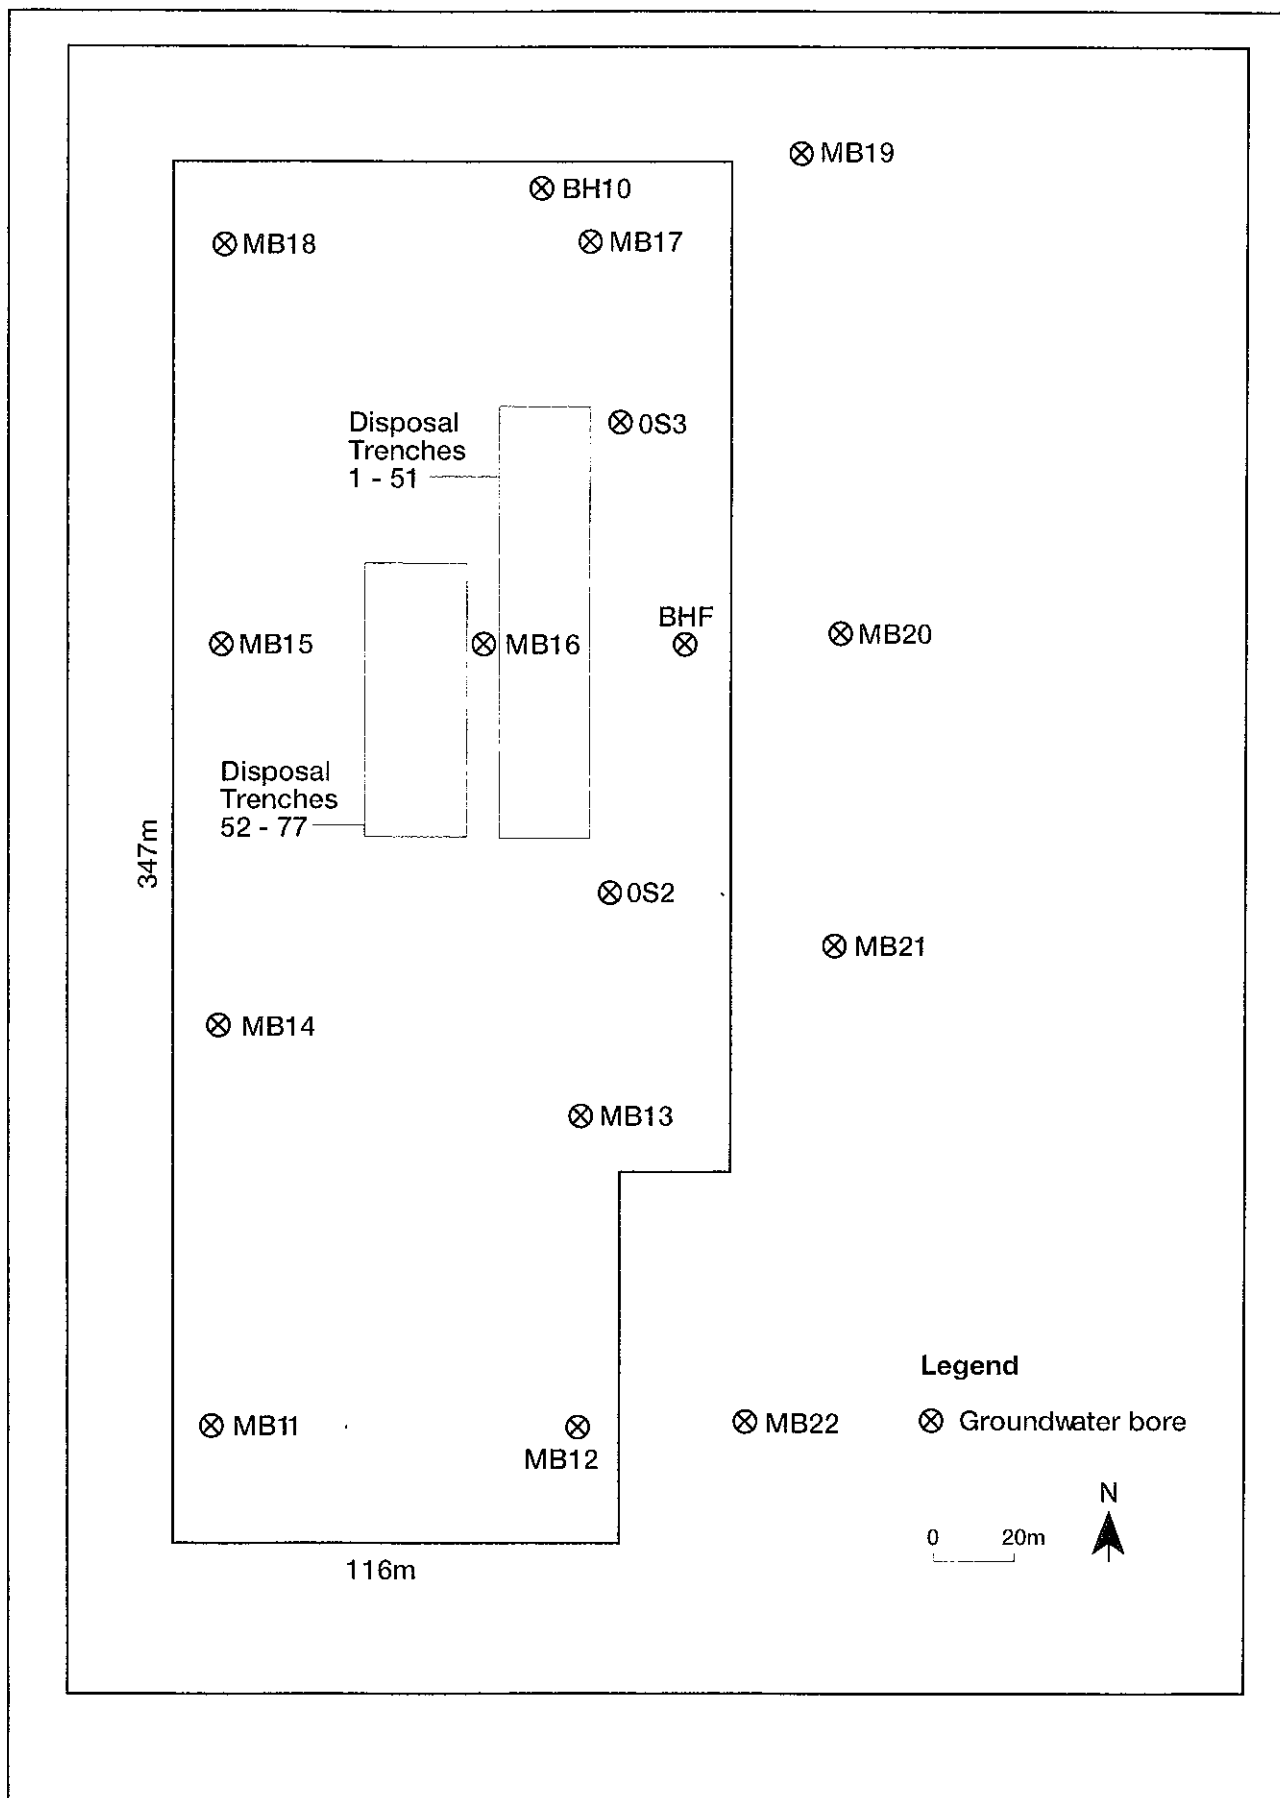


FIGURE 3
Little Forest Burial Ground - Location of Trenches & Groundwater Bores

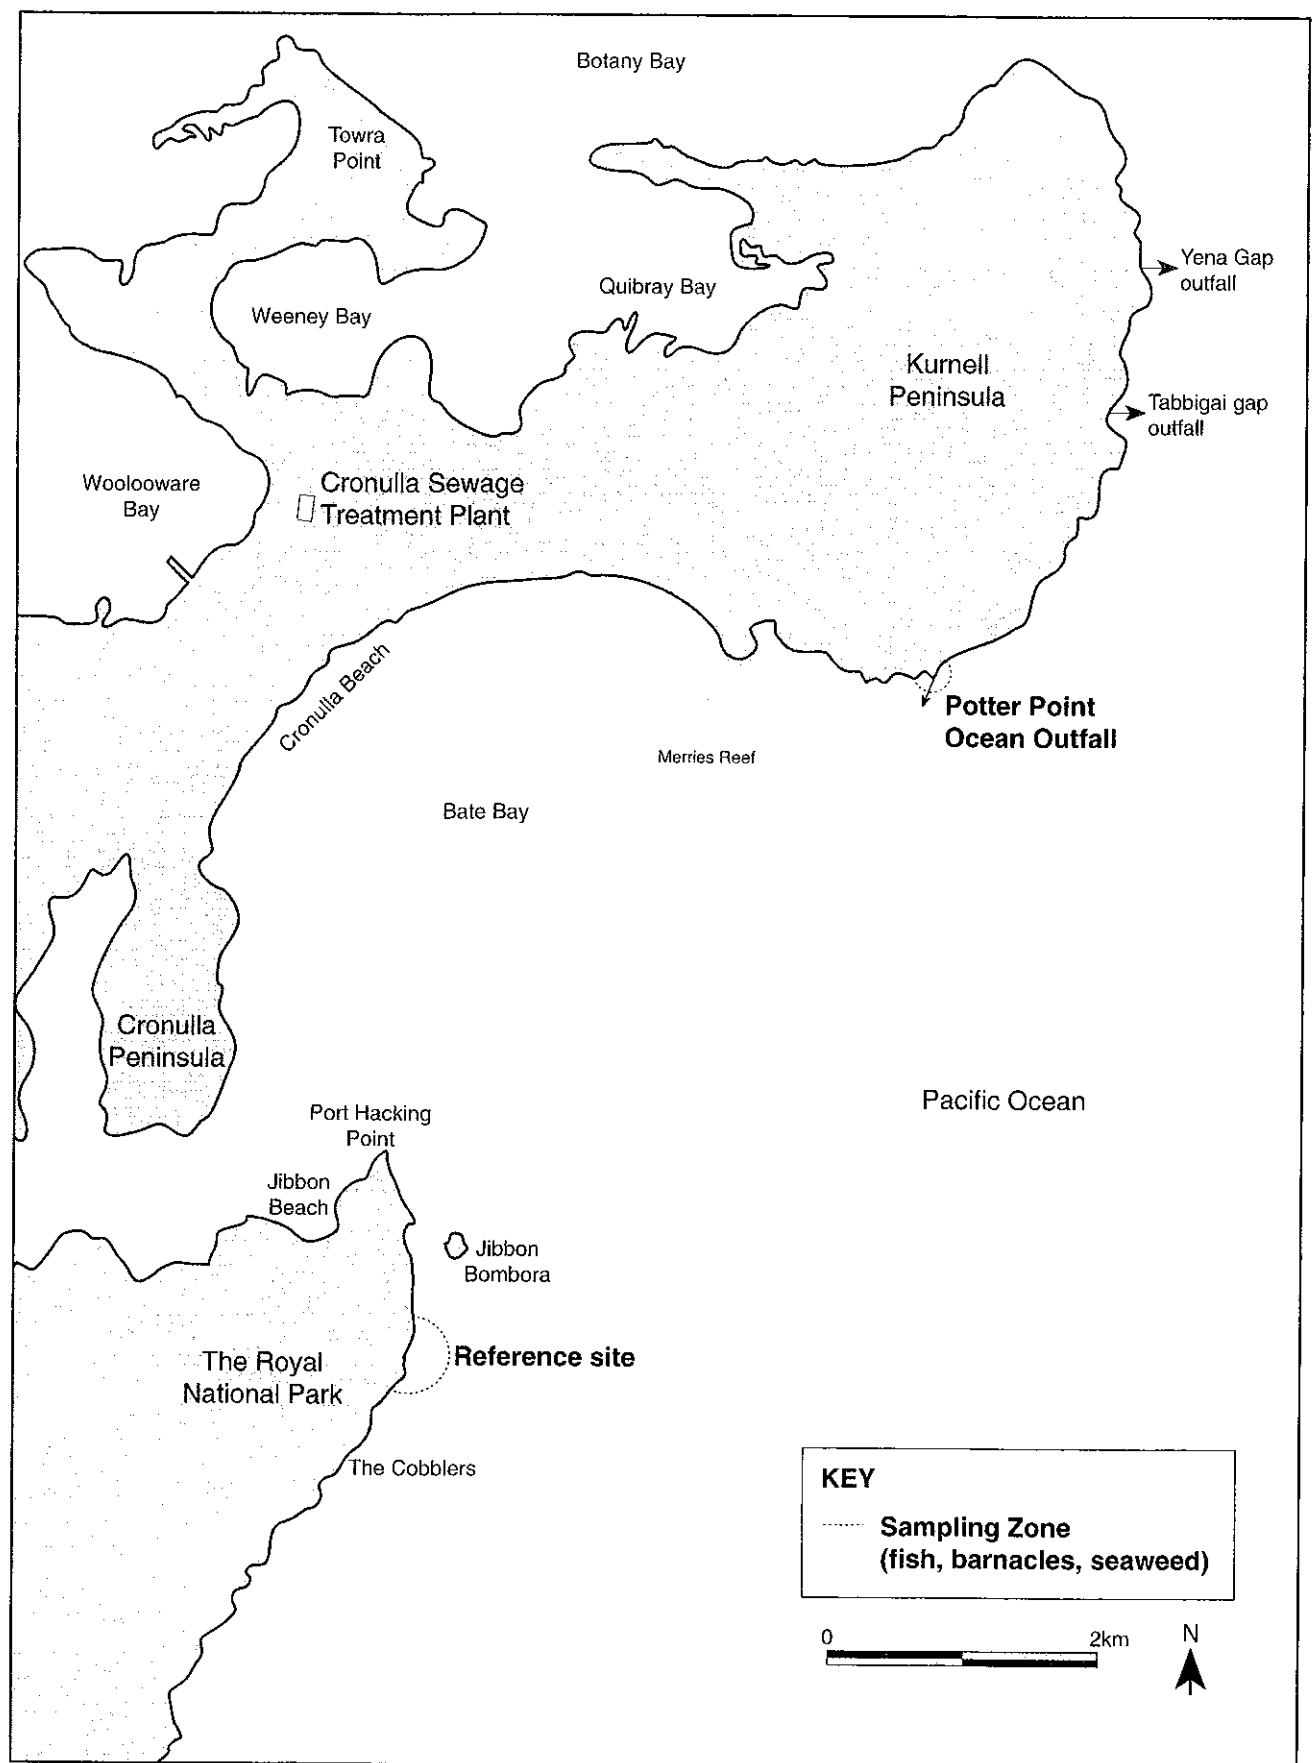


FIGURE 4
 Location of Sampling Zones at Potter Point Ocean Outfall and the Royal National Park

1 INTRODUCTION

The Australian Nuclear Science and Technology Organisation (ANSTO) is a research and development agency of the Commonwealth Government of Australia. ANSTO operates several large nuclear science and technology-based facilities, including the HIFAR research reactor, the National Medical Cyclotron (NMC) and the Australian National Tandem Accelerator. ANSTO provides services to industry, government, the research and development community and the community at large.

Figure 1 shows the location of the main ANSTO site at the Lucas Heights Science and Technology Centre (LHSTC), in relation to local roads, waterways and residential areas. The 1.6 kilometre radius buffer zone boundary around HIFAR is also shown. The National Medical Cyclotron is located next to the Royal Prince Alfred Hospital, in inner city Sydney (see inset, Figure 1).

The activities undertaken by ANSTO are supported by specialist nuclear science and technology capabilities that include:

- ♦ the operation of national facilities;
- ♦ the manufacture of radiopharmaceuticals;
- ♦ occupational health and safety associated with the nuclear fuel cycle;
- ♦ application of radioisotopes, neutrons and radioanalytical techniques;
- ♦ environmental research and monitoring;
- ♦ mineral and chemical processing technologies;
- ♦ structural integrity assessment;
- ♦ advanced ceramics; and
- ♦ management of radioactive waste.

ANSTO operations that involve radiation or radioactive material are regulated under the Australian Radiation Protection and Nuclear Safety Act 1998. The object of this Act is to protect the health and safety of people and to protect the environment from the harmful effects of radiation. The Australian Radiation Protection and Nuclear Safety Agency (ARPANSA) has been established within the Health and Aged Care portfolio to implement the provisions of the Act and the associated regulations. Under the Act ARPANSA has the authority to undertake independent audit of the effluent and environmental monitoring programs at ANSTO sites.

ARPANSA is developing criteria against which the environmental monitoring performance, with respect to radiation, of Commonwealth organisations such as ANSTO will be assessed. These criteria include:

- ♦ identification and analysis of potential exposure pathways;
- ♦ regular review of pathways where exposure could be significant; and
- ♦ detailed documentation of any decision not to monitor a specific potential exposure pathway.

A commitment to ensure that the environmental monitoring regime complies with relevant standards and codes and is in accordance with international best practice is also required. The above criteria are drawn from the following sources:

- ♦ Commonwealth of Australia (1998), *Australian Radiation Protection and Nuclear Safety Act 1998*. Commonwealth Government Printer: Canberra;
- ♦ Commonwealth of Australia (1999), *Australian Radiation Protection and Nuclear Safety Regulations 1999*. Commonwealth Government Printer, Canberra;
- ♦ International Atomic Energy Agency (1996), *Health and Environmental Aspects of Nuclear Fuel Cycle Facilities*. IAEA-TECDOC-918, IAEA, Vienna;
- ♦ International Atomic Energy Agency (1996), *International Basic Safety Standards for Protection Against Ionising Radiation and for the Safety of Radiation Sources*. Safety Series No 115, IAEA, Vienna;
- ♦ Nuclear Energy Agency and International Atomic Energy Agency (1999), *Environmental Activities in Uranium Mining and Milling*. OECD, France; and
- ♦ Worksafe Australia (1995), *National Standard for Limiting Exposure to Ionising Radiation*. NOHSC:1013, 1995, AGPS, Canberra.

ANSTO has a Health, Safety and Environment Policy (Appendix F), which commits the Organisation to undertaking its activities in a manner that protects human health and the environment and is consistent with national and international standards. The Policy further mandates that all procedures are not only in accordance with Commonwealth legislation but also take account of relevant NSW regulations and Australian and international standards on environmental management and quality systems.

ANSTO provides verifiable evidence of the fulfilment of the policy through a program of monitoring and audit. In addition, the monitoring program is designed to detect and quantify any accidental releases of radioactive materials, should they occur.

This report summarises the results from the environmental and effluent surveys carried out at the LHSTC and NMC sites during 2000, and assesses the effects of radioactive discharges on both the local population and the environment. The results obtained in previous years have been published regularly and are listed in Appendix A.

2 ENVIRONMENTAL EXPOSURE PATHWAYS - LHSTC

The main environmental pathways by which radionuclides from LHSTC may potentially enter the environment and lead to radiation exposure of members of the general public are:

- ♦ atmospheric discharges from stacks (including tritium, volatile fission products, activation products and noble gases released from isotope production facilities, research laboratories and the HIFAR research reactor);
- ♦ discharge of low-level liquid effluent via the Sydney Water Corporation Ltd. (hereafter referred to as Sydney Water) sewer system to the ocean at the Potter Point outfall;
- ♦ radionuclide transport by surface/ground water and/or contaminated airborne particulate dispersion from the low-level radioactive waste disposal site at Little Forest; and
- ♦ accidental airborne releases, or liquid spills which enter the stormwater system.

In addition, there is potential for a small, localised external dose from gamma radiation emitted by stored wastes on site.

2.1 ATMOSPHERIC DISCHARGES FROM LHSTC

Atmospheric discharges from LHSTC have been regulated since 1968 when expansion of radioisotope production made it necessary to consider possible exposure pathways for airborne releases of radionuclides, such as noble gases and iodine-131. Noble gases, including argon-41 from HIFAR, and radioisotopes of xenon (Xe-133, Xe-135 and Xe-135m) and krypton (Kr-85) from production of radiopharmaceuticals, are the major contributors to the small public dose arising from ANSTO's operations.

The computer code used to model ANSTO's airborne effluent releases and assess the resulting dose is called PC-Cream (see Section 3.2).

The pathway for potential transfer of deposited airborne radioactivity to humans via ingestion of contaminated drinking water or vegetable produce is not considered to be significant, for the following reasons:

- ♦ any (small) ANSTO contribution to public dose would be dominated by external radiation from short-lived noble gases, which are inert and cannot be concentrated in the food chain;
- ♦ there is little or no commercial food production or processing in the neighbourhood of LHSTC; and
- ♦ small creeks receiving run-off from the site are not used as sources of drinking water.

Nevertheless, the ingestion pathway for locally grown vegetables is included in the PC-Cream dose assessment for the general public.

Iodine-131 has the potential to concentrate in milk after deposition onto grazing land, therefore locally produced milk (for private consumption) was tested for radionuclides until 1993. The registered dairy herd closest to LHSTC is now approximately 13 kilometres away (NSW Dairy Corporation, 2000). At this distance the milk pathway is not significant and is not considered further.

The critical group for inhalation of airborne activity is people living close to the LHSTC perimeter at the Stevens Hall Motel. Continuous samplers (to monitor ambient levels of iodine-131 in air) are positioned near the site perimeter fence at locations nearest to suburban residences and the motel. See Figure 2 for the location of Stevens Hall Motel and the air sampling stations, Section 5.8 for the results.

Levels of integrated external radiation at the LHSTC and in nearby suburban locations were measured during 2000 using dosimeters issued by ARPANSA. Results of this monitoring are discussed in Section 5.10.

As in the past, ANSTO would be pleased to measure the levels of environmental radioactivity in samples identified by the local community. Contact the Communications Manager at ANSTO for further information.

2.2 LOW-LEVEL LIQUID EFFLUENT DISCHARGES FROM LHSTC

The low-level liquid effluent generated from various operations at the LHSTC is chemically treated, analysed and documented to verify compliance with authorised limits before discharge to the Sydney Water sewer. In accordance with the Sydney Water Trade Wastewater Agreement (No. 4423, 1999) the authorised discharge limits for radioactivity are based upon the WHO Guidelines for Drinking Water Quality (1993), see Section 3.1.

Low-level liquid effluent from ANSTO passes through the Cronulla Sewage Treatment Plant (CSTP) and is discharged to the ocean via the Potter Point outfall along with other effluent from the Sutherland Shire. Potential exposure scenarios for members of the public would include consumption of fish caught around the Potter Point outfall and incidental ingestion of seawater near the outfall by swimmers and surfers.

In 1993, tracer studies were undertaken at the Cronulla STP and around the Potter Point outfall to determine dilution factors for effluent releases from the LHSTC. The results were published in the ANSTO report, *Environmental and Effluent Monitoring at LHSTC, 1994*.

Biological and seawater monitoring programs have been operating at Potter Point since 1995. The respective results for the current year are presented in Sections 5.3 and 7 of this report.

External gamma radiation levels at the CSTP have been monitored since July 1999, using thermoluminescent dosimeters. The measurements in 1999 and 2000 were at background levels (see Section 5.10).

The monitoring programs at Potter Point confirm that the pre-discharge treatment of effluent at ANSTO, combined with the large dilution effects measured in both the sewer system and the ocean, ensure that levels of radioactivity from ANSTO in the ocean are negligible and of no radiological consequence for members of the public or employees of Sydney Water.

2.3 THE LITTLE FOREST BURIAL GROUND (LFBG)

Between 1960 and 1968 the Australian Atomic Energy Commission (AAEC) used a small area locally known as Little Forest (see Figure 1) for the disposal by burial of solid waste with low levels of radioactivity and beryllium oxide (non-radioactive) that originated predominantly from LHSTC.

The selection of the site and waste disposal operations followed international guidelines and best practice relevant at the time. Near-surface disposal is still widely accepted internationally as a safe and practical way to dispose of low level solid radioactive waste, provided that the possible return of radionuclides via the human food chain, water or inhaled air, as well as possible exposure due to external radiation, are strictly controlled.

Potential exposure pathways to members of the general public, from the wastes buried at LFBG, would be associated with the off-site transport of radionuclides by surface or ground waters or by windborne movement of contaminated particulates from the surface of the burial area.

Various government agencies and private companies have used areas adjacent to LFBG for the disposal of liquid industrial wastes, solid municipal wastes and nightsoil. Some nearby areas were quarried for clay and shale, until the closure of the quarries in December 1998.

Ground water and surface water associated with the LFBG and surrounding area are not utilised as a potable water supply, and the ephemeral nature of the streams excludes their use for irrigation of crops. The hydrogeological conditions at LFBG ensure that groundwater movement in the immediate area of the waste is very slow and most radionuclides, with the exception of tritium, are strongly adsorbed onto the clay subsoil.

Airborne contamination at LFBG could potentially occur through wind suspension of any radioactive particulates at the ground surface. Surface contamination could arise following erosion of cover material, or the movement of contaminated ground water to the surface, followed by precipitation of radionuclides. The airborne particulate pathway requires special consideration at LFBG since the site was also used for the disposal of beryllium oxide. Beryllium is not radioactive but is chemically toxic if inhaled as a fine dust.

The vegetative and clay/shale trench cover at LFBG is regularly inspected and any sign of deterioration is remedied.

The radiation levels over the disposal trench area are at normal background radiation levels (see Section 5.7). Direct exposure to external radiation from buried waste would only become a consideration if the waste was exposed through erosion or subsidence of the soil cover, or if dissolved radionuclides were transported to the surface by ground water.

3 DISCHARGE AUTHORISATIONS

ARPANSA is developing guidelines for the routine discharge of radioactive waste to the sewage system and to the atmosphere. For the period covered by this report, a discharge authorisation from ARPANSA only applied to HIFAR. Broadly speaking, these guidelines are based on the following documents:

- ♦ Commonwealth of Australia (1999), *Australian Radiation Protection and Nuclear Safety Regulations 1999*, Commonwealth Government Printer, Canberra; and
- ♦ National Health and Medical Research Council (1985), *Code of Practice for the Disposal of Radioactive Wastes by the User (1985)*, AGPS: Canberra.

Key elements of these expectations include comprehensive documentation, monitoring and review of all discharges. ANSTO will need to ensure that appropriate Statutory Authorities are notified and the requisite approvals are obtained. ANSTO's Health, Safety and Environment Policy is fully consistent with these expectation guidelines.

In 2000 ANSTO complied with:

- ♦ new requirements prescribed by ARPANSA;
- ♦ all provisions of relevant NSW acts and regulations; and in particular

- ♦ provisions of the Sydney Water Trade Waste Service Agreements No. 4423 (1999) and No. 13966 (1994) for the LHSTC and NMC sites, respectively.

In 2000 the results of ANSTO's effluent monitoring programs at the LHSTC were independently checked by the (non-regulatory) Environmental and Radiation Health Branch of the ARPANSA, based in Melbourne.

Summaries of annual levels of radioactivity in authorised discharges from LHSTC are presented in this and previous environmental survey reports (see Appendix A).

3.1 LOW-LEVEL LIQUID EFFLUENT - LHSTC

Under the terms of the Sydney Water Trade Waste Service Agreement No. 4423, (1999, as amended) ANSTO complied with:

- ♦ discharge levels for radioactive pollutants listed in Schedule 1, paragraph 1(b) of the Agreement, at the ANSTO composite effluent sampling and discharge point;
- ♦ the World Health Organisation (WHO) *Guidelines for Drinking-Water Quality*, (1993) reference activity concentrations for radionuclides in drinking water at the Cronulla Sewage Treatment Plant; and
- ♦ concentration limits for non-radioactive components of the effluent.

The basis for compliance with the WHO *Guidelines for Drinking-Water Quality* (1993) are set out in Schedule 1, paragraph 1(c) in the following terms:

"...average monthly activity concentrations of discharges by ANSTO to the Sydney Water Corporation sewer shall not exceed 25 times the reference activity concentrations for radionuclides as determined by the application of the methodology specified in the WHO *Guidelines for Drinking-water Quality*, Volume 1 Recommendations, Second Edition (1993), corresponding to the reference level of dose of 0.1 mSv/year."

It should be noted that these guidelines are calculated assuming that the dose is to an adult, drinking 2 litres of water daily for a year.

The drinking water Reference Activity Concentrations (RAC) for specific radionuclides are calculated using the following formula taken from the WHO Guidelines (1993):

Equation 1:

$$\text{Reference Activity Concentration (Bq/L)} = \frac{1.4 \times 10^{-7} \text{ (Sv/litre)}}{\text{Dose conversion factor (Sv/Bq)}}$$

Reference Activity Concentrations (RAC) for relevant radionuclides are listed in Table A. Note that the RAC are calculated using the WHO methodology (*Equation 1*), but with updated dose conversion factors specified in *International Basic Safety Standards for Protection Against Ionising Radiation and for the Safety of Sources*, IAEA, 1996, Table II – VI. This document was jointly issued by six organisations, including the WHO. The majority of RAC given in Table A are similar to, or more restrictive than, those of WHO (1993).

Cobalt-60 is an exception, in that it has a more restrictive RAC (20 Bq/L) under the WHO (1993) guidelines.

TABLE A: Reference Activity Concentrations (RAC) for Selected Radionuclides

Radionuclide	Dose Conversion Factor. (Sv/Bq)	Drinking Water Reference Activity Concentration (RAC). (Bq/L)	Activity Concentration Equivalent in liquid effluent discharged from ANSTO. (Bq/L)
	<i>IAEA Safety Series No 115, 1996</i>	<i>Equivalent to a dose of 0.1 mSv/year</i>	<i>25 x drinking water RAC</i>
Beta-emitters			
Tritium	1.8×10^{-11}	7800	195000
Cobalt-60	3.4×10^{-9}	40	1000
Caesium-137	1.3×10^{-8}	10	250
Caesium-134	1.9×10^{-8}	7	175
Iodine-131	2.2×10^{-8}	6	150
Strontium-90	2.8×10^{-8}	5	125
Radium-228	6.9×10^{-7}	0.20	5
Lead-210	6.9×10^{-7}	0.20	5
Alpha-emitters			
Radium-226	2.8×10^{-7}	0.5	12.5
Americium-241	2.0×10^{-7}	0.7	17.5

3.1.1 Radioactivity Concentration Limits

When monitoring liquid effluent at the ANSTO point of discharge to the sewer, all discharges must be below the relevant Activity Concentration Equivalent (ACE). These ACE values (see table above) are based on an agreed dilution factor for ANSTO's discharges of 25 (allowing for dilution between ANSTO and the Cronulla STP). Tracer studies conducted on liquid effluent releases in 1993 (ANSTO report E-717, 1994) were used to determine the in-line dilution factors. The dilution factors have since been measured on a six-monthly basis since 1995 (see Section 7), confirming that the agreed dilution factor of 25 is very conservative.

Where more than one radionuclide is present, the sum of the average concentrations (C_i) of all radionuclides on release (expressed as a fraction of the relevant ACE) is taken. This is termed the concentration quotient and must be no greater than one, *ie*

$$\text{Equation 2: Concentration Quotient} = \sum_i \frac{C_i}{\text{ACE}} \leq 1$$

For a mixture of unspecified alpha and beta radionuclides and tritium, the monthly concentration quotient is calculated using the summation formula in Equation 2, based on the ACE for the most restrictive alpha-emitters, beta-emitters and for tritium, *ie*

$$\text{Equation 3: } \frac{\alpha}{\text{ACE } ^{226}\text{Ra}} + \frac{\beta}{\text{ACE } ^{90}\text{Sr}} + \frac{^3\text{H}}{\text{ACE } ^3\text{H}} \leq 1$$

Where:

- α = average gross alpha concentration in effluent discharged;
- β = average gross beta concentration in effluent discharged;
- ^3H = average tritium concentration in effluent discharged; and
- ACE = Activity Concentration Equivalent for the most restrictive radionuclide (or tritium), as specified by the Sydney Water Trade Waste Service Agreement, 1999.

Within the terms of the Trade Waste Service Agreement, it is assumed that all alpha and beta radiation come from the most restrictive nuclide of each type as defined in the table. Where the presumed most restrictive alpha or beta emitting radionuclide can be shown to be an insignificant fraction of the overall alpha emitting components in the effluent, then the activity concentration equivalent of the next most restrictive radionuclides may be used.

In addition, ANSTO is required to:

- ♦ confirm that Ra-228 is not present in the waste water discharged to the sewer by analysing the monthly composite sample specifically for the Ra-228 content; and
- ♦ continue efforts to reduce tritium in the waste stream.

Composite samples of ANSTO's monthly liquid effluent discharges (proportionately sampled from all discharges for the month) are analysed for the beta-emitters radium-228 and lead-210. The results for samples analysed in 2000 were all less than the limit of detection, indicating these radionuclides are not present in the liquid effluent in significant proportions. Therefore, as in previous years, the gross (unspecified) beta radioactivity is reported in terms of the strontium-90 ACE, while the gross alpha activity is reported using the ACE for radium-226.

3.1.2 Compliance Auditing of Liquid Effluent Discharges

In 2000, ARPANSA randomly requested some of the monthly pipeline composite samples from ANSTO's Waste Operations and carried out independent analyses. These analyses confirmed that discharges were in compliance with the Sydney Water Trade Wastewater Agreement. In addition, Sydney Water also collected random liquid effluent samples from the ANSTO discharge pipeline at LHSTC, to assess compliance with their requirements for the acceptance of liquid trade waste. Sydney Water did not raise any non-conformances against ANSTO in 2000. Section 6.2 presents the results of ANSTO's compliance monitoring of LHSTC liquid effluent discharges.

3.2 ATMOSPHERIC DISCHARGES - LHSTC

From 1968 until 1988, radioactive airborne emissions from AAEC/ANSTO were subject to a discharge authorisation approved by the NSW Radiological Advisory Council (RAC) which specified the maximum amount of radioactivity that could be discharged from each of the stacks at LHSTC during a given time period.

In December 1988, a revised site-wide airborne radioactive effluent discharge limit for LHSTC was authorised by the NSW RAC. The revision arose out of changes to International Commission for Radiological Protection (ICRP) and

NH&MRC recommendations, to changes in site operations, to advances in radiation dosimetry and to increased knowledge of the meteorology at LHSTC.

The revised authorisation limit was based on limiting the total amount of radioactivity discharged to the atmosphere from LHSTC, such that the sum of the effective dose to any member of the public from all stack discharges would not exceed 0.5 mSv. This is half of the annual effective dose limit for members of the general public recommended by the NH&MRC and specified in the NSW Radiation Control Regulation (1993).

3.2.1 LHSTC Site Dose Constraint

In August 1993, the Research Reactor Review Panel recommended that ANSTO should commit itself to emission targets and, in particular, a single-source dose constraint of 0.3 mSv (see Glossary for the definition of dose constraint). This recommendation was adopted by ANSTO. In August 1997 the Nuclear Safety Bureau (replaced by ARPANSA) issued a revised HIFAR Radioactive Airborne Discharge Authorisation specifying four weekly, quarterly and annual notification levels with a HIFAR dose constraint of 0.1 mSv. It also confirmed that a dose constraint of 0.3 mSv was appropriate for the whole site. As indicated above, the site dose constraint previously authorised by the NSW RAC was 0.5 mSv.

3.2.2 PC-Cream Code

In June 1998 the Nuclear Safety Bureau authorised the use of a European computer code, PC-Cream⁽¹⁾ to replace the ANSTO-developed ADDCOR code⁽²⁾ for estimating effective doses due to airborne discharges from the LHSTC site. This is an internationally accepted code that includes the latest ICRP dose conversion factors. The PC-Cream computer code has been used to model environmental transport of, and estimate effective doses from, all site discharges since 1997. Refer to Section 6.1 for results of airborne emission monitoring.

Although the small ANSTO contribution to public dose is dominated by external radiation from noble gases, other pathways such as inhalation of radionuclides and ingestion of vegetables are included in the PC-Cream dose assessment. A number of assumptions are used by PC-Cream for defining the critical groups of members of the public. Like most computer models, some of the assumptions made within PC-Cream can be altered by the user while others cannot. These assumptions are generally conservative and may lead to some overestimation of the dose received. The following user-defined assumptions are included:

- ♦ a person is assumed to be outdoors, at the boundary of the buffer zone, 100% of the time for an entire year. Because they are assumed to be outdoors, there is no assumed shielding;
- ♦ 25% of the hypothetical person's diet of green vegetables (47 kg/annum), root vegetables (84 kg/annum) and fruit (148 kg/annum) is assumed to be grown at the buffer zone boundary, and all other food is grown away from the local area. Diet is based on Australian Bureau of Statistics data;

¹ Refer to ANSTO Safety and Reliability Report SD/SR/TN 98-7 revision 1, August 1998.

² Atmospheric Dispersion and Dosimetry Code for Operators and Regulators. Refer to ANSTO/DR25, 1989.

- ♦ only adult doses are included but note that the calculated child and infant doses are approximately the same as the adult dose due to the dominance of the contribution from noble gases.

Other assumptions are intrinsic to PC-Cream and cannot be altered by the user, for example:

- ♦ that the effective release height for airborne effluent is the same as the stack height, so that buoyancy, velocity and building wake effects are not included.

Appendix B lists the various types of radioactive airborne effluent releases from LHSTC and their origin.

3.2.3 Compliance Monitoring of LHSTC Atmospheric Discharges

ANSTO monitored stack discharges on a weekly basis, with monthly reporting to ARPANSA. Independent confirmation of these measurements was undertaken by a peer laboratory, the Environmental and Radiation Health Branch of the ARPANSA. See Section 6.1 for a discussion of the stack monitoring results.

3.3 SURFACE WATERS NEAR LHSTC

In 1985, in order to assess ANSTO's compliance with the regulations existing at the time, three sampling points on local streams were selected by the NSW State Pollution Control Commission (SPCC)⁽³⁾, at Strassman, MDP and Bardens Creeks. These three creeks, shown on Figure 2, receive most of the stormwater that runs off the LHSTC site.

The Protection of the Environment Operations Act (1997) refers to the Clean Waters Regulations (1972). These regulations limit the gross alpha and gross beta radioactivity in wastes discharged to Class C (Controlled) waters to 1.1 and 11.1 Bq/L, respectively.

Results of stormwater and surface water sampling are discussed in Sections 5.4 and 5.5 of this report.

A new sampling regime will be implemented in 2001 under ANSTO's Environmental Monitoring Action Plan (EMAP) project, to assess the non-radiological water quality characteristics of stormwater from the LHSTC site.

4 MEASUREMENT OF RADIOACTIVITY

This section presents a brief description of the radioactivity analyses performed, the radionuclides commonly found and information on natural radioactivity in environmental samples. The statistical analysis of data is also discussed. Definitions of terms can be found in the Glossary. The radioisotope symbols used in this report are listed in Appendix C.

4.1 TYPES OF RADIOACTIVITY MEASURED

Gross alpha activity: refers to the measurement of total alpha activity from unspecified nuclides in a sample. Screening for gross alpha emitters is a rapid,

³ Now the NSW Environment Protection Authority (EPA)

semi-quantitative technique used to determine whether more complete analyses for specific radionuclides are warranted.

Gross beta activity: refers to the measurement of the total beta activity from unspecified nuclides in a sample. Tritium is not included in these assays and is reported separately.

Gamma activity: refers to the gamma rays emitted from radionuclides, which are analysed on a high purity germanium solid-state detector. A gamma spectrum for each sample is accumulated, with an energy range of 20 keV to 2000 keV. The gamma photopeaks in the spectrum are then analysed for significant nuclides and the specific activity calculated. Nuclides detected by this method include cobalt-60, caesium-137 and iodine-131.

Caesium-137: is a fission-product that was widely dispersed around the world by fallout from nuclear tests performed in the atmosphere. It has a half-life of 30.14 years. The isotope is deposited on land in precipitation or as 'dry' fallout, and adsorbs strongly onto fine sediments (like clays). A typical value for soils in the Sydney region is 1350 Bq/m² (Cole-Clark, 1993). Caesium-137 is widespread in foods, since its chemical behaviour is similar to that of potassium (an element essential to all living things). This isotope is also abundant in the marine environment and hence can be found in marine biota such as fish and shellfish. Caesium-137 is also formed as a by-product of the production of technetium-99m generators for medical purposes.

Cobalt-60: is an activation product formed in reactors by the neutron activation of stable cobalt-59 (often present in steel components). It has a half-life of 5.26 years and is a beta-gamma emitter. This isotope is readily concentrated by both aquatic and terrestrial organisms.

Iodine-131: is a beta/gamma-emitting radionuclide with a relatively short half-life of 8.02 days. Iodine-131 is used in hospitals to diagnose and treat various diseases associated with the thyroid. It is biologically important because atmospheric releases of iodine-131 can deposit onto pasture and be incorporated into milk. Human consumption of this milk can then lead to iodine-131 uptake by thyroid tissue. Further, inhalation of gaseous iodine-131 can also result in doses to the lung and thyroid. See Appendix B for the sources of airborne iodine-131 at the LHSTC. If present in water, iodine is more readily concentrated by marine biota than by freshwater organisms.

Tritium (³H): is a radioisotope of hydrogen, with a half-life of 12.26 years. It decays with the emission of a weak beta particle, with a maximum energy of 18.6 keV and an average energy of 5.69 keV (there is no gamma emission). The penetration of the tritium beta is consequently low (the stopping distance is about 7 mm in air, 0.01 mm thickness of paper, or the outer dead layer of human skin). Exposure through internal uptake is therefore the main consideration when assessing radiation dose due to tritium. The WHO drinking water reference level for tritium (7800 Bq/L) reflects the fact that tritium is not as biologically hazardous as other radionuclides having more energetic radiations (see Table A in Section 3.1).

Tritium is widespread in the environment. It is a cosmogenic radionuclide, which was also produced as a result of atmospheric nuclear weapons testing (by far the largest contribution). It is also produced in nuclear reactors

(particularly in reactors such as HIFAR with heavy water moderators) by neutron activation of deuterium. See Appendix B.

Tritium (as tritiated water) is chemically indistinguishable from normal water and may be taken up as such by living organisms. The biological half-life of tritium is relatively short, with one half of the absorbed tritium being excreted from the body typically in the order of days. When present, tritium is found more or less uniformly distributed throughout living species, not accumulated in any particular organ. The concentration factor is ordinarily assumed to be equal to one. Tritium is therefore not considered to accumulate in aquatic organisms above the concentration found in the surrounding water.

Tritiated water does not undergo geochemical processes such as ion exchange, adsorption or precipitation and can therefore be used as a tracer for groundwater movement.

4.2 NATURAL RADIOACTIVITY IN ENVIRONMENTAL SAMPLES

Uranium and thorium series

The uranium-238 and thorium-232 chains are two of the primordial radioactive decay series found in nature. The extremely long half-lives of the parent nuclides (4500 million and 14000 million years respectively) mean that the various progeny produced by their decay are ubiquitous in nature, occurring to varying degrees in soils, water, vegetation and air. When present in environmental samples, the decay products of the uranium and thorium series can contribute significantly to the levels of gross alpha, gross beta and gamma radioactivity of such samples. Levels of the uranium-238 and thorium-232 series in LHSTC environmental survey samples have not been quantified, because of their natural origin. If progeny of the uranium-238 and thorium-232 decay series are detected during gamma spectroscopy of samples, their presence is reported in the relevant tables simply as "U & Th series". Typical activities of uranium and thorium and each of their 24 radioactive products range from 0.001 to 0.520 Bq/g in different soil types (UNSCEAR 1993: Table 5, p 65).

Potassium-40

Potassium-40 (half-life 1280 million years) is a primordial radioisotope of potassium, found in rocks, natural waters and all material of plant and animal origin. Potassium-40 occurs naturally in a fixed ratio to stable potassium, and decays by beta/gamma emission with a specific activity of 27.6 Bq/g of potassium (NH&MRC 1987). Potassium-40 does not accumulate in the body but is maintained at a constant level. The average concentration of potassium in an adult male is about 2 g per kg of body weight, or about 60 Bq of potassium-40 per kg of body weight.

For crustal rock, the mean potassium-40 activity is about 0.63 Bq/g, while some granites may have concentrations exceeding 1.85 Bq/g (Kathren, 1984). Soils are lower, with a mean of around 0.44 Bq/g.

4.3 QUALITY MANAGEMENT

ANSTO's Quality Policy (see Appendix G) requires activities to be undertaken in a manner that promotes a quality culture for planning and undertaking research and development, the provision of items and services and reporting of these activities. Consistent with this policy, a formal commitment to quality

systems is fundamental to obligations accepted by ANSTO within the framework of the environmental assessment process for the replacement reactor. ANSTO is in the process of introducing an ISO 9000/2000 regime across the site (including the monitoring laboratories) and has made a commitment to implement the ISO 14001 standard for Environmental Management Systems.

The Environment Division was certified as meeting the ISO 9001:2000 standard for Quality Management Systems in December 2000 (certificate No. QEC12839). In October 2000 the Safety Division external dosimetry, health physics instrument calibration and stack sampling operations gained certification to the AS/NZS ISO 9002:1994 standard.

4.3.1 Methods - Environmental Radiochemistry Laboratory

Australian or International Standard methods for radiological analyses are used, where they are available. Methods for gamma spectrometry, gross alpha, gross beta and tritium analyses of waters are documented and incorporate techniques based on those used by the ARPANSA Environmental Radioactivity Section. See Appendix D for details of sample analysis techniques.

Blanks and standards are counted regularly and are often included with each batch of samples. Instruments and detectors are regularly calibrated against certified standard materials. During tritium, gross alpha and gross beta analyses, samples were counted up to five times. Long counting times of 23 hours are employed for low-level gamma spectrometry samples.

Results are reported with the appropriate number of significant figures. All data entries are double-checked before results are released.

4.3.2 Counting Statistics

Most of the results from the environmental monitoring program are reported using the principles of counting decision levels endorsed by Gilmore & Hemingway in *Practical Gamma-ray Spectrometry* (1995), Chapter 5, Section 5.6, pages 119-124. The statistical significance of a sample count is based on the uncertainty of the background. See Appendix D for more information on counting statistics.

5 ENVIRONMENTAL MONITORING AT LHSTC

The monitoring program at LHSTC involves measurements of the radioactivity in local environmental samples as well as the liquid and airborne effluent discharged from the site. Details of the LHSTC effluent monitoring programs are presented in Sections 6 and 7 of this report. Environmental monitoring at the National Medical Cyclotron site is reported in Section 8.

This section deals with the results of environmental monitoring carried out at the LHSTC in 2000. The Environmental Monitoring Laboratory performs the routine environmental surveys of the site and surrounding areas.

Samples of sediment, groundwater, air and surface water were collected during 2000 at the sites shown in Figures 1 to 4 and analysed for radioactivity. Sampling locations included the Woronora River, Mill Creek, Bardens Creek, Forbes Creek, Potter Point ocean outfall, LHSTC stormwater outlets, creeks

draining LHSTC and the Little Forest Burial Ground. The on-site meteorological station collects data all year round and has been in operation since 1958. External gamma radiation levels at the perimeter of LHSTC, as well as local residences, have been measured since 1994.

The environmental sample collection and preparation schedule is shown in Table 1. More detailed information on the collection, preparation and analysis of environmental samples is available in Appendix D. Environmental survey results for 2000 are presented in Tables 2 to 18b.

5.1 WORONORA RIVER

Water samples were collected monthly from the Woronora River at the boat ramp in Jannali Reserve and analysed for tritium. No tritium was detected in these samples during 2000 and none has been detected since July 1980, when discharges of treated liquid effluent from LHSTC to the Woronora River ceased. The data are listed in Table 2.

5.2 FORBES CREEK

Water from the confluence of Forbes and Loftus Creeks (tributaries of the Woronora River) was sampled monthly in 2000 and analysed for tritium. The samples were taken after rain (when possible) from the point where the Sydney Water supply pipeline crosses Forbes Creek, shown on Figure 1.

Sampling at Forbes/Loftus Creek was initiated in response to the concerns of some local residents, that occasional overflows from the upstream sewer mains during periods of heavy rainfall may contain radioactivity of LHSTC origin. Tritium is the radionuclide most likely to be detectable under such circumstances.

Tritium was not detected in any of the samples collected during 2000, nor has any been found since sampling at Forbes Creek began in 1994 (see Table 3).

5.3 POTTER POINT BIOLOGICAL MONITORING

The biological monitoring program at Potter Point commenced in 1995 and was designed to maximise the chance of detecting radionuclides in the marine environment. Specimens of fish, algae (seaweed) and barnacles were collected since these organisms represent different levels in the food chain.

A similar coastal sampling site was selected for comparison purposes at The Royal National Park, approximately 6.5 km south of Potter Point. Unfortunately, scheduled sampling had to be abandoned on several occasions due to unfavourable weather conditions, therefore no specimens were collected from The Royal National Park in 2000.

The sampling locations at Potter Point and The Royal National Park are shown on Figure 4 and the results for fish flesh, green algae and barnacles are presented in Tables 4, 5 & 6. See Section 7 for details of the offshore monitoring program conducted at Potter Point.

The species collected from Potter Point are listed below:

Common name	Scientific name
Blackfish or Luderick	<i>Girella sp.</i>
Filamentous green algae (bait weed)	<i>Enteromorpha intestinalis</i> and <i>Cladophora sp</i>
Surf barnacles	Mainly <i>Tesseraopera rosea</i>

The approximate quantities of biological material collected in 2000 were:

Mass of Biota Collected from Potter Point in 2000 (kg fresh weight)		
Blackfish	Macroalgae	Barnacles
0.8	1.7	1.8

Blackfish were caught using a fishing line baited with *Ulva sp* (commonly known as lettuce or cabbage weed) while the filamentous green algae and barnacles were scraped off the rocks. Fish were filleted & scaled, while the algae and barnacles were left whole and unwashed. Samples were dried, ground and analysed for gamma-emitting radioisotopes.

Biological Monitoring Results

The radioactivity of these samples is expressed as becquerels per kilogram fresh weight. Gamma spectrometry of the biological samples collected in 2000 from Potter Point showed typical levels of naturally occurring radioisotopes, which are commonly found in marine specimens. These included beryllium-7, potassium-40 (ubiquitous in biological samples) and progeny of the uranium-238 and thorium-232 decay series, such as lead-210.

Three fish samples were collected at Potter Point during the year (see Table 4). The filleted flesh was analysed by gamma spectrometry, with 0.81 Bq/kg (fresh weight) of iodine-131 found in one sample and 0.46 Bq/kg caesium-137 in another. These are extremely small amounts. Anthropogenic caesium-137 has also been found at comparable levels in other types of fish caught in Australian regional waters (Aarkrog *et al.*, 1997).

Filamentous algae sampled from the shore near the Potter Point ocean outfall contained iodine-131 and small amounts of cobalt-60 as well as the expected natural radioactivity (Table 5). These isotopes have previously been detected in this species of algae sampled from Potter Point, at similar concentrations.

In 2000, two of the four barnacle samples from Potter Point showed traces of iodine-131 in addition to natural radioactivity (Table 6). As the samples were analysed unwashed, there could have been a contribution from any iodine-131 present in the water at the time of sampling.

Iodine-131 is a beta and gamma-emitting radionuclide with a relatively short half-life of about 8 days. It is an important medical isotope used in the treatment of thyroid cancer and is produced by ANSTO's Radiopharmaceuticals Division.

It should be noted that ANSTO is not the only source of iodine-131 entering the sewer system in the Sutherland Shire, since local hospitals or medical practices using nuclear medicines would also be a source.

The small concentrations of iodine-131, caesium-137 or cobalt-60 found in algae, fish or barnacles from Potter Point are of no health significance to humans. Cobalt-60 has not been detected in blackfish sampled from Potter Point since 1995, even though these fish are known to consume algae of the type analysed.

The potential radiation dose to members of the general public, as a result of ANSTO's discharges to the sewer, is extremely low, at least 1000 times less than the NH&MRC recommended dose limit for members of the public.

5.4 STORMWATER

Concrete stormwater retention dams (bunds) were constructed on the three main stormwater outlet points for the LHSTC site in 1994. The small capacity bunds are designed to retain stormwater/groundwater seepage temporarily before its release off site. They enable the on-site containment and treatment of any small accidental spills or releases of contaminated liquid that could otherwise enter the site stormwater system. They are also used as environmental monitoring points.

The locations of the stormwater bunds are shown on Figure 2. Briefly, they are:

- Bund A - Opposite Building 1;
- Bund B - Opposite the meteorological tower;
- Bund C - (MDP) below the Waste Management area.

The stormwater bunds are inspected and discharged daily.

5.4.1 Tritium in Stormwater Bunds

The detection of small but measurable quantities of tritium in stormwater and creeks draining the site is not unexpected at LHSTC, since tritiated water vapour released to air from HIFAR operation, will exchange with rain water and other free water surfaces. Further information on tritium is presented in Section 4.1.

Changes to Bund Sampling Regime

From February 1996 until December 1999 the stormwater bunds were sampled once per month. In January 2000 a more representative sampling strategy was tested for Bund A. Daily samples were taken (except weekends & public holidays) and combined to form a monthly composite. The volume sampled each month ranged from 17 to 23 litres. The composite samples were distilled and analysed for tritium.

In March 2000 this improved sampling protocol was extended to all three stormwater bunds. The tritium results appear in Table 7a.

Tritium Results

Tritium was detected in monthly composite water samples from stormwater bunds A, B & C at levels well below the WHO drinking water reference concentration of 7800 Bq/L (see Table 7a). The range of tritium values recorded in the 12 composite samples for 2000 were as follows:

Bund A: 80 - 2760 Bq/L; Bund B: 70 - 1240 Bq/L; Bund C: 60 - 120 Bq/L.

During February-April 2000, the scheduled shutdown of the HIFAR reactor for major maintenance operations occasionally resulted in above average emissions of tritium to air. Some of this activity was deposited in rain or exchanged with the surface waters and was expressed in the tritium results for bunds A and B. These bunds are situated on-site and stormwater passing through them clearly does not contribute to any public drinking water source.

In 2000, as in previous years, discrete water samples were collected from the MDP stormwater bund C each week. All of these samples were analysed for tritium and the results are shown in Table 7b. The tritium levels in the MDP bund C remained at site background levels with an average of 80 Bq/L.

The tritium levels recorded in the stormwater bunds in 2000 had no health consequences for humans or the environment.

5.4.2 Radioactivity in Water from MDP Bund C - Monthly Composite

The MDP bund is on the drain previously known as Stormwater Outlet No.1, which drains the Waste Management area into MDP creek.

The MDP bund weekly water samples were combined to make a monthly composite sample, which was analysed for gross alpha, gross beta and gamma radioactivity. The results are given in Table 7c.

The average gross alpha/beta activities of the monthly MDP bund C composite samples for 2000 (including less-than values) were: gross alpha < 0.03 Bq/L; gross beta 0.51 Bq/L. These values are well below the relevant limits for Class C waters (gross alpha, 1.1 Bq/L and gross beta, 11.1 Bq/L) under the Protection of the Environment Operations Act (1997).

Gamma spectrometry performed on the monthly composite samples showed low caesium-137 concentrations. The only other significant gamma-emitters detected were potassium-40 and beryllium-7 (both of natural origin) and occasional traces of cobalt-60 or americium-241. The latter two radionuclides were probably associated with suspended sediment in the unfiltered samples.

The average weekly concentration of caesium-137 in MDP bund water was less than 0.020 Bq/L, or 0.2% of the WHO reference value for caesium-137 in drinking water. Similar, low levels of caesium-137 have been detected in previous years.

5.4.3 Sediment from Stormwater Bunds

Sediment that has accumulated in the stormwater bunds is removed at least once each year. These sediments are analysed for gross alpha, gross beta and gamma radioactivity. Results for sediment collected from the three bunds in

2000 are given in Table 8. Gross alpha/beta activities found in 2000 corresponded to normal levels for similar sandy soils of the Sydney region. Gamma-emitters detected included potassium-40, progeny of the uranium-238 and thorium-232 decay series and small concentrations of fission and activation products. The low-level activities found do not have any health consequences for humans or the environment.

5.5 SURFACE WATERS

5.5.1 MDP Creek (MDP+60m)

Stormwater and groundwater from the southeast corner of the site drain into MDP creek (Figure 2). Historically, the water from this area has been sampled about 60 metres below the actual stormwater outlet itself, known as MDP+60m.

In 2000, as in previous years, part of the weekly MDP+60m sample was combined each month to make a composite sample for gross alpha, gross beta and gamma spectrometry analyses. Each weekly sample was also separately analysed for tritium.

Tritium in Water from MDP+60m - Weekly

Tritium results for the weekly MDP+60m water samples are shown in Table 9a and varied from < 20 to 150 Bq/L. The average tritium concentration of weekly samples for the year was below 80 Bq/L, which is only 1% of the WHO drinking water reference concentration.

Radioactivity in MDP+60m - Monthly Composite

Gross alpha and gross beta radioactivity results for monthly composite MDP+60m water samples were at background levels throughout the year, see Table 9b. The average activities were < 0.03 Bq/L for gross alpha and 0.32 Bq/L for gross beta. These are well below the relevant NSW regulations limits for Class C waters: 1.1 Bq/L for gross alpha and 11.1 Bq/L for gross beta activity.

The maximum observed concentration of caesium-137 in creek water from the MDP+60m sampling point represents < 0.3% of the WHO drinking water reference concentration. The trace of cobalt-60 reported for August was < 0.1 % of the WHO drinking water reference concentration (20 Bq/L).

5.5.2 SPCC Creek Sampling Points

Sampling locations on Strassman Creek, Bardens Creek and MDP Creek (shown in Figure 2) are known as the "SPCC" creek sampling points because they were originally selected in 1975 by the State Pollution Control Commission⁽⁴⁾. Stormwater from the LHSTC flows into these small local streams, which are classified as Class C waters under the NSW regulations associated with the Protection of the Environment Operations Act (1997).

The results of gross alpha and gross beta analyses conducted on the SPCC creek water samples are shown in Table 10. Note that the gross beta results include the contribution of natural potassium-40 activity. All results for 2000 were well below the limits for gross alpha and gross beta activity in the relevant NSW regulations. The gross alpha and beta results were also at or

⁴ Now the NSW Environment Protection Authority

below the more restrictive Australian Drinking Water Guidelines levels of 0.1 Bq/L for gross alpha and 0.5 Bq/L for gross beta activity.

5.5.3 Bardens Creek Weir

In addition to the monthly sampling (see above), weekly water samples were also collected from the flume weir on Bardens Creek during 2000. The results of tritium analyses performed on these samples are shown in Table 11. The highest concentrations recorded during the year, 1200 and 4680 Bq/L, were recorded in February and March during the HIFAR shutdown operations. Nonetheless, the average weekly concentration at this location was less than 230 Bq/L, or < 3% of the WHO reference concentration. It should be noted that water from Bardens Creek is not part of any known drinking water supply.

5.5.4 Surface and Stormwater Summary

The majority of tritium and gamma activity concentrations found in stormwater at LHSTC and associated watercourses are very low when compared to the WHO drinking water quality guidelines. Gross alpha/beta results are substantially below the limits specified in the relevant NSW regulations. Since the levels of detected activity are minimal, and stormwater does not enter any known human drinking water supply, it is concluded that there are no environmental or health consequences to humans from the measured radioactivity in stormwater from LHSTC.

5.6 GAMMA SURVEY OF EFFLUENT DISCHARGE PIPELINE

The pipeline through which liquid effluent from ANSTO is discharged to the Sydney Water sewer is shown on Figure 2. This pipeline runs above ground for part of its length and surveys of the dose-rates along the accessible sections of pipeline were carried out in 2000. The results are summarised in Table 12. These surveys are performed as part of the regular program of inspection and maintenance of the pipeline in order to detect any past or present leaks. Gamma dose-rates at pipe joints were recorded using an Eberline PRM-7 dose-rate meter. The measurement tolerance on such instruments is typically $\pm 20\%$. The measured dose-rates ranged from 0.05 to 0.13 $\mu\text{Sv}/\text{hour}$ and were principally due to natural background radiation. No leaks or breaches of the pipeline were reported.

5.7 LITTLE FOREST BURIAL GROUND (LFBG)

Results of sampling at the LFBG are given in Tables 13, 14a, 14b, 15, and 16. The locations of the sampling points and the burial trenches are shown on Figure 3.

Non-routine monitoring of soil and air (dust) from the LFBG burial trench area was carried out on 12 & 13 October 2000, in response to vandalism of the fence and LFBG compound. There was minor disturbance of the grass cover on a small area of the trench zone (to a depth of no more than 5 cm), however there was no damage to the monitoring bores. Results are discussed below.

5.7.1 Gamma Radiation Survey of LFBG

Annual surveys of the burial trenches are carried out using field dose rate monitors to check for surface contamination. The dose rate survey for 2000 was carried out immediately following the vandalism incident, see Table 13.

Dose rates over all the trenches ranged from 0.10 to 0.15 $\mu\text{Sv}/\text{hour}$ and were consistent with background readings taken at the LFBG entrance gate.

5.7.2 Soil from LFBG

The criterion for collection of soil samples from the LFBG is as follows: if the gamma radiation survey of the trenches indicates an area that shows more than three times the background reading, soil samples are collected. This criterion was not met in 2000 therefore no routine soil samples were collected. During the year several small depressions in the trench zone were filled with clay/shale of local origin.

On 12 October 2000, in response to vandalism of the LFBG, several samples of soil from the trench area and a reference site outside the LFBG (near bore MB22) were collected. The samples were analysed for gross alpha, gross beta and gamma radioactivity. The results, which indicate only background levels of natural radioactivity for all the samples, are given in Table 14a.

5.7.3 Groundwater Monitoring at LFBG

Groundwater from 15 monitoring bores located both inside and outside the fenced LFBG area were collected in May and November 2000 and analysed for tritium, gross alpha, gross beta and gamma radioactivity. Results are listed in

Table 14. Note that there are no liquid or airborne emissions from the LFBG therefore no discharge authorisation exists. Results are therefore compared to state, national or international guidelines for surface waters and/or drinking water.

Gamma-emitters in LFBG Groundwater

Only natural potassium-40 was detected in LFBG borewater apart from the traces of cobalt-60 found in MB16, located in the centre of the trench area. The maximum concentration of cobalt-60 was less than 2% of the WHO drinking water reference activity of 20 Bq/L.

Gross Alpha/Beta Activity in LFBG Groundwater

The range of gross alpha activity found in groundwater from LFBG was < 0.01 to 0.90 Bq/L. The gross beta values ranged from 0.03 to 1.30 Bq/L.

The results were all below the limits of 1.1 Bq/L (alpha) and 11.1 Bq/L (beta) set in the NSW regulations associated with the Protection of the Environment Operations Act (1997) for Class C surface waters. Apart from the MB16 results, most gross alpha and gross beta activity levels were also below the more restrictive NH&MRC Australian Drinking Water Guidelines levels (0.1 and 0.5 Bq/L respectively).

Tritium in LFBG Groundwater

Tritium concentrations in 2000 were within the range of previous measurements, with detectable tritium levels in 12 out of fifteen bores sampled. Bore MB16, being in the centre of the trenches, had the highest tritium concentration of 8160 Bq/L.

Tritium concentrations in the remaining bores were at background levels. Two of the three bores that are outside the fenced LFBG area contained low, but detectable levels of tritium: MB19 and MB21. Similar tritium levels were last detected in these bores in 1996 & 1997.

5.7.4 Streams North of LFBG

Samples of surface water and sediment were collected from Mill Creek and Bardens Creek, near their confluence (see Figure 1). These streams drain the area around the LFBG. The results of gross alpha, gross beta, tritium and gamma analyses on these samples are given in Table 15. No radioactivity above background levels was found.

5.7.5 Airborne Particulates at LFBG

The airborne particulate pathway requires special consideration at LFBG since the site was also used for the disposal of stable beryllium oxide. This beryllium is not radioactive but is chemically toxic if inhaled as a fine dust.

An Ecotech high-volume air sampler was operated at the Little Forest Burial Ground once every two weeks for 4 to 6 hours during normal working hours. Sampling was not performed during wet weather when airborne dust levels would be negligible.

Built to United States Environmental Protection Authority specifications, the sampler was commissioned in October 1997 to replace the previous solar-powered monitoring station. The Ecotech sampler is capable of collecting far greater quantities of air than the previous system. See Appendix D for further details.

The results for airborne particulate monitoring at LFBG in 2000 are given in Table 16. At the end of each three-month sampling period, the exposed filter was divided into four equal portions. Two of these were used for beryllium and plutonium analyses; the remaining two portions were stored. Beryllium and plutonium were not detected on the filter portions analysed in 2000.

An extra sample of airborne particles was collected on 16 October 2000 in response to the vandalism incident at the LFBG. The volume of air sampled was 255 m³ and the filter was analysed for plutonium and beryllium – none was detected.

5.7.6 Wind Speeds at LFBG

Wind conditions at the LFBG are assumed to be similar to those measured at the nearby LHSTC meteorological tower. In 2000, during periods of air sampling at the LFBG, the average wind speed at LHSTC was 3.2 metres per second and the data ranged from 1.0 to 6.0 metres per second. This information was obtained from 15-minute averages of wind speed data recorded at the 10 metre high ANSTO meteorological tower, during the actual periods that sampling was undertaken at the LFBG. For further information on the meteorological monitoring carried out at Lucas Heights see Section 5.9.

The wind speed threshold for increased resuspension of dust particles from the ground, in temperate Australian conditions is normally considered to be about 5 to 6 metres per second. However, this depends on local conditions including soil moisture, age of the particles and their bonding to the ground surface, vegetation cover and local turbulence. Nigel Holmes and Associates (1991) reported that 5.6 metres per second was the critical wind speed threshold for dust generation from an exposed surface, such as the nearby Lucas Heights Waste Management Centre.

The LFBG has an established vegetation cover consisting of grass and scattered shrubs, which minimises the potential for dust generation. Analysis of all wind speed data from Lucas Heights for the period April 1991 to June 1998 showed only 4% of cases where the wind speeds exceeded 5.6 metres per second (Clark, G.H. 1997; Clark, G.H. unpublished data, 1999).

5.7.7 LFBG Summary

The LFBG is a stable, grass-covered area, which rarely experiences winds capable of significant dust generation. The possibility that contaminated airborne particulates could be transported off-site is remote. Radiological exposures to members of the public from the LFBG continue to be assessed as negligible.

Non-routine environmental monitoring of soil, airborne dust and dose rates on the LFBG trench area was carried out in response to an occurrence of vandalism. The results indicate that there was no mobilisation of radioactivity as a result of this incident.

5.8 IODINE-131 IN AIR

Four (4) continuous air sampling stations are situated along the eastern fence boundary of the site (where suburban residences are closest) to monitor concentrations of ambient iodine-131 in air. The locations of these samplers are shown on Figure 2. Iodine-131 is a nuclide of interest since it could potentially be incorporated into the food chain, unlike noble gases that are inert.

At each station the air is sampled by means of a vacuum pump drawing air through a pair of Maypacks (activated charcoal filter cartridges), so that duplicate samples are available. Air is sampled at a rate of approximately 35 m³ per day. Filters are replaced and analysed weekly, with airflow-rates through the filters being checked at the same time. Calculations of iodine-131 activity give maximum levels of activity using a conservative set of assumptions. Analysis is via gamma spectrometry of the Maypacks (see Appendix D for further details).

No iodine-131 was detected in ambient air at the site boundary during 2000. All results were below the detectable level of 0.0025 Bq/m³ (see Table 17). The minimum detectable level would correspond to an annual dose of less than 0.01 mSv per year⁽⁵⁾ to a member of a hypothetical critical group, living at Stevens Hall Motel and receiving continuous exposure to iodine-131 at a concentration of 0.0025 Bq/m³. Since the fifty-two measurements in 2000 showed no detectable iodine-131, the average annual dose to the public from iodine-131 is clearly far less than 0.01 mSv.

5.9 METEOROLOGICAL MONITORING AT LHSTC

In common with many other nuclear facilities, ANSTO undertakes an extensive program of meteorological measurements. The prime reason for such a program is to allow estimates to be made of the downwind concentration of any airborne pollutants, particularly radionuclides, released from the LHSTC site through routine operations or under accident conditions. The data collected

⁵ Based on the Committed Effective Dose per Unit Activity given in the International Basic Safety Standards (1996), Safety Series No 115.

from this program provide the necessary input to the atmospheric dispersion model called PC-Cream⁽⁶⁾, which is used to compute the effective dose to an individual due to the routine airborne or accidental release of radionuclides from the LHSTC.

The meteorological data are collected and analysed continuously. The long-term climatology data for Lucas Heights are updated and published every five years. The most recent report available is *An Updated Analysis of the Lucas Heights Climatology – 1975 to 1996*. Clark, G.H., 1997. The on-site meteorological tower and associated laboratory are shown on Figure 2.

Two off-site meteorological stations are also used to measure the influence of local complex terrain on wind flow, dispersion patterns and temperatures. These stations (shown on Figure 1) are located at the Boys Town School (Engadine) and at the "Shackels Estate" in the Woronora River valley.

Wind Speed and Direction

Annual average wind speeds recorded at Lucas Heights from 1991 to 1996 were approximately 2.5 metres per second (Clark, 1997).

The winds that predominate at Lucas Heights during summer and winter are shown in the table below.

Prevailing Winds at Lucas Heights		
<i>Season</i>	<i>Time of Day</i>	<i>Wind Direction</i>
SUMMER	Daytime sea-breeze	From NE - ENE sectors
	Night / early morning	From SSE – SSW sector
WINTER	Daytime	From W - NW and S - SE sectors
	Night / early morning	From S – WSW sectors

Winds during autumn and spring represent a transition between the summer and winter seasons, with sea breezes observed later in the afternoon.

The influence of local topography on wind speeds and directions is very marked in the Lucas Heights area. Low wind speeds at the Woronora River valley floor are associated with the drainage of cool air into the valley at night (Clark, 1997). Winds on the plateau and ridges are stronger and steadier.

Rainfall and Evaporation

The total rainfall for the year 2000 at Lucas Heights was 698 mm, recorded on 128 rainy days. The year started with two dry months before the wettest month of March with 217.6 mm. Then there was a dry period of six months when the maximum total only reached 55 mm. In comparison with the long-term records kept since 1958 where the annual rainfall ranged from a minimum of 556 mm to a maximum of 1658 mm, the year 2000 was the sixth lowest on record. Using a standard Class A evaporation pan, the total evaporation for the year was 1169mm.

⁶ Refer to ANSTO Safety and Reliability Report SD/SR/TN98-7 revision 1, August 1998.

Temperatures

In 2000, the coldest month at Lucas Heights was June, with an average minimum temperature of 6.8 °C. The warmest month was February, when the average maximum temperature was 28.1 °C.

The temperature extremes recorded in 2000 were:

Minimum: 3.4 °C in June;

Maximum: 42.2 °C in January.

There are only small differences in temperatures between the stations on the ridges and plateau above the Woronora River valley. However the valley generally has higher daytime temperatures due to trapping of warm air and lower night-time temperatures due to cool air drainage.

5.10 EXTERNAL GAMMA RADIATION

ANSTO and ARPANSA thermoluminescent dosimeters (TLD) were used to measure the external gamma radiation in and around the LHSTC during 2000.

The dosimeters issued by ARPANSA are the same as those used for personal monitoring and consist of calcium sulphate thermoluminescent material with three filtered areas and an open window.

The environmental dosimeters used by ANSTO contain lithium fluoride and calcium fluoride thermoluminescent materials with energy compensation filters. They were analysed at ANSTO using a Harshaw 6600 TLD reader (manufactured by BICRON).

Figure 2 shows the locations of dosimeters 1 to 15.

Thermoluminescent Dosimeter Results

Table 18a shows the integrated annual absorbed dose to air, in millisieverts, as monitored by the ARPANSA dosimeters for the calendar year 2000, and compares these figures with results obtained since 1996. Measurements were made over quarterly monitoring periods, the dosimeters were returned to ARPANSA for measurement, and the readings were reported to ANSTO as annual absorbed dose to air in terms of milligrays (mGy). The absorbed dose was then converted to effective dose (millisieverts) using the conservative conversion factor of one.⁽⁷⁾

The 2000 annual doses measured at or within the LHSTC perimeter fence, apart from location 2, ranged from 0.6 mSv to 1.3 mSv. The external gamma dose at location 2 (on the inner perimeter fence) has been slightly elevated since 1997, when stored radioactive materials were relocated to the area. In 1998, Safety Division conducted a comprehensive dose rate survey both inside and outside the perimeter fence. The results of this survey, together with a consideration of occupancy factors, indicated no need for further shielding of the storage building. This location is about 1.8 km away from any residential areas and there is no public occupancy of the area.

Table 18a also shows the annual absorbed dose to air measured outside three homes in the vicinity of the LHSTC (locations 16, 17 & 18). This dose, due to

⁷ UNSCEAR (1993) use conversion factors of 0.72 Sv per Gy for adults, 0.80 for children and 0.93 for infants.

environmental radiation, averaged 0.8 mSv at the three locations in 2000. The annual doses measured at these local residences have remained constant (within measurement tolerances) since the introduction of TLD monitoring in 1994.

When converted to an hourly rate, the local environmental dose figures (Table 18a) correspond with the average hourly absorbed dose rate to air from terrestrial gamma radiation, recorded in Australian capital cities in surveys carried out by the Australian Radiation Laboratory (now ARPANSA) and reported by UNSCEAR (1993). This means that the external gamma dose rates at residences near the LHSTC are at normal background levels.

In July 1999 an additional dosimeter was placed at the Cronulla Sewage Treatment Plant. The annual effective dose values for the Cronulla Sewage Treatment Plant were at background levels in 1999 and 2000.

Data obtained from the ARPANSA and ANSTO dosimeters, placed at the same locations, are compared in Table 18b. As in previous years, the results from the two types of TLD show no significant difference.

6 EFFLUENT MONITORING AT LHSTC

The Stack Sampling and Ventilation group within ANSTO's Safety Division performed the routine monitoring of the airborne emissions from LHSTC stacks. The Waste Operations group within Nuclear Technology Division was responsible for the routine treatment, sampling and authorised discharge of liquid effluent arising from operations at LHSTC.

In 2000, results of ANSTO's effluent monitoring programs at the LHSTC were checked by the (non-regulatory) Environmental and Radiation Health Branch of ARPANSA, based in Melbourne.

Descriptions of the effluent sampling and analysis procedures are given in the following sections. For more information on stack sampling procedures, see Appendix E.

6.1 AIRBORNE EFFLUENT STACK DISCHARGES

The authorised airborne emissions from LHSTC stacks were sampled continuously, with weekly analysis and data collection. The effluent airstream samples were analysed for gamma emitters, noble (inert) gases, tritiated water vapour and gross alpha/beta activity and the results were reported to ARPANSA on a monthly basis. The locations of the discharge stacks at the LHSTC are shown on Figure 2. Appendix B summarises the types of stack discharges that occur at LHSTC and comments on their causes.

Stack Sampling & Analysis

During 2000, 12 discharge stacks were monitored on a weekly basis. The effluent airstreams were sampled using filter cartridges called Maypacks, connected to vacuum pumps. The Maypacks consist of a charcoal section, to trap gases and vapours, and a particulate filter. Critical orifices are used to standardise the flow of air through Maypack sampling assemblies.

The Maypack cartridges are initially analysed by gamma spectrometry and the particulate filters for gross alpha/beta activity. The cartridges and the filters are

then stored for 4 weeks. Some of the particulate filters are measured again for gross alpha and gross beta activity to confirm whether any particulate activity previously measured was principally due to short-lived radioisotopes.

Tritiated water in the airborne discharges is sampled using a tritium trap. A proportion of the stack airstream is drawn through a series of four Dreschel bottles filled with demineralised water, trapping the tritiated water. A liquid scintillation counter is then used to measure the tritium activity in the sample. Noble gases in airborne effluent are measured in situ by a gamma spectrometer as the effluent passes through a 250 mL sampling flask.

Airborne Emission Data

Tables 19a, 19b, 19c and 19d present the 2000 airborne emission data for the individual stack release points at LHSTC, showing total releases over quarterly (3-monthly) periods.

The airborne emissions from ANSTO in 2000 were influenced by two notable changes to routine operations. These were the scheduled extended shutdown of the HIFAR reactor and emission minimisation work performed for noble gases generated during radiopharmaceutical production. During the HIFAR shutdown period January-March, most emissions from HIFAR and radiopharmaceutical production in Building 54, were reduced to negligible levels. The exception was tritium emissions, which increased due to the maintenance work undertaken at HIFAR.

Table 19a shows that during the January-March quarter tritium discharges from the building 15A (HIFAR) active ventilation system were occasionally above routine levels. This was due to the maintenance operations being carried out during the extended shutdown of the HIFAR reactor.

Depending on localised weather and wind conditions, airborne tritium discharges can be washed-out into stormwater. This was reflected in the tritium results for stormwater in Bund A (Table 7a) and the downstream Bardens Creek Weir sampling point (Table 11), during the quarter. The tritium concentrations recorded in the stormwater were well below levels considered acceptable for drinking water.

In the second half of 2000, detailed investigations were undertaken into noble gas emissions during radiopharmaceutical production. This involved monitoring the gaseous emissions every fifteen minutes and correlating the results with the operating practices being performed at the time. On the basis of this information, modifications to the production process were undertaken.

This work significantly reduced the emissions during radiopharmaceutical production in the period July to December 2000, when noble gas releases were reduced by almost a factor of ten. For the most important radionuclides with respect to public exposure (Xe-135 and Xe-135m), reductions by over a factor of ten were realised. This process modification will ensure noble gas emissions from radiopharmaceutical production remain low, even if production rates increase in the future.

The possible doses to members of the public due to airborne releases from the LHSTC were estimated from the airborne discharge data for the 2000 calendar year using a dispersion model. See Section 3.2.2 for a description of the PC

Cream model, and Section 9 for discussion of the potential public doses from operations at the LHSTC.

It should be noted that the on-site and public doses due to the discharges are very low. At the 1.6km exclusion zone boundary the estimated doses were less than 0.01 mSv/year, well below the 0.3 mSv site dose constraint and much smaller than the public dose limit of 1 mSv/year, or the natural background of 1.5 mSv/year.

Independent Check of Stack Monitoring Program

Throughout the year, upon request, ANSTO provided sets of weekly stack samples to the (non-regulatory) Environmental and Radiation Health Branch of the ARPANSA for the purpose of checking ANSTO's results. These independent checks confirmed that ANSTO's stack monitoring system was operating correctly in 2000.

6.2 LOW-LEVEL LIQUID EFFLUENT DISCHARGES

The Waste Operations group at ANSTO is responsible for the handling, treatment, monitoring and authorised discharge of liquid effluent arising from operations at the LHSTC. The Waste Operations facilities are located on the south-east corner of the site, see Figure 2.

Treatment and Discharge

Liquid effluents fall into the following categories:

- ♦ liquids from radioactive laboratories, which have a low level of radioactivity;
- ♦ trade effluent from laboratories and workshops in which radioactive and toxic materials are not handled;
- ♦ leachate from the nearby Waste Services NSW land-fill operations; and
- ♦ sewage.

The low-activity liquid effluent goes through an alum-based chemical treatment process for removal of radionuclides. The trade waste is tested and chemically treated if necessary. Waste Services effluent is tested for ammonia levels before being accepted as trade waste. Sewage is partially treated via the on-site plant. Groundwater seeping into the sump in the vicinity of building 27 (the intermediate waste and spent fuel storage facility) is routinely pumped into the holding tanks. The levels of gamma emitting isotopes and tritium in the groundwater seepage are also monitored monthly.

The liquid trade waste, treated low activity effluent and sewage are combined in the effluent plant holding tanks. The levels of radioactivity in each holding tank are checked for compliance with the Trade Wastewater Agreement prior to discharge to the Sydney Water sewer. Proportional samples from the discharge pipeline are also collected during each release of treated effluent to the sewer and are analysed for gross alpha and gross beta radioactivity, pH, ammonia and zinc. A volume-weighted monthly composite sample is produced from all discharge samples for the month. This monthly composite sample is analysed for gross alpha/beta, tritium and gamma activity and assessed for compliance with the Sydney Water Trade Wastewater Agreement (as are the individual pipeline samples that make up the monthly composite).

Groundwater in the Vicinity of Building 27

Groundwater seepage from the area below Building 27 was analysed monthly in 2000 (Table 20). Building 27 houses the in-ground storage of the HIFAR spent fuel elements. No significant gamma activity was detected other than naturally occurring potassium-40. Tritium levels remained stable with an average of 370 Bq/L, that is less than 5 % of the WHO drinking water guideline of 7800 Bq/L.

Liquid Effluent Results

Radioactivity levels in liquid effluent discharges to the Sydney Water sewer are summarised in Table 21. The monthly average gross alpha, gross beta and tritium concentrations were calculated using the results for proportional samples collected during each discharge. The average volume of liquid effluent discharged during the calendar year 2000 was 6733 cubic metres per month.

Table 21 also shows the concentration quotients calculated using equation 3 in Section 3.1. The concentrations of alpha emitters were below the detection limits and, for this reason, alpha quotients are reported as less-than values.

There was an increase in the amount of tritium discharged to the sewer for the months of May to September 2000. This increase is related to the shutdown of the HIFAR reactor for maintenance during the three months of February to April 2000. The waste water generated from the shutdown activities, containing elevated levels of tritium, was diverted to storage in the effluent treatment plant. ANSTO's regulatory agreements were not breached at any time and tritium discharges for the remainder of the year returned to previous levels of routine operation.

Liquid Effluent Compliance

In 2000, the average monthly quotient term (based on the WHO Activity Concentration Equivalents at the ANSTO discharge point) for gross alpha, gross beta and tritium radioactivity in liquid effluent was < 0.29 . This represents less than 30% of the limit. Individual monthly quotients ranged from < 0.09 to < 0.61 . All quotients for 2000 were below the limit ($ie \leq 1$), demonstrating compliance with the Sydney Water Trade Wastewater Agreement.

Analyses of the monthly composite effluent samples for the year 2000 for radium-228 and lead-210 showed that concentrations of these beta-emitting radionuclides were below detectable levels. ANSTO is therefore continuing to report gross alpha and gross beta activities in terms of radium-226 and strontium-90.

Non-Radioactive Components of Liquid Effluent

All discharges for the year were analysed for the following non-radioactive components: suspended solids; pH; ammonia; biological oxygen demand and grease. Chromium was deleted from the Sydney Water analysis schedule in May 2000 (variation to Trade Waste Service Agreement No.4423) and replaced by zinc. This change was made because chromium is no longer used in the corrosion inhibitor added to the secondary cooling water circuit.

The data are listed in Table 22 as yearly averages recorded for 1997 through to 2000. The standards for acceptance of the trade waste are also listed against

each component. All discharges in 2000 complied with the relevant standards for acceptance of trade wastes to the sewer, as required by Sydney Water.

7 POTTER POINT OFFSHORE MONITORING

Advanced primary treated effluent from the Cronulla Sewage Treatment Plant is discharged from a submerged cliff face outfall at Potter Point, located at the northern end of Bate Bay on the Southern Sydney coastline of NSW (Figure 4).

Some public interest groups have in the past expressed concern that treated liquid effluent discharged to the sewer from LHSTC may be a radiation hazard to swimmers and surfers in the vicinity of the Potter Point ocean outfall.

In order to address these concerns ANSTO has carried out biannual investigations at Potter Point since 1995, with the following objectives:

- ♦ to measure the transit times and dilution factors between Lucas Heights and the Cronulla Sewage Treatment Plant (CSTP);
- ♦ to study the dispersion of tritium in the vicinity of the outfall; and
- ♦ to continue the biological monitoring program at Potter Point outfall.

Two routine effluent releases from LHSTC were monitored during 2000. See Section 5.3 for the Potter Point biological monitoring results.

Modelling of the Effluent Plume

In 1997 ANSTO commissioned Unisearch Water Research Laboratory (WRL) to model the plume dispersion using the conditions prevailing during an effluent release in May 1997. See ANSTO/ E-732, Section 7.3 for a full report on the WRL modelling of the Potter Point plume.

It is now possible to calculate the concentrations of tritium at any location at sea and at any time since the implementation of the WRL model, given:

- ♦ the concentration and times of effluent release at ANSTO;
- ♦ the average transit times and dilution factors between ANSTO and Potter Point; and
- ♦ offshore dilution factors calculated from the model.

Two releases of ANSTO treated liquid effluent to the sewer were monitored in 2000, the first was in June and the second in December. The effluent was sampled at three stages: prior to its release from LHSTC; at the exit to the CSTP; and in the sea offshore of the Potter Point (near the ocean outfall). Details of these two surveys follow.

7.1 JUNE 2000 - EFFLUENT STUDY

Tritium levels in the offshore effluent plume at Potter Point were investigated on 28 June 2000. The contents of a holding tank at Lucas Heights were released overnight between 22:30 hours on 27 June 2000 and 01:00 hours on the following morning. A total volume of 200 kilolitres was released over 2.5 hours with an average release rate of 22.2 litres per second.

Effluent Transit Time to Cronulla STP Outlet

An automatic sampler was used to collect hourly samples of effluent near the outflow of the CSTP. The concentration of tritium in the effluent varies as it passes through the treatment plant and the highest concentration in samples taken at the Cronulla STP was 71.9 Bq/L. The interval between the mid-point of the effluent release from Lucas Heights and the peak tritium concentration observed at the CSTP (at 11:00 hours on 28 June 2000) was approximately 10 hours. This is consistent with effluent transit times obtained in previous studies, ranging from 9.6 to 12 hours.

Dilution Factors

The effluent was released from ANSTO over a 2.5 hour period commencing 22:30 hours on 27 June 2000 at a rate of 22.2 litres per second. The hourly flow rate through the CSTP at the time of the peak tritium concentration was 100.7 ML/day, or 1165 L/second (information supplied by Sydney Water). This corresponds to a dilution factor of $1165/22.2$, or 52. This is consistent with previously observed values, which were 27, 22, 29, 32, 50 and 30 for similar overnight releases outside normal business hours.

Routine releases of effluent from ANSTO are made during business hours on weekdays (Mondays to Fridays). At these times, the flow rate of effluent through the Cronulla STP is generally greater than at night, when industrial premises are closed. This means that dilution factors should be even higher during the more routine daytime releases.

Offshore Sampling

On exiting the CSTP, the treated sewage travels via a pipeline to the Potter Point outfall where it enters the ocean (this takes approximately one hour). The ANSTO Environment Division research vessel *Imara* conducted an hourly sampling program from 09:00 to 15:00 hours on 28 June 2000. Two-litre samples of water were taken from the visible effluent plume, at depths of 0.5, 1.0 and 2 metres.

The samples were taken from three points that were marked by buoys, placed in position before sampling commenced, and accurately fixed using the differential global positioning system available on board the vessel. The first sampling point was located 50 metres from the ocean outfall and the third was 200 metres away, within the sewage plume.

Tritium Results

The seawater samples were analysed for tritium concentration by liquid scintillation counting. The limit of detection was 15 Bq/L. No tritium was detected in any of the samples taken from stations #1, #2 or #3.

On this occasion, the *offshore dilution ratio* (from the outlet of the sewage treatment plant to the sampling station nearest the outfall) could not be calculated because no tritium was detected in the offshore sewage plume.

7.2 DECEMBER 2000 – EFFLUENT STUDY

ANSTO's Environment Division investigated tritium levels in the offshore effluent plume at Potter Point on 4 December 2000. Between 22:00 hours on 4 December 2000 and 01:00 hours on the following day, 210 kilolitres of treated liquid effluent was released from Lucas Heights to the Sydney Water sewer. The tritium concentration of the effluent in the holding tank was 1290 Bq/L.

Due to construction works at CSTP for the new tertiary treatment plant, the automatic sampler could not be used to collect effluent samples at the outflow of the CSTP. It was therefore not possible to calculate the *in-line dilution ratio*, nor the effluent *transit time* from Lucas Heights to the Cronulla STP on this occasion.

Sampling of the effluent plume offshore of the Potter Point outfall was undertaken from the *Imara* vessel, at hourly intervals from 09:00 until 15:00 hours. Sampling station #1 was located around 100 metres from the outfall whilst station #3 was about 250 metres away.

No tritium was detected in any of the 63 samples taken from the three sampling points at depths of 0.5, 1 and 2 metres (all were less than the 15 Bq/L limit of detection for tritium).

8 THE NATIONAL MEDICAL CYCLOTRON

The National Medical Cyclotron (NMC) is a national facility that provides isotopes for research, clinical evaluations and routine nuclear medicine procedures. It is owned and operated by ANSTO and is located adjacent to the Royal Prince Alfred Hospital in Camperdown, Sydney (see Figure 1 inset).

The NMC is primarily used to produce radiopharmaceuticals for use in two diagnostic imaging systems - positron emission tomography (PET) and single photon emission computed tomography (SPECT). The radionuclides produced by the NMC are typically of a very short half-life (particularly for PET), ranging from minutes to a number of days. Because of the very short half-life of some of the radiopharmaceuticals, they need to be administered to the patient very soon after they are produced. The NMC was therefore located physically close to major Sydney hospitals to minimise the delay between production and patient use.

SPECT radiopharmaceuticals produced at the NMC include:

- ♦ Gallium-67, which is used to diagnose soft tissue tumours and some inflammatory lesions. It has a half-life of 78 hours;
- ♦ Thallium-201, which is used to assess heart conditions. It has a half-life of 74 hours; and
- ♦ Iodine-123, which is used to diagnose certain thyroid diseases. It has a half-life of 13 hours.

PET radiopharmaceuticals produced at the NMC include:

- ♦ Fluorine-18 Fluorodeoxyglucose, which is used to diagnose brain disease and to assess the spread of cancers. It has a half-life of 110 minutes;
- ♦ Nitrogen-13 Ammonia, which is used for the early detection of coronary disease. It has a half-life of 10 minutes; and
- ♦ Oxygen-18, which is used to study oxygen metabolism. It has a half-life of 2 minutes.

8.1 NMC ENVIRONMENTAL PATHWAYS & DISCHARGE LIMITS

As a result of the manufacture, purification and preparation of radiopharmaceuticals, small quantities of radionuclides are released from the NMC.

The pathways by which radionuclides from the NMC may enter the environment are:

- ♦ atmospheric discharges of short-lived isotopes from stacks (such as iodine-123);
- ♦ discharge of low-level liquid effluent to the Sydney Water sewer system (typically containing thallium-201, thallium-202, gallium-67, cobalt-57, zinc-65 and iodine-123).

The airborne emissions are governed by limits set by the NSW EPA while the liquid waste discharges to the Sydney Water sewer are covered by a separate Trade Waste Agreement, No.13966 (1994).

These emissions are routinely monitored and the results for 2000 are discussed below.

8.2 NMC EFFLUENT MONITORING RESULTS

The NMC emissions are monitored daily and the monitoring results for 2000 are detailed in Tables 23a (airborne) and 23b (liquid). The tables also list the authorised airborne and liquid effluent discharge limits as prescribed by the NSW EPA and in the Trade Waste Agreement with Sydney Water, respectively.

Monthly average discharges of iodine-123 to air from the NMC ranged from <1% to 10% of the NSW EPA limit (Table 23a). Over the year 2000, the monthly average concentration of iodine-123 in airborne discharges was less than 4% of the EPA limit.

For liquid effluent discharges from the NMC, the average concentrations of radionuclides discharged to sewer each month were all less than 1% of the NSW EPA limits for thallium-201, thallium-202, gallium-67, zinc-65 and iodine-123.

The average concentration of cobalt-57 in January was 6.5% of the EPA limit, this dropped to < 2% in February and the remaining discharges for the year were all below 1% of the limit.

All the individual airborne and liquid effluent emissions from the NMC during 2000 were well within the prescribed concentration limits.

9 POTENTIAL RADIATION EXPOSURE TO MEMBERS OF THE PUBLIC FROM OPERATIONS AT ANSTO SITES

The principal sources of potential radiation exposure to members of the public from routine ANSTO operations at the LHSTC and NMC are from airborne emissions and low level liquid effluent discharges to the sewer. As indicated in

Section 3, ANSTO complied with all relevant Commonwealth and New South Wales regulations and international guidelines during 2000. It is concluded that there is no impact on the health of the community, staff or the environment as a consequence of operations at the Lucas Heights Science and Technology Centre or the National Medical Cyclotron.

9.1 LHSTC AIRBORNE EMISSIONS

The discharge authorisation for airborne emissions at the LHSTC is based on limiting the doses to hypothetical critical group members to levels well below the public dose limits, and below the 0.3 mSv site dose constraint. As indicated in Section 3.2, the PC-Cream atmospheric transport, dispersion and dosimetry model is used to evaluate potential doses to members of the public at various receptor locations, based on measured stack discharges and local meteorological data. Table 24 shows the estimated effective doses due to airborne discharges from LHSTC in 2000 at specified locations and distances from the reactor.

The results show that the potential effective doses to critical group members of the public within the 1.6 kilometre radius LHSTC buffer zone, were calculated to be less than 0.01 mSv per year in 2000. This is less than 1% of the NH&MRC recommended annual dose limit of 1 mSv and less than 3.3 % of the site dose constraint of 0.3 mSv. For members of the general public residing at the boundary of the 1.6 kilometre buffer zone and beyond, the most exposed individual was also estimated to receive less than 0.01 mSv/year.

The maximum value calculated for potential dose to members of the public in 2000 (Table 24) was significantly lower than in previous years (less than half). This was due to two factors: the major shutdown of HIFAR and the reduction of noble gas releases during radiopharmaceutical production. The reduction in noble gases in the first quarter was due to the HIFAR major shutdown, which only occurs once every five years. However, the reduction in noble gas emissions from radiopharmaceutical production will continue into future years further reducing the already very low ANSTO contribution to public dose.

Iodine-131 emissions from the LHSTC were also monitored at the perimeter fence. No iodine-131 was detected in ambient air in 2000.

Assuming continuous exposure to iodine-131 at the minimum detectable concentration of 0.0025 Bq/m³, the potential effective dose to members of the critical group would be about 0.01 mSv per year. Since all of the fifty-two weekly iodine-131 measurements were below the detectable limit, the average potential dose to the public is clearly less than 0.01 mSv per year. This figure is consistent with the results obtained from the PC-Cream model and represents 1% of the NH&MRC recommended annual dose limit of 1 mSv and about 3% of the site dose constraint.

Table 25, taken from UNSCEAR (1993), shows the average annual effective doses to adults from the various natural sources of radiation, which result in an estimated total annual dose of 2.4 mSv. This figure will vary with local geological conditions and with height above sea level and is estimated at around 1.5 mSv per year in Australia (Webb *et al.*, 1999).

The estimated potential dose to members of the general public from airborne discharges at LHSTC are only a very small fraction, less than 0.5%, of the

radiation dose received by everyone each year from naturally occurring sources of radiation.

9.2 LOW-LEVEL LIQUID EFFLUENT FROM LHSTC

Liquid effluent is chemically treated and analysed before controlled discharge to the Sydney Water sewer. Prior to 1980, such discharges were routinely made to the Woronora River. Dose estimates based on actual radioactive concentrations measured in environmental samples from 1969 to 1979 were given in the relevant environmental survey reports (Appendix A). These dose estimates confirmed the negligible impact on public health of low-level liquid effluent discharges to the Woronora Estuary.

The studies conducted by ANSTO at the Cronulla Sewage Treatment Plant and the Potter Point ocean outfall area, from 1995 through to 2000, determined the dilution effects on radionuclides contained in the treated effluent discharged by ANSTO to the sewer. The predictions of the Unisearch WRL plume transport and dilution model have been confirmed using these measurements. If required, the model may be used to calculate tritium concentrations in the sea near Potter Point at any time since 1995.

The levels of radioactivity found in fish, algae and barnacles collected near the Potter Point outfall, as well as tritium measured in the ocean a short distance from the outfall, are negligible. They do not pose any health risk to members of the public using the ocean in the vicinity of the outfall or ingesting seafood from the area. The potential dose is at least a factor of 1000 below the NH&MRC recommended dose limits for members of the public.

9.3 EXTERNAL RADIATION AT LHSTC

The levels of external gamma radiation at LHSTC were measured by thermoluminescent dosimeters located at private residences in Barden Ridge, Engadine and Woronora (see Tables 18a & 18b). The local absorbed doses in air were consistent with levels recorded in Australian capital cities (using similar dosimeters) in Australian surveys carried out by the Australian Radiation Laboratory and reported by UNSCEAR (1993).

These results indicate that the external gamma radiation levels at residential locations in the vicinity of LHSTC are not noticeably affected by the operations at LHSTC.

The external gamma radiation dose measured at location 2 on the southern sector of the perimeter fence was affected by the nearby storage of radioactive materials. This location is not readily accessible to the general public and, due to the lack of occupancy, any incremental dose resulting from proximity to the fence will be negligible. All other external dose rates recorded on site were at normal background levels.

9.4 THE LITTLE FOREST BURIAL GROUND

The 2000 environmental survey results for the LFBG show similar trends to past years.

Tritium was detected in ground water near the burial trenches and at low levels in several other monitoring bores within the fenced area. All 15 bores sampled were below the WHO drinking water guideline level for tritium.

Gamma spectrometry of the LFBG groundwater showed only small concentrations of natural potassium-40, and low levels of cobalt-60 in bore MB16, which lies in the centre of the trenches.

With the exception of gross alpha activity in bore MB16, the gross alpha and gross beta activities measured in LFBG groundwater were at or below levels considered safe for Australian drinking water (NH&MRC, 1996).

The three groundwater bores outside of the LFBG fenced area showed low levels of tritium and background levels of naturally occurring radioactivity. Surface water sampled from Mill and Bardens Creeks also contained background levels of radioactivity.

These results confirm that potential radiation exposure to members of the public from groundwater and surface water in the vicinity of LFBG is negligible. It should be noted that contaminants from other non-radioactive wastes (disposed of by other agencies) in the areas adjacent to LFBG, makes the groundwater unsuitable for human consumption.

Sampling of airborne particulates at LFBG was carried out using a high-volume air sampler built to US-EPA specifications. No beryllium or plutonium was detected on air filters in 2000. Based on these and previous surveys, it is concluded that possible radiation exposure to members of the general public via the inhalation pathway is negligible.

Extra soil, air and dose monitoring was carried out in response to minor vandalism at the LFBG and the results clearly show that there was no resultant mobilisation of radioactivity.

External radiation readings over the trenches were consistent with normal background levels. Radiation readings around the LFBG site boundary fence were also at background levels, confirming that possible doses to members of the public from external radiation can also be regarded as negligible.

9.5 THE NATIONAL MEDICAL CYCLOTRON

All airborne and liquid effluent emissions from the National Medical Cyclotron during 2000 were well within the approved limits. Due to the short-lived nature of the radioisotopes concerned, the impact on humans and the environment from NMC emissions is negligible.

10 ACKNOWLEDGEMENTS

For critical review of this document the authors thank Dr Peter Airey, Mr Lubi Dimitrovski, Dr John Ferris, Dr John Harries, Mr Frank Harris, Dr Peter Holden and Mr Steven McIntosh.

Thanks to Ms Jennifer Harrison for her assistance in analysis of environmental samples.

Thanks to Mr Geoff Clark for providing meteorological data for the LHSTC site.

Thanks also to Mr Graham Spelman of Environment Division for his contribution in relation to the Potter Point offshore sampling program.

The Environmental Chemistry group (Environment Division) used ICPAES techniques to determine beryllium levels on the LFBG air filters.

Dosimeter readings for external gamma radiation at LHSTC (Tables 18a & 18b), airborne effluent release data (Tables 19a to 19d, 24) and public dose estimates were supplied by Safety Division.

Details of the environmental monitoring at the National Medical Cyclotron (Tables 23a & 23b) were also supplied by Safety Division.

Liquid effluent release data (Tables 21 & 22) and details of waste treatment were supplied by Waste Operations, Nuclear Technology Division.

11 REFERENCES & BIBLIOGRAPHY

Aarkrog, A., *et al.*, *A Comparison of Doses from ^{137}Cs and ^{210}Po in Marine Food: A Major International Study*. Journal of Environmental Radioactivity, Vol. 34, No.1, pp. 69-90, 1997. Elsevier Science Ltd, Printed in Ireland.

Australian Nuclear Science and Technology Organisation (ANSTO), September 1989. *Radioactive Airborne Effluent Working Party on a Revised Radioactive Effluent Discharge Limit for the Lucas Heights Research Laboratories*. M.C.E. Petersen, G.H. Clark, G.M. Bailey, F.M. May. ANSTO/DR25.

Australian Nuclear Science and Technology Organisation and Sydney Water Corporation Pty Ltd. *Consent to Discharge Trade Wastewater, Category:3 Agreement No. 4423, (1998)*.

Australian Nuclear Science and Technology Organisation. *ANSTO Health and Safety and Environment Policy*. ANSTO Policy Manual, APOL 2.2, Revision 2, 2000.

Australian Nuclear Science and Technology Organisation. *ANSTO Quality Policy*. ANSTO Policy Manual, APOL 1.1, Revision 2, 1998.

ANSTO Safety and Reliability Report. *Estimates of Doses from Routine Emissions of Radionuclides to Atmosphere from HIFAR during the Financial Years 1996/97 and 1997/98*. SD/SR/TN 98-7 Revision 1, August 1998.

Australian Radiation Laboratory (ARL), April 1990. *A Nation-Wide Survey of Radon and Gamma Radiation Levels in Australian Homes*. M.K. Langroo, K.N. Wise, J.C. Duggleby, L.H. Kotler. ARL/TR090, ISSN 0157-1400.

Clark, G.H. (June 1997) *An Updated Analysis of the Lucas Heights Climatology 1975 to 1996*, ANSTO/E-731, Environment Division, Australian Nuclear Science & Technology Organisation.

Clark, G.H., Environment Division, Australian Nuclear Science & Technology Organisation (ANSTO), personal communication, July 1999.

Clean Waters Act 1972, Regulations as amended, Government Gazette, NSW Government Printery, Australia.

Cole-Clark, B. E. *Estimates of Erosion on Potato Land on Krasnozems at Dorrigo NSW Using the Caesium-137 Technique*. Australian Journal of Soil Research, Vol. 31, pp 209-23, 1993.

Commonwealth of Australia (1998), *Australian Radiation Protection and Nuclear Safety Act 1998*, Commonwealth Government Printer, Canberra.

Commonwealth of Australia (1999), *Australian Radiation Protection and Nuclear Safety Regulations 1999*, Commonwealth Government Printer, Canberra.

Cox, D.R.. *Potter Point Outfall Modelling*, 27 May, 1997. Unisearch Ltd. Water Research Laboratory, University of NSW. WRL Technical Report 97/17.

Elliott, G.L, Campbell, B.L, Loughran, R.J. *Correlation of Erosion Measurements and Soil Caesium-137 Content*. Appl. Radiat. Isotopes, Vol.41(8), pp 713-17, 1990. Int. J. Radiat. Appl. Instrum. Part A. Pergamon Press, Great Britain.

Fry, R.M.,1966. *Reformulation of the Lucas Heights Liquid Effluent Discharge Authorisation*. AAEC/E156. Australian Atomic Energy Commission.

Gordon Gilmore, John Hemingway, 1995. *Practical Gamma-Ray Spectrometry*. John Wiley & Sons, West Sussex, England.

Harries, J.R. and Calf, G.E. (1980). *Tritium Measurements in the Tasman Sea and the Southern Ocean*. Australian Journal of Marine and Freshwater Research. Vol 31, No.6, pp737-45.

International Commission on Radiological Protection (ICRP), 1990 (b). *Annual Limits on Intake of Radionuclides by Workers based on the 1990 Recommendations*. ICRP Publication 61, Pergamon Press, Oxford.

International Atomic Energy Agency (1996), *Health and Environmental Aspects of Nuclear Fuel Cycle Facilities*, IAEA-TECDOC-918, IAEA, Vienna.

International Atomic Energy Agency, 1996. *International Basic Safety Standards for Protection against Ionising Radiation and for the Safety of Radiation Sources*. Jointly sponsored by the FAO, IAEA, ILO, OECD/NEA, PAHO and WHO. Safety Series No 115, IAEA, Vienna.

International Atomic Energy Agency, 1985. *Sediment K_d s and Concentration Factors for Radionuclides in the Marine Environment*, Technical Reports Series No.247, IAEA, Vienna.

International Atomic Energy Agency (IAEA), 1981. *Shallow Ground Disposal of Radioactive Wastes - A Guidebook*. Safety Series No. 53, Vienna.

International Commission on Radiological Protection (ICRP), 1975. *Report of the Task Group on Reference Man*. ICRP Publication 23. Pergamon Press, Oxford.

International Commission on Radiological Protection (ICRP), 1990(a). *Recommendations*. ICRP Publication 60, Pergamon Press, Oxford.

International Organisation for Standardisation, (ISO). *Water Quality - Determination of tritium activity concentration - Liquid scintillation counting method*. ISO 9698:1989 (E). Geneva, Switzerland.

International Organisation for Standardisation, (ISO). *Water Quality - Measurement of gross alpha activity in non-saline water - Thick source method*. ISO 9696:1992 (E). Geneva, Switzerland.

International Organisation for Standardisation, (ISO). *Water Quality - Measurement of gross beta activity in non-saline water - Thick source method*. ISO 9697:1992 (E). Geneva, Switzerland.

Kathren, R.L., 1984. *Radioactivity in the Environment - Sources, Distribution and Surveillance*. pp 160-162. University of Washington Joint Centre for Graduate Study, Richland, Washington. Harwood Academic Publishers.

National Health and Medical Research Council (NH&MRC), 1989. *Recommended Radiation Protection Standards for Individuals Exposed to Ionising Radiation*. Radiation Health Series No.27.

National Health and Medical Research Council & Australian Water Resources Council (NH&MRC and AWRC), 1996. *Australian Drinking Water Guidelines 1996*. Australian Government Publishing Service, Canberra.

National Health and Medical Research Council Report 39. *Recommendations for Limiting Exposure to Ionising Radiation and National Standard for Limiting Occupational Exposure to Ionising Radiation*, 1995. Australian Government Publishing Service, Canberra, ACT.

National Institute for Occupational Safety and Health (NIOSH), 1977. *Manual of Air Sampling Data*, Sheet 9 (SDS). Washington, DC.

National Radiological Protection Board (NRPB), 1991. *Committed Equivalent Organ Doses and Committed Effective Doses from Intakes of Radionuclides*. Part I, Chapter 4.3.3, Table 4.1. Report NRPB-R245, Chilton, UK.

Nuclear Energy Agency and International Atomic Energy Agency (1999), *Environmental Activities in Uranium Mining and Milling*. OECD, France.

Nigel Holmes and Associates (1991), *Air Quality Assessment, Lucas Heights Regional Depot*. Prepared for NSW Waste Services.

NSW Dairy Corporation. List of registered dairies closest to the LHSTC. Personal communication, N. Spooner, June 2000.

Protection of the Environment Operations Act 1997, No.156 as amended. Government Gazette, NSW Government Printery, Australia.

Radioactive Substances Regulations, 1959 under the Radioactive Substances Act, 1957. Regulations as amended. Government Gazette, NSW Government Printery, Australia.

Radiation Control Regulation, 1993 under the Radiation Control Act, 1990. Government Gazette No.94, 27 August 1993. NSW Government Printery, Australia.

Radiological and Environmental Sciences Laboratory (RESL), 1982. *Analytical Chemistry Branch Procedures Manual.* (Editors Bodnar, L.Z., Percival, D. R.) Analytical Chemistry Branch, US Department of Energy, Idaho. IDO/12096

Standards Association of Australia (SAA), 1990. *Methods For Sampling And Analysis Of Ambient Air. Method 9.6: Determination Of Total Suspended Particulates (TSP) - High Volume Sampler Gravimetric Method.* AS 3580.9.3-1990, Sydney.

Standards Association of Australia (SAA), 1990. *Waters - Determination of Gross Alpha and Gross Beta Activities.* AS 3550.5-1990, Sydney.

Sydney Water Corporation Pty Ltd. *Sydney Water Trade Waste Policy & Management Plan, August 1995.* Standards for Acceptance of Liquid Trade Wastes to Sewers.

United Nations Scientific Committee on the Effects of Atomic Radiation. *Sources and Effects of Ionising Radiation.* UNSCEAR 1993 Report to the General Assembly, with scientific annexes. United Nations, New York.

Webb, D.V., Solomon, S.B., Thomson, J.E.M. *Background Radiation Levels and Medical Exposure Levels in Australia.* Radiation Protection in Australasia (1999), March 1999, volume 16, No.1.

Wilson, A.R.W., 1957. *Radiation survey - Lucas Heights.* AAEC/K116. Australian Atomic Energy Commission.

Wilson, A.R.W., 1959. *Safe Levels for the Discharge of Radioactive Effluent into the Woronora Estuary.* AAEC/K260. Australian Atomic Energy Commission.

Worksafe Australia. *Exposure Standards for Atmospheric Contaminants in the Occupational Environment.* Guidance note NOHSC: 3008 (1995). Australian Government Printery Service, Canberra.

Worksafe Australia, 1995. *National Standard for Limiting Exposure to Ionising Radiation.* Guidance note NOHSC:1013(1995). Australian Government Printery Service, Canberra.

World Health Organisation (WHO) 1993. *Guidelines for Drinking-Water Quality.* Volume 1: Recommendations, 2nd Edition, Geneva.

World Health Organisation (WHO) 1996. *Guidelines for Drinking-Water Quality.* Volume 2: Health Criteria And Other Supporting Information, 2nd Edition, Geneva.

TABLE 1
ENVIRONMENTAL MONITORING SCHEDULE, 2000

SAMPLE	LOCATION ⁽¹⁾	FREQUENCY	COLLECTION DETAILS	SAMPLE PREPARATION & ANALYSIS
Stormwater	MDP+60m: 60m down-stream of MDP BUND.	Weekly, plus monthly composite.	2 x 5 L sampled with polyethylene bottle.	250 mL aliquot of the weekly sample distilled for tritium analysis. Weekly samples bulked into two monthly composites: 4 -5 L for α, β analysis; 8 - 10 L for γ . Remainder acidified & stored.
	Bund C: MDP	Weekly, plus monthly composite.	2 x 5 L sampled with polyethylene bottle.	As above.
	Bunds A, B & C	Daily samples (working days only) combined into a monthly composite.	1 L sampled with polyethylene bottle into 30 L drum.	Subsampled - 250 mL distilled for tritium analysis. One litre acidified & stored.
Estuary water	Woronora River: station E5.9 at Jannali Park.	Monthly.	250 mL, sampled by polyethylene bottle at surface.	Distilled for tritium analysis.
Creek water	Bardens Creek Weir.	Weekly.	250 mL sampled from weir overflow.	Distilled for tritium analysis.
	SPCC points: Bardens Ck Weir; MDP Ck Weir; Strassman Ck.	Monthly.	3 L sampled after rain.	Gross α, β analysis on 2 L (ISO method). Remaining 1 L acidified & stored.
	Forbes Creek.	Monthly.	1 L sampled after rain.	250 mL distilled for tritium analysis. Remainder acidified & stored.
	Bardens and Mill Creeks: station T2 near confluence.	Yearly.	5 L water from each creek (above the junction of the two creeks).	Evaporated and counted for α, β, γ . 250 mL distilled for tritium analysis. Remainder acidified & stored.

Notes:

1. Sampling locations are shown on **Figures 1 through 4.**

Continued next page...

TABLE 1 Continued...

SAMPLE	LOCATION ⁽¹⁾	FREQUENCY	COLLECTION DETAILS	SAMPLE PREPARATION & ANALYSIS
Ground water	Little Forest Burial Ground.	Twice yearly.	Bores are pumped dry & allowed to refill. Seven litres sampled from the centre of the bore, avoiding the bottom sediments.	Decanted, evaporated and counted for α, β, γ . 250 mL distilled for tritium analysis. Two litres acidified & stored.
	Sump near Bld 27.	Monthly.	1 L ground water seepage collected with clean sponge.	Distilled for tritium analysis. Immediate gamma spectrometry of 500 mL in Marinelli beaker. Remainder acidified & stored.
Airborne particulates	Little Forest Burial Ground: trench area.	Quarterly: particulates are accumulated for ~ 4 hours every 2 weeks over three months.	Airborne particulates were collected on 400 cm ² filter paper using <i>Ecotech</i> air sampler at 60 m ³ per hour.	Each quarterly sample divided into four equal parts: one analysed for beryllium by ICPMS, another put aside for a yearly composite, analysed for ^{239/240} Pu. The remaining two portions are stored.
Ambient iodine-131 in air	Stations 1, 2, 3 & 4: along the eastern boundary of LHSTC.	Continuous samples, changed weekly.	Collected on activated charcoal filters (Maypacks).	Gamma spectrometry of Maypacks using a 20 x 10 cm NaI crystal.
Soil / sediment	Stormwater bunds A, B & C.	Yearly, or whenever bunds are emptied.	Bund water is drained. 2 kg sampled randomly from accumulated sediments.	Soils/sediments are dried, ashed and sieved, then counted for α, β, γ activity.
	Little Forest Burial Ground.	If indicated by annual dose rate survey.	1 kg, from surface.	As above.
	Effluent discharge pipeline.	If indicated by six-monthly dose rate survey.	1 kg, from surface.	As above.
	Bardens and Mill Creeks: Station T2.	Yearly.	1 kg from each creek bed (upstream of their confluence).	As above.

Notes:

1. Sampling locations are shown on Figures 1 through 4.

Continued next page...

TABLE 1 Continued...

SAMPLE	LOCATION ⁽¹⁾	FREQUENCY	COLLECTION DETAILS	SAMPLE PREPARATION & ANALYSIS
Marine Biological Samples	Potter Point Ocean Outfall	Twice yearly.	Barnacles, algae & fish, near the outfall.	Gamma spectrometry of dried and ground samples prepared in duplicate.
	The Royal National Park.	Twice yearly.	Barnacles, algae & fish.	As above.
Gamma Dose Rate Survey	Effluent discharge pipeline.	Twice yearly.	Pipe joints and ground surveyed using Eberline PRM-7 dose-rate meter. Soil sampled if >3 times the background dose.	If collected, soils are sieved and ashed, then counted for α, β, γ activity.
	Little Forest Burial Ground.	Yearly.	Burial trenches are surveyed using a field dose-rate monitor. Soil is sampled if >3 times background.	As above.
External Gamma Radiation	LHSTC perimeter: 15 sites; plus Local suburbs: 3 sites.	Quarterly.	Two types of Thermoluminescent Dosimeter (TLD) badges, exposed to ambient gamma radiation.	Personal-type TLDs sent to ARL for analysis. Environmental TLDs analysed at ANSTO. Results reported as effective dose in mSv/year.

Notes

1. Sampling locations are shown on **Figures 1 through 4.**

TABLE 2

TRITIUM IN WORONORA ESTUARY WATER ⁽¹⁾
STATION E5.9, 2000

Date	Tritium ⁽²⁾ (Bq/L)
11-1-00	< 10 ⁽³⁾
25-2-00	< 10
9-3-00	< 10
14-4-00	< 10
2-5-00	< 10
13-6-00	< 10
18-7-00	< 10
8-8-00	< 10
15-9-00	< 10
5-10-00	< 10
22-11-00	< 10
12-12-00	< 10

Notes:

1. Refer to **Figure 1** for the Woronora Estuary sampling point.
2. The Reference Activity Concentration for tritium in drinking water is 7800 Bq/L (WHO, 1993).
3. Values quoted as "less than" figures were below the stated minimum detectable activity, calculated with 95 % confidence.

TABLE 3
TRITIUM IN FORBES CREEK ⁽¹⁾
WATER SAMPLES, 2000

Date	Tritium ⁽²⁾ (Bq/L)
11-1-00	< 10
25-2-00	< 10
9-3-00	< 10
14-4-00	< 10
2-5-00	< 10
13-6-00	< 10
18-7-00	< 10
8-8-00	< 10
15-9-00	< 10
5-10-00	< 10
22-11-00	< 10
12-12-00	< 10

Notes:

1. **Figure 1** shows the sampling location.
2. A "less than" value indicates that the result was below the minimum detectable activity (stated at the 95 % confidence level).

TABLE 4
RADIOACTIVITY IN FISH FROM POTTER POINT
OCEAN OUTFALL, 2000

Sampling Location ⁽¹⁾	Date Sampled	Gamma-emitters in FISH ⁽²⁾ Bq/kg FW ⁽³⁾				
		U&Th Series ⁽⁴⁾	⁴⁰ K	⁶⁰ Co	¹³⁷ Cs ⁽⁵⁾	¹³¹ I
POTTER POINT Ocean Outfall	12-5-00	✓	130 ± 10	< 0.7	< 0.6	0.81 ± 0.20
	5-12-00	✓	140 ± 10	< 0.5	0.46 ± 0.13	< 0.3
	5-12-00	✓	150 ± 10	< 0.5	< 0.8	< 0.3

Notes:

1. Samples were split to form duplicates, where possible. See **Figure 4** for sampling locations.
2. Flesh fillets of Luderick (*Girella sp.*) were analysed.
3. Radioactivity is in units of becquerels per kilogram of fresh (wet) sample.
4. ✓ in the U&Th Series column indicates the unquantified presence of decay products from the natural uranium-238 or thorium-232 series. **U&Th Series** and ⁴⁰K are of natural origin.
5. Caesium-137 is widely dispersed in the environment from atmospheric weapons testing and is found at similar levels in other species of fish from Australian regional waters.

TABLE 5
RADIOACTIVITY IN ALGAE FROM POTTER POINT
OCEAN OUTFALL, 2000

Date Sampled ⁽¹⁾	Gamma Emitters in ALGAE ⁽²⁾ Bq/kg FW ⁽³⁾					
	U&Th Series ⁽⁴⁾	⁷ Be	⁴⁰ K	⁶⁰ Co	¹³⁷ Cs	¹³¹ I
10-5-00	✓	14 ± 2	110 ± 10	1.0 ± 0.2	< 0.4	120 ± 10
10-5-00	✓	16 ± 2	90 ± 10	0.8 ± 0.2	< 0.3	350 ± 10
5-12-00	✓	22 ± 2	120 ± 10	1.0 ± 0.3	< 0.4	13 ± 1
5-12-00	✓	21 ± 2	110 ± 10	0.9 ± 0.3	< 0.3	12 ± 1

TABLE 6
RADIOACTIVITY IN BARNACLES FROM POTTER POINT
OCEAN OUTFALL, 2000

Date Sampled ⁽¹⁾	Gamma-emitters in BARNACLES ⁽²⁾ Bq/kg FW ⁽³⁾				
	U&Th Series ⁽⁴⁾	⁴⁰ K	⁶⁰ Co	¹³⁷ Cs	¹³¹ I
10-5-00	✓	20 ± 5	< 0.7	< 0.8	4.1 ± 0.7
10-5-00	✓	25 ± 5	< 1.1	< 0.9	4.7 ± 0.7
5-12-00	✓	20 ± 5	< 0.8	< 0.7	< 0.5
5-12-00	✓	25 ± 5	< 0.9	< 0.6	< 0.5

Notes for Tables 5 & 6:

1. Samples were split to form duplicates, where possible. See **Figure 4** for sampling locations.
2. Filamentous green algae (*Enteromorpha intestinalis* & *Cladophora* sp.) and barnacles (mainly *Tessieropera rosea*) were analysed whole and unwashed.
3. Radioactivity units are becquerels per kilogram of fresh (wet) sample.
4. A ✓ in the **U&Th Series** column indicates the unquantified presence of decay products from the natural uranium-238 or thorium-232 series. **U&Th Series**, ⁷Be and ⁴⁰K are all of natural origin.

TABLE 7a
TRITIUM IN COMPOSITE WATER SAMPLES FROM LHSTC
STORMWATER BUNDS, 2000

Month	Total Volume collected (L)	TRITIUM ⁽¹⁾ (Bq/L)		
		BUND A ^(2,3) Behind Building 1	BUND B Opposite Meteorology Tower	BUND C MDP – Waste Management Area
January	19	500 ± 30	-	-
February	20	810 ± 10	-	-
March	25	2760 ± 30	1240 ± 10	90 ± 10
April	17	970 ± 20	220 ± 10	100 ± 10
May	23	400 ± 10	120 ± 10	100 ± 10
June	21	80 ± 10	70 ± 10	60 ± 10
July	19	320 ± 10	300 ± 20	100 ± 10
August	23	150 ± 10	120 ± 20	100 ± 10
September	20	160 ± 20	120 ± 10	80 ± 20
October	21	470 ± 10	90 ± 10	70 ± 10
November	22	170 ± 20	70 ± 10	120 ± 10
December	19	150 ± 20	100 ± 20	80 ± 20

Notes:

1. The WHO reference concentration for tritium in drinking water is 7800 Bq/L.
2. Refer to **Figure 2** for the locations of the bunds.
3. The sampling regime for Bund A in 2000 was changed to the following: 1 litre collected daily before the bund was discharged (except weekends and public holidays). These daily samples were combined to form a monthly composite for tritium analysis. This new sampling regime was extended to all three bunds in March and replaces the discrete samples collected once per month in previous years.

TABLE 7b
TRITIUM IN WEEKLY WATER SAMPLES FROM MDP BUND C,⁽¹⁾ 2000

Date	Tritium ^(2,3) Bq/L	Date	Tritium Bq/L
5-1-00	120 ± 10	4-7-00	50 ± 10
11-1-00	20 ± 10	11-7-00	100 ± 10
18-1-00	110 ± 10	18-7-00	70 ± 10
25-1-00	70 ± 10	26-7-00	70 ± 10
1-2-00	40 ± 10	1-8-00	90 ± 10
8-2-00	30 ± 10	8-8-00	80 ± 10
15-2-00	40 ± 10	16-8-00	60 ± 10
22-2-00	60 ± 20	22-8-00	80 ± 10
29-2-00	80 ± 10	29-8-00	70 ± 10
8-3-00	30 ± 10	5-9-00	160 ± 20
14-3-00	140 ± 10	12-9-00	70 ± 10
21-3-00	30 ± 10	19-9-00	40 ± 10
28-3-00	90 ± 10	26-9-00	20 ± 10
4-4-00	90 ± 10	3-10-00	50 ± 10
11-4-00	80 ± 10	10-10-00	120 ± 10
18-4-00	110 ± 10	17-10-00	50 ± 10
29-4-00	60 ± 10	24-10-00	90 ± 10
2-5-00	100 ± 10	31-10-00	90 ± 10
9-5-00	120 ± 10	7-11-00	190 ± 10
16-5-00	80 ± 10	14-11-00	< 10 ⁽⁴⁾
23-5-00	110 ± 10	21-11-00	40 ± 10
30-5-00	40 ± 10	28-11-00	110 ± 10
6-6-00	30 ± 10	6-12-00	30 ± 10
13-6-00	50 ± 20	12-12-00	130 ± 10
20-6-00	110 ± 20	19-12-00	90 ± 10
27-6-00	90 ± 20	28-12-00	110 ± 10

Notes:

1. Refer to **Figure 2** for the location of this sampling point.
2. The average tritium level in MDP Bund C during 2000 was 80 Bq/L, which is 1% of the WHO drinking water reference activity (7800 Bq/L).
3. The weekly water samples from MDP Bund C were combined into monthly composite samples and analysed for gross alpha/beta and gamma activity. See **Table 7c** for these results.
4. A "less-than" value indicates that the result was below the minimum detectable activity (stated at the 95% confidence level).

TABLE 7c
RADIOACTIVITY IN COMPOSITE
WATER SAMPLES FROM MDP BUND C, 2000

Monthly Composite ⁽¹⁾	RADIOACTIVITY (Bq/L)					
	Gross α ⁽²⁾	Gross β ⁽³⁾	Gamma Emitters			
			⁷ Be ⁽⁴⁾	⁴⁰ K	¹³⁷ Cs ⁽⁵⁾	Other
January	< 0.01 ⁽⁶⁾	0.58 ± 0.01	0.20 ± 0.04	0.17 ± 0.04	0.024 ± 0.004	⁶⁰ Co 0.008 ± 0.003
February	0.03 ± 0.01	0.82 ± 0.01	0.28 ± 0.04	0.14 ± 0.03	0.059 ± 0.006	
March	< 0.03	0.51 ± 0.01	0.20 ± 0.03	0.18 ± 0.04	0.017 ± 0.004	
April	< 0.03	0.38 ± 0.01	0.10 ± 0.03	0.13 ± 0.04	0.012 ± 0.003	
May	< 0.02	0.32 ± 0.01	0.18 ± 0.03	0.10 ± 0.03	0.012 ± 0.002	
June	< 0.02	0.28 ± 0.01	0.08 ± 0.03	0.16 ± 0.03	0.010 ± 0.003	
July	< 0.02	0.28 ± 0.01	0.15 ± 0.03	< 0.093	< 0.021	²⁴¹ Am 0.010 ± 0.002 ⁶⁰ Co 0.031 ± 0.006
August	0.03 ± 0.01	0.46 ± 0.01	0.09 ± 0.03	0.11 ± 0.03	0.027 ± 0.004	
September	0.03 ± 0.01	0.32 ± 0.01	0.21 ± 0.04	0.11 ± 0.05	0.012 ± 0.003	
October	< 0.02	0.44 ± 0.01	0.25 ± 0.04	< 0.10	0.014 ± 0.003	⁶⁰ Co 0.043 ± 0.008
November	0.03 ± 0.01	0.47 ± 0.01	0.18 ± 0.03	0.24 ± 0.03	0.013 ± 0.003	
December	0.09 ± 0.01	1.21 ± 0.02	0.31 ± 0.05	0.16 ± 0.03	0.17 ± 0.02	

Notes:

1. Refer to **Figure 2** for the sampling location. MDP Bund C was sampled weekly for tritium analysis (see **Table 7b**). The remainder of the weekly samples were combined to make a monthly composite water sample for gross alpha, beta and gamma analysis.
2. The NSW Clean Water Regulations (1972) specify limits for radioactivity in class C waters as follows:
Gross alpha (α) 1.1 Bq/L ; Gross beta (β) 11.1 Bq/L.
3. The gross beta results include the contribution from potassium-40 (a natural beta-gamma emitter).
4. ⁷Be and ⁴⁰K are of natural origin.
5. In 2000, the average concentration of ¹³⁷Cs in MDP Bund Composites was < 0.020 Bq/L, which is < 0.2 % of the WHO reference value for ¹³⁷Cs in drinking water (10 Bq/L).
6. A less-than value indicates that the result was below the minimum detectable activity (stated at the 95 % confidence level).

TABLE 8
RADIOACTIVITY IN SEDIMENT FROM STORMWATER BUNDS, 2000

Location ⁽¹⁾	Date	RADIOACTIVITY in SEDIMENT, Bq/g DW ⁽²⁾			
		Gross α	Gross β	Gamma Emitters	⁴⁰ K
BUND A: Behind Building 1	24-2-00	0.55 ± 0.07	0.35 ± 0.02	U & Th series ⁷ Be = 0.061 ± 0.008 ¹³⁷ Cs = 0.008 ± 0.001 ⁶⁰ Co = 0.033 ± 0.003	0.23 ± 0.02
BUND B: Opposite Meteorological Tower	24-2-00	0.33 ± 0.07	0.22 ± 0.02	U & Th series ⁷ Be = 0.017 ± 0.004 ⁶⁰ Co = 0.0067 ± 0.0008 ¹³⁷ Cs = 0.0017 ± 0.0005	0.12 ± 0.01
BUND C: MDP (on Stormwater Outlet No.1)	24-2-00	0.65 ± 0.08	0.66 ± 0.02	U & Th series ¹³⁷ Cs = 0.13 ± 0.01 ⁶⁰ Co = 0.023 ± 0.002 ²⁴¹ Am = 0.009 ± 0.001 ¹⁴⁴ Ce = 0.0095 ± 0.0017	0.16 ± 0.02

Notes:

1. See **Figure 2** for the location of the stormwater bunds.
2. Refers to the radioactivity per gram (dry weight) of sample.

TABLE 9a
TRITIUM IN WEEKLY WATER SAMPLES FROM
MDP + 60m,⁽¹⁾ 2000

Date	Tritium ^(2,3) Bq/L	Date	Tritium Bq/L
5-1-00	90 ± 10	4-7-00	70 ± 10
11-1-00	40 ± 10	11-7-00	100 ± 10
18-1-00	60 ± 10	18-7-00	70 ± 10
25-1-00	80 ± 10	26-7-00	60 ± 10
1-2-00	30 ± 10	1-8-00	80 ± 10
8-2-00	40 ± 10	8-8-00	80 ± 10
15-2-00	70 ± 20	16-8-00	60 ± 10
22-2-00	70 ± 20	22-8-00	80 ± 10
29-2-00	70 ± 10	29-8-00	70 ± 10
8-3-00	30 ± 10	5-9-00	150 ± 10
14-3-00	120 ± 10	12-9-00	80 ± 10
21-3-00	30 ± 10	19-9-00	70 ± 10
28-3-00	80 ± 10	26-9-00	40 ± 10
4-4-00	80 ± 10	3-10-00	70 ± 10
11-4-00	70 ± 10	10-10-00	110 ± 20
18-4-00	130 ± 10	17-10-00	70 ± 10
26-4-00	70 ± 10	24-10-00	90 ± 20
2-5-00	90 ± 10	31-10-00	80 ± 10
9-5-00	100 ± 10	7-11-00	120 ± 10
16-5-00	70 ± 10	14-11-00	< 20 ⁽⁴⁾
23.5.00	90 ± 30	21-11-00	30 ± 10
30.5.00	60 ± 10	28-11-00	100 ± 10
6.6.00	40 ± 10	6-12-00	40 ± 10
13.6.00	60 ± 10	12-12-00	120 ± 10
20.6.00	70 ± 10	19-12-00	90 ± 10
27.6.00	80 ± 10	28-12-00	80 ± 20

Notes:

1. Refer to **Figure 2** for the location of this sampling point, 60m downstream of Stormwater Outlet No. 1 on MDP Creek.
2. The average tritium level during 2000 was about 80 Bq/L, representing 1% of the WHO reference concentration for tritium in drinking water (7800 Bq/L).
3. The weekly water samples were combined to make monthly composite samples, then analysed for gross alpha/beta and gamma activity. See **Table 9b** for these results.
4. A "less-than" value indicates that the result was below the minimum detectable activity (stated at the 95% confidence level).

TABLE 9b
RADIOACTIVITY IN COMPOSITE
WATER SAMPLES FROM MDP+60m⁽¹⁾, 2000

Monthly Composite	RADIOACTIVITY (Bq/L)					
	Gross α ⁽²⁾	Gross β	Gamma-Emitters ⁽³⁾			
			⁶⁰ Co ⁽⁴⁾	¹³⁷ Cs ⁽⁵⁾	⁷ Be	⁴⁰ K
January	< 0.02 ⁽⁶⁾	0.29 ± 0.01	-	0.012 ± 0.003	-	0.17 ± 0.04
February	< 0.02	0.25 ± 0.01	-	0.013 ± 0.003	0.11 ± 0.03	0.18 ± 0.03
March	0.02 ± 0.01	0.38 ± 0.01	-	0.016 ± 0.003	0.20 ± 0.03	0.19 ± 0.04
April	0.04 ± 0.01	0.34 ± 0.01	-	0.018 ± 0.003	-	0.15 ± 0.04
May	< 0.03	0.29 ± 0.01	-	0.008 ± 0.002	-	0.11 ± 0.03
June	< 0.02	0.23 ± 0.01	-	0.007 ± 0.003	-	0.13 ± 0.03
July	< 0.03	0.28 ± 0.01	-	0.010 ± 0.003	-	< 0.07
August	< 0.03	0.34 ± 0.01	0.012 ± 0.003	0.010 ± 0.003	-	< 0.07
September	0.02 ± 0.01	0.27 ± 0.01	-	0.009 ± 0.003	-	0.16 ± 0.03
October	0.02 ± 0.01	0.32 ± 0.01	-	0.013 ± 0.003	-	< 0.07
November	0.05 ± 0.01	0.31 ± 0.01	-	0.015 ± 0.003	0.11 ± 0.03	0.13 ± 0.06
December	0.05 ± 0.01	0.49 ± 0.01	-	0.025 ± 0.004	-	0.09 ± 0.04

Notes:

1. Refer to **Figure 2** for the location of this sampling point. This location was sampled weekly for tritium (see **Table 9a**). The remaining weekly samples were combined into a monthly composite water sample for gross alpha, beta and gamma analyses.
2. The NSW Clean Water Regulations (1972) specify limits for radioactivity in class C waters as follows: gross α 1.1 Bq/L ; gross β 11.1 Bq/L. The gross beta results include the contribution from potassium-40 (a natural beta-gamma emitter).
3. ⁷Be and ⁴⁰K are of natural origin.
4. The small amount of ⁶⁰Co reported for August was close to the detection limit and less than 0.1 % of the WHO reference value for ⁶⁰Co in drinking water.
5. The average ¹³⁷Cs concentration measured in 2000 was 0.013 Bq/L which is less than 0.2 % of the WHO reference value for ¹³⁷Cs in drinking water (10 Bq/L).
6. A "less than" value indicates that the result was below the minimum detectable activity (stated with 95 % confidence).

TABLE 10
RADIOACTIVITY IN WATER FROM SPCC ⁽¹⁾ SAMPLING POINTS, 2000

Date	RADIOACTIVITY ⁽²⁾ (Bq/L)					
	Strassman Creek		Bardens Creek Weir		MDP Creek Weir	
	Gross α	Gross β	Gross α	Gross β	Gross α	Gross β
11-2-00	< 0.01 ⁽³⁾	0.05 $\pm$ 0.01	< 0.02	< 0.03	< 0.02	0.31 $\pm$ 0.01
25-2-00	< 0.01	0.06 $\pm$ 0.01	< 0.03	0.04 $\pm$ 0.01	< 0.02	0.30 $\pm$ 0.01
28-3-00	< 0.02	0.05 $\pm$ 0.01	< 0.03	0.06 $\pm$ 0.01	< 0.01	0.24 $\pm$ 0.01
1-5-00	< 0.02	0.04 $\pm$ 0.01	< 0.02	0.04 $\pm$ 0.01	< 0.02	0.19 $\pm$ 0.01
26-5-00	< 0.01	0.03 $\pm$ 0.01	< 0.01	0.07 $\pm$ 0.01	< 0.02	0.24 $\pm$ 0.01
27-6-00	< 0.01	0.04 $\pm$ 0.01	< 0.01	0.10 $\pm$ 0.01	< 0.01	0.19 $\pm$ 0.01
24-7-00	< 0.01	0.05 $\pm$ 0.01	< 0.02	0.05 $\pm$ 0.01	< 0.02	0.23 $\pm$ 0.01
30-8-00	< 0.02	0.03 $\pm$ 0.01	< 0.02	0.04 $\pm$ 0.01	< 0.02	0.22 $\pm$ 0.01
15-9-00	< 0.01	0.03 $\pm$ 0.01	< 0.02	0.05 $\pm$ 0.01	< 0.03	0.24 $\pm$ 0.01
6-11-00	< 0.03	0.04 $\pm$ 0.01	< 0.02	0.03 $\pm$ 0.01	< 0.01	0.18 $\pm$ 0.01
23-11-00	< 0.03	0.05 $\pm$ 0.01	< 0.02	0.06 $\pm$ 0.01	< 0.03	0.65 $\pm$ 0.02
20-12-00	< 0.02	0.06 $\pm$ 0.01	< 0.03	0.04 $\pm$ 0.01	< 0.02	0.27 $\pm$ 0.01

Notes:

1. See **Figure 2** for the location of the former SPCC (now NSW EPA) sampling points.
2. The NSW Clean Waters Regulations (1972) specify limits for radioactivity in class C waters are as follows: gross alpha < 1.1 Bq/L ; gross beta < 11.1 Bq/L. All gross beta results include the contribution from the naturally-occurring beta-gamma emitter, potassium-40.
3. Values which are quoted as "less than" figures were below the stated minimum detectable activity (calculated with 95 % confidence).

TABLE 11

TRITIUM IN WATER FROM BARDENS CREEK WEIR ⁽¹⁾
(at SPCC sampling point), 2000

Date	Tritium ⁽²⁾ Bq/L	Date	Tritium Bq/L
5-1-00	40 ± 10	4-7-00	200 ± 10
11-1-00	110 ± 20	11-7-00	80 ± 10
18-1-00	100 ± 10	18-7-00	90 ± 10
25-1-00	40 ± 10	25-7-00	50 ± 10
1-2-00	140 ± 20	1-8-00	70 ± 10
8-2-00	60 ± 10	8-8-00	60 ± 10
15-2-00	50 ± 10	16-8-00	50 ± 10
22-2-00	70 ± 10	22-8-00	70 ± 50
29-2-00	1200 ± 20	29-8-00	70 ± 20
8-3-00	500 ± 10	5-9-00	160 ± 70
14-3-00	4680 ± 70	12-9-00	80 ± 10
21-3-00	110 ± 10	19-9-00	100 ± 10
28-3-00	170 ± 10	26-9-00	30 ± 10
4-4-00	160 ± 10	3-10-00	130 ± 10
11-4-00	130 ± 10	10-10-00	730 ± 30
18-4-00	360 ± 10	17-10-00	140 ± 20
26-4-00	700 ± 20	24-10-00	160 ± 20
2-5-00	150 ± 10	31-10-00	110 ± 20
9-5-00	110 ± 10	7-11-00	90 ± 10
16-5-00	50 ± 10	14-11-00	< 20
23-5-00	30 ± 10	21-11-00	70 ± 10
30-5-00	30 ± 10	28-11-00	40 ± 10
6-6-00	< 20 ⁽³⁾	6-12-00	50 ± 10
13-6-00	60 ± 10	12-12-00	60 ± 20
20-6-00	50 ± 20	19-12-00	70 ± 10
27-6-00	50 ± 10	28-12-00	40 ± 10

Notes:

1. See **Figure 2** for the location of this sampling point.
2. The average weekly tritium concentration at Bardens Creek weir during 2000 was 230 Bq/L which is below 3% of the WHO drinking water reference activity concentration.
3. Values which are quoted as "less than" figures were below the stated minimum detectable activity (calculated with 95 % confidence).

TABLE 12**GAMMA DOSE-RATE SURVEY of EFFLUENT DISCHARGE PIPELINE, 2000**

Date	Location ^(1,2)	Dose-rate ($\mu\text{Sv}/\text{hour}$)		Background Dose-rate ($\mu\text{Sv}/\text{hour}$)
		Ground Below Joint	Pipe Joint	
8-5-00	Joints #1-22	0.05 – 0.11	0.08 – 0.12	0.07 – 0.13
23-10-00	Joints #1-22	0.07 – 0.13	0.07 – 0.11	0.06 – 0.11

Notes:

1. Survey of exposed portions of pipeline between LHSTC and the Sydney Water sewer connection, using a calibrated Eberline PRM-7 gamma dose-rate meter.
2. The survey excluded joints numbered 17, 18 & 19 which are inaccessible.

TABLE 13**GAMMA DOSE-RATE SURVEY of BURIAL TRENCHES at LITTLE FOREST BURIAL GROUND, 2000**

Date	Location ^(1,2)	Dose-rate ($\mu\text{Sv}/\text{hour}$)
12 October 2000	Background reading (outside LFBG fence)	0.10 – 0.15
	Trenches 1-51	0.10 – 0.15
	Trenches 52-77	0.10 – 0.15
	Soil samples ⁽³⁾ 1 - 4	0.10 – 0.15

Notes:

1. See **Figure 3** for the location of the waste burial trenches and sampling points at LFBG.
2. The survey was performed using a calibrated Eberline PRM-7 gamma dose-rate meter.
3. Four soil samples were collected, see Section 5.7.

TABLE 14a
RADIOACTIVITY IN SOIL FROM LITTLE FOREST BURIAL GROUND, 2000

Sampling Location ⁽¹⁾	Date	RADIOACTIVITY in SOIL (Bq/g DW) ⁽²⁾		
		Gross α	Gross β	Gamma Emitters
#1: southern end of burial trench area numbered 1-51.	12-10-00	0.58 ± 0.07	0.50 ± 0.02	U & Th series, $^{40}\text{K} = 0.15 \pm 0.02$
#2: southern end of burial trench area numbered 52-77.	12-10-00	0.51 ± 0.07	0.47 ± 0.02	U & Th series, $^{40}\text{K} = 0.13 \pm 0.02$
#3: northern end of burial trench area numbered 52-77.	12-10-00	0.49 ± 0.07	0.40 ± 0.02	U & Th series, $^{40}\text{K} = 0.10 \pm 0.01$
#4: Reference site: outside LFBG fenced area ⁽³⁾ , near bore MB 22.	12-10-00	0.44 ± 0.06	0.40 ± 0.02	U & Th series, $^{40}\text{K} = 0.07 \pm 0.01$

Notes:

1. These soil samples were collected in response to vandalism of the LFBG fenced area. See Section 5.7.
2. Refers to the radioactivity per gram (dry weight) of sample.
3. The soil from this location was sandy whereas the trench covering consists of clay/shale.

TABLE 14b
RADIOACTIVITY IN GROUNDWATER FROM LITTLE FOREST
BURIAL GROUND, 2000

Bore ⁽¹⁾	Date Sampled	RADIOACTIVITY ^(2,3) Bq /L				
		³ H	Gross α	Gross β	Gamma Emitters	
					⁴⁰ K	Others
BHF	23-5-00	270 $\pm$ 20	< 0.05	0.11 $\pm$ 0.01	< 0.24	N.D
BH10	"	400 $\pm$ 10	< 0.05	0.05 $\pm$ 0.01	< 0.20	N.D
OS2	"	670 $\pm$ 30	< 0.03	0.07 $\pm$ 0.01	0.46 $\pm$ 0.09	N.D
OS3	"	1230 $\pm$ 30	< 0.06	0.33 $\pm$ 0.01	< 0.25	N.D
MB11	"	< 30	< 0.02	0.03 $\pm$ 0.01	0.40 $\pm$ 0.08	N.D
MB12	"	40 $\pm$ 10	< 0.01	0.03 $\pm$ 0.01	0.25 $\pm$ 0.07	N.D
MB13	"	1280 $\pm$ 20	< 0.03	0.07 $\pm$ 0.01	0.38 $\pm$ 0.09	N.D
MB14	"	40 $\pm$ 10	< 0.11	0.17 $\pm$ 0.03	0.50 $\pm$ 0.09	N.D
MB15	"	< 10	< 0.03	0.04 $\pm$ 0.01	0.21 $\pm$ 0.10	N.D
MB16 ⁽⁴⁾	"	6050 $\pm$ 50	0.18 $\pm$ 0.02	0.40 $\pm$ 0.01	< 0.34	⁶⁰ Co 0.26 $\pm$ 0.03
MB17	"	530 $\pm$ 20	< 0.03	0.04 $\pm$ 0.01	0.36 $\pm$ 0.08	N.D
MB18	"	190 $\pm$ 10	< 0.08	0.11 $\pm$ 0.02	0.48 $\pm$ 0.08	N.D
MB19 ⁽⁵⁾	"	110 $\pm$ 10	< 0.37	0.41 $\pm$ 0.09	0.82 $\pm$ 0.11	N.D
MB20	"	40 $\pm$ 20	< 0.06	0.19 $\pm$ 0.02	0.55 $\pm$ 0.09	N.D
MB21	"	< 10	< 0.06	0.16 $\pm$ 0.01	0.65 $\pm$ 0.09	N.D
BHF	10-11-00	430 $\pm$ 50	< 0.06	0.10 $\pm$ 0.01	< 0.31	N.D
BH10	"	760 $\pm$ 20	< 0.07	0.12 $\pm$ 0.02	< 0.29	N.D
OS2	"	390 $\pm$ 20	< 0.12	0.29 $\pm$ 0.03	< 0.34	N.D
OS3	"	1900 $\pm$ 50	< 0.03	0.09 $\pm$ 0.01	< 0.33	N.D
MB11	"	< 20	< 0.06	0.07 $\pm$ 0.01	< 0.33	N.D
MB12	"	< 30	< 0.06	0.05 $\pm$ 0.01	< 0.34	N.D
MB13	"	3700 $\pm$ 100	0.11 $\pm$ 0.02	0.11 $\pm$ 0.01	< 0.32	N.D
MB14	"	150 $\pm$ 10	< 0.13	0.20 $\pm$ 0.04	< 0.33	N.D
MB15	"	< 30	0.06 $\pm$ 0.02	0.09 $\pm$ 0.01	< 0.30	N.D
MB16	"	8160 $\pm$ 80	0.90 $\pm$ 0.08	1.30 $\pm$ 0.04	< 0.18	⁶⁰ Co 0.097 $\pm$ 0.011
MB17	"	880 $\pm$ 20	< 0.11	0.09 $\pm$ 0.02	< 0.29	N.D
MB18	"	80 $\pm$ 10	< 0.11	0.17 $\pm$ 0.02	< 0.14	N.D
MB19	"	80 $\pm$ 10	< 0.06	0.14 $\pm$ 0.02	< 0.50	N.D
MB20	"	< 20	< 0.16	0.42 $\pm$ 0.04	< 0.64	N.D
MB21	"	110 $\pm$ 10	0.10 $\pm$ 0.02	0.30 $\pm$ 0.01	< 0.43	N.D

Notes:

1. See Figure 3 for the location of the groundwater monitoring bores at the Little Forest Burial Ground.
2. The Australian Drinking Water Guidelines (1996) recommended limits are: < 0.1 Bq/L for gross alpha activity; and < 0.5 Bq/L for gross beta activity (including potassium-40). Gross beta results above include the contribution from natural potassium-40. The WHO guideline value for tritium in drinking water is 7800 Bq/L.
3. A "less than" value indicates that the result was below the minimum detectable activity (stated at the 95% confidence level). "N.D." indicates that no other significant radioactivity was detected.
4. The maximum ⁶⁰Co level in MB16 was < 2 % of the WHO drinking water guideline concentration (20 Bq/L).
5. Shading indicated those bores which are outside the fenced area of the LFBG.

TABLE 15
RADIOACTIVITY IN CREEKS NORTH OF THE
LITTLE FOREST BURIAL GROUND, 2000

Sample Location	Date	RADIOACTIVITY in SEDIMENT (Bq/g DW)			
		Gross α	Gross β	γ -emitters	
Mill Creek	27-11-00	0.91 ± 0.09	0.71 ± 0.03	^{40}K 0.27 ± 0.03 U + Th series	
Bardens Creek	27-11-00	0.69 ± 0.08	0.10 ± 0.02	^{40}K 0.04 ± 0.01 U + Th series	
Sample Location	Date	RADIOACTIVITY in WATER (Bq/L)			
		Gross α	Gross β	γ -emitters	Tritium
Mill Creek	27-11-00	0.04 ± 0.01	0.54 ± 0.02	^{40}K 0.70 ± 0.20	<10
Bardens Creek	27-11-00	0.03 ± 0.01	0.08 ± 0.01	^{40}K < 0.38	30 ± 10

Notes:

1. See **Figure 1** for the location of these sampling points.
2. The creeks were each sampled approximately 20m upstream from their confluence.

TABLE 16
PARTICULATES IN AIR AT LITTLE FOREST BURIAL GROUND, 2000

Sampling Period ^(1,2)	Average Windspeed ⁽³⁾ (m.s ⁻¹)	Equivalent Volume ⁽⁴⁾ (m ³)	Beryllium ⁽⁵⁾		^{239/240} Plutonium ⁽⁶⁾	
			μg (total)	$\mu\text{g m}^{-3}$	Bq (total)	Bq m ⁻³
Jan – Mar	2.8	450.8	< 0.050	$< 1.1 \times 10^{-4}$	-	-
Apr – Jun	3.0	312.7	< 0.050	$< 1.6 \times 10^{-4}$	-	-
July – Sept	3.5	275.1	< 0.004	$< 1.45 \times 10^{-5}$	-	-
Oct – Dec	3.3	345.9	< 0.005	$< 1.4 \times 10^{-5}$	-	-
2000 Composite	3.2	1384.5	-	-	< 0.001	$< 7.2 \times 10^{-7}$

Notes:

1. Samples were collected using a mobile Ecotech high-volume air sampler (US-EPA-approved).
2. Airborne particulate samples at LFBG were accumulated on a single filter over a period of 3 months. The sampling duration and frequency was approximately 4 hours, every 2 weeks. The filter paper was then divided into four equal parts with one being used per Be & Pu analysis and two retained as duplicates.
3. The average windspeed during each sampling period was calculated from the data recorded at the 10m point on the LHSTC meteorological tower.
4. The Equivalent Volume is 25% of the total volume of air sampled, since one-quarter of the filter is used for each analysis.
5. The Worksafe Australia Exposure Standard for atmospheric contaminants such as beryllium in air is $2 \mu\text{g m}^{-3}$ (applicable to workers exposed 8 hours per day, 50 weeks per year).
6. The limit of detection for plutonium-239/240 in Bq/m³ would equate to a committed effective dose to adults of < 0.0002 mSv/year, or < 0.02% of the allowable public dose limit of 1 mSv/y.

TABLE 17
AMBIENT IODINE-131 IN AIR at LHSTC, 2000

Iodine-131^(1,2)		Iodine-131	
Sampled during the week ending:	Air Concentration Bq / m ³	Sampled during the week ending:	Air Concentration Bq / m ³
5-1-00	< 0.0025	4-7-00	< 0.0025
11-1-00	< 0.0025	11-7-00	< 0.0025
18-1-00	< 0.0025	18-7-00	< 0.0025
25-1-00	< 0.0025	25-7-00	< 0.0025
1-2-00	< 0.0025	1-8-00	< 0.0025
8-2-00	< 0.0025	8-8-00	< 0.0025
15-2-00	< 0.0025	15-8-00	< 0.0025
22-2-00	< 0.0025	22-8-00	< 0.0025
29-2-00	< 0.0025	29-8-00	< 0.0025
8-3-00	< 0.0025	5-9-00	< 0.0025
14-3-00	< 0.0025	12-9-00	< 0.0025
21-3-00	< 0.0025	19-9-00	< 0.0025
28-3-00	< 0.0025	26-9-00	< 0.0025
4-4-00	< 0.0025	3-10-00	< 0.0025
11-4-00	< 0.0025	10-10-00	< 0.0025
18-4-00	< 0.0025	17-10-00	< 0.0025
26-4-00	< 0.0025	24-10-00	< 0.0025
2-5-00	< 0.0025	31-10-00	< 0.0025
9-5-00	< 0.0025	7-11-00	< 0.0025
16-5-00	< 0.0025	14-11-00	< 0.0025
23-5-00	< 0.0025	21-11-00	< 0.0025
30-5-00	< 0.0025	28-11-00	< 0.0025
6-6-00	< 0.0025	6-12-00	< 0.0025
13-6-00	< 0.0025	12-12-00	< 0.0025
20-6-00	< 0.0025	19-12-00	< 0.0025
27-6-00	< 0.0025	28-12-00	< 0.0025

Notes:

1. Four air samplers are located along the eastern boundary of the LHSTC site, where suburban residences are closest (see **Figure 2**). Results are calculated making the conservative assumptions that:
 - (a) all iodine-131 activity was released during the first day of the 7 day sampling period;
 - (b) all the activity was concentrated at one sampling point.
2. A person with continuous exposure to iodine-131 at a concentration of 0.0025 Bq/m³ would receive an effective dose of less than 0.01 mSv per year (IAEA, 1994).

TABLE 18a
EXTERNAL GAMMA RADIATION AT LHSTC
(ARPANSA Dosimeter Results), 1996 to 2000

Dosimeter Location: on-site ⁽¹⁾	Effective Dose ⁽²⁾ ARPANSA Dosimeters ⁽³⁾ (mSv / year)				
	1996	1997	1998	1999	2000
1 Hifar fence - south east	0.8 ± 0.3	0.9 ± 0.4	1.0 ± 0.4	1.0 ± 0.5	0.9 ± 0.3
2 Hifar fence - south	2.2 ± 0.3	3.3 ± 0.5	3.3 ± 0.5	3.2 ± 0.5	3.3 ± 0.4
3 Perimeter fence - west	1.0 ± 0.4	1.2 ± 0.5	1.3 ± 0.5	1.0 ± 0.5	1.0 ± 0.3
4 Hifar fence - west	2.1 ± 0.3	1.5 ± 0.6	1.2 ± 0.5	1.5 ± 0.2	1.3 ± 0.2
5 Hifar fence - north west	3.0 ± 0.5	1.2 ± 0.5	0.9 ± 0.4	1.1 ± 0.5	1.1 ± 0.4
6 Perimeter fence - north A	0.8 ± 0.3	0.9 ± 0.4	0.8 ± 0.4	0.8 ± 0.4	0.8 ± 0.3
7 Internal fence - north	0.8 ± 0.3	1.1 ± 0.4	0.8 ± 0.4	0.8 ± 0.4	0.9 ± 0.3
8 Perimeter fence - north B	0.7 ± 0.3	1.0 ± 0.4	0.8 ± 0.4	1.0 ± 0.4	0.9 ± 0.3
9 Perimeter fence - north east	0.7 ± 0.3	0.8 ± 0.3	0.8 ± 0.3	0.7 ± 0.3	0.7 ± 0.2
10 Perimeter fence - east	0.7 ± 0.3	0.9 ± 0.4	0.8 ± 0.4	0.8 ± 0.4	0.8 ± 0.3
11 Perimeter fence - south east	0.5 ± 0.2	0.9 ± 0.3	0.9 ± 0.4	0.6 ± 0.3	0.7 ± 0.2
12 Corner of Curie and Roentgen Streets	0.8 ± 0.3	1.2 ± 0.5	0.8 ± 0.4	1.1 ± 0.5	1.0 ± 0.3
13 Perimeter fence - south	0.6 ± 0.2	0.7 ± 0.3	0.8 ± 0.4	0.7 ± 0.3	0.6 ± 0.2
14 Hifar fence - east	0.8 ± 0.3	1.0 ± 0.4	1.1 ± 0.5	1.0 ± 0.4	1.0 ± 0.3
15 Hifar fence - north east	0.9 ± 0.4	1.1 ± 0.5	1.0 ± 0.4	1.1 ± 0.5	1.0 ± 0.3
Dosimeter Location: off-site	1996	1997	1998	1999	2000
16 Private house - Barden Ridge	0.7 ± 0.3	0.8 ± 0.3	0.9 ± 0.4	0.7 ± 0.3	0.7 ± 0.2
17 Private house - Engadine	0.8 ± 0.3	1.1 ± 0.4	0.9 ± 0.4	1.0 ± 0.4	0.9 ± 0.3
18 Private house - Woronora	0.7 ± 0.3	0.9 ± 0.4	0.9 ± 0.4	0.8 ± 0.3	0.8 ± 0.2
19 Cronulla Sewage Treatment Plant	-	-	-	0.5 ± 0.2 ⁽⁴⁾	0.6 ± 0.2

Notes:

1. Refer to Figure 2 for the locations of dosimeters 1 to 15.
2. The data were reported as absorbed dose to air (mGy) and converted to effective dose for adults (mSv) using a conservative conversion factor of 1. UNSCEAR (1993) uses a factor of 0.72 Sv per Gy for adults, 0.80 for children and 0.93 for infants.
3. The ARPANSA dosimeters are the same as those usually used for personal monitoring, consisting of calcium sulphate thermoluminescent material with three filtered areas and an open window. The uncertainties (at the 95% confidence level) have been estimated from the standard deviation of the results for several dosimeters placed at the same location.
4. New sampling point introduced in 1999 with an estimated value based on two measurements.

TABLE 18b

EXTERNAL GAMMA RADIATION AT LHSTC,
Comparison of ARPANSA and ANSTO Results, 2000

Dosimeter Location: on-site ⁽¹⁾		Thermoluminescent Dosimeter Results 2000 Effective Dose ⁽²⁾ (mSv / year)	
		ARPANSA ⁽³⁾	ANSTO ⁽⁴⁾
1	Hifar fence - south east	0.9 ± 0.3	1.0 ± 0.1
2	Hifar fence - south	3.3 ± 0.4	3.2 ± 0.2
3	Perimeter fence - west	1.0 ± 0.3	1.1 ± 0.1
4	Hifar fence - west	1.3 ± 0.2	1.3 ± 0.1
5	Hifar fence - north west	1.1 ± 0.4	0.9 ± 0.1
6	Perimeter fence - north A	0.8 ± 0.3	0.9 ± 0.1
7	Internal fence - north	0.9 ± 0.3	0.9 ± 0.1
8	Perimeter fence - north B	0.9 ± 0.3	0.9 ± 0.1
9	Perimeter fence - north east	0.7 ± 0.2	0.8 ± 0.1
10	Perimeter fence - east	0.8 ± 0.3	0.9 ± 0.1
11	Perimeter fence - south east	0.7 ± 0.2	0.8 ± 0.1
12	Corner of Curie and Roentgen St	1.0 ± 0.3	1.0 ± 0.1
13	Perimeter fence - south	0.6 ± 0.2	0.7 ± 0.1
14	Hifar fence - east	1.0 ± 0.3	1.0 ± 0.1
15	Hifar fence - north east	1.0 ± 0.3	1.1 ± 0.1
Dosimeter Location: off-site		ARPANSA	ANSTO
16	Private house - Barden Ridge	0.7 ± 0.2	0.8 ± 0.1
17	Private house - Engadine	0.9 ± 0.3	1.2 ± 0.1
18	Private house - Woronora	0.8 ± 0.2	0.9 ± 0.1
19	Cronulla Sewage Treatment Plant	0.6 ± 0.2	0.6 ± 0.1

Notes:

1. Refer to Figure 2 for the locations of thermoluminescent dosimeters (TLD's) 1 to 15.
2. The data were reported as absorbed dose to air (mGy) and converted to effective dose for adults (mSv) using a conservative conversion factor of 1. UNSCEAR (1993) uses a factor of 0.72 Sv per Gy for adults, 0.80 for children and 0.93 for infants.
3. The ARPANSA dosimeters are the same as those usually used for personal monitoring, consisting of calcium sulphate thermoluminescent material with three filtered areas and an open window.
4. The ANSTO environmental dosimeters contain lithium fluoride and calcium fluoride thermoluminescent materials with energy compensation filters. The uncertainties for ANSTO results have been estimated (at the 95% confidence level) from the standard deviation of the results for several dosimeters placed at the same location.

TABLE 19a
AIRBORNE RADIOACTIVITY DISCHARGES FROM INDIVIDUAL DISCHARGE POINTS at LHSTC,
January – March 2000

STACK ⁽¹⁾	Alpha (kBq)	Beta ⁽²⁾ (kBq)	Iodine-131 (MBq)	Tritium (GBq)	Noble Gases ⁽³⁾ (TBq)	Other Nuclides (MBq)			
3	N.D. ⁽⁴⁾	N.D.	0.6						
15A	N.D.	33	0.62	8500	16	Hg-197 9.6	Hg-203 2.4	As-76 15	Br-82 0.61
15M	N.D.	N.D.	0.2	140	1.1				
19S	N.D.	N.D.	1.1						
19D	N.D.	N.D.	0.099						
20	N.D.	N.D.	1.0	37					
21A	N.D.	N.D.	0.059						
21B	N.D.	N.D.	0.017						
23A	N.D.	280	990						
23B	N.D.	N.D.	0.32						
41A	N.D.	N.D.	0.84						
41B	N.D.	N.D.	0.46						
54	N.D.	N.D.	3000		160	I-132 23000	I-133 1500		
56	N.D.	N.D.	1.9						
57	N.D.	N.D.	2.8	60					

Notes:

1. See **Figure 2** for the location of the discharge stacks and **Appendix B** for explanations of the different types of airborne discharges.
2. Any long-lived beta activity is assumed to be Strontium-90, although this nuclide is not a likely candidate.
3. Noble gases emitted from building 54 stack are short-lived radioactive isotopes of Xenon and Krypton from Tc-99 production. HIFAR emits mainly Argon-41 produced by the neutron activation of air inside the reactor irradiation facilities.
4. "N.D." indicates that the radioactivity was not detected.

TABLE 19b

AIRBORNE RADIOACTIVITY DISCHARGES FROM INDIVIDUAL DISCHARGE POINTS at LHSTC,
April – June 2000

STACK ⁽¹⁾	Alpha (kBq)	Beta ⁽²⁾ (kBq)	Iodine-131 (MBq)	Tritium (GBq)	Noble Gases ⁽³⁾ (TBq)	Other Nuclides (MBq)			
3	N.D. ⁽⁴⁾	N.D.	0.62						
15A	N.D.	74	1.0	2200	24	Hg-197 7.8	Hg-203 2.3	As-76 22	Br-82 1.1
15M	N.D.	N.D.	0.2	94	1.6				
19S	N.D.	N.D.	2.9						
19D	N.D.	N.D.	0.082						
20	N.D.	N.D.	0.58	77					
21A	N.D.	N.D.	0.026						
21B	N.D.	N.D.	0.02						
23A	N.D.	830	530						
23B	N.D.	N.D.	0.27						
41A	N.D.	N.D.	1.2						
41B	N.D.	N.D.	0.14						
54	N.D.	N.D.	1200		91	I-132 7500	I-133 230		
56	N.D.	N.D.	2.4						
57	N.D.	N.D.	0.43	16					

Notes:

1. See **Figure 2** for the location of the discharge stacks and **Appendix B** for explanations of the different types of airborne discharges.
2. Any long-lived beta activity is assumed to be Strontium-90, although this nuclide is not a likely candidate.
3. Noble gases emitted from building 54 stack are short-lived radioactive isotopes of Xenon and Krypton from Tc-99 production. HIFAR emits mainly Argon-41 produced by the neutron activation of air inside the reactor irradiation facilities.
4. "N.D." indicates that the radioactivity was not detected.

TABLE 19c
AIRBORNE RADIOACTIVITY DISCHARGES FROM INDIVIDUAL DISCHARGE POINTS at LHSTC,
July – September 2000

STACK ⁽¹⁾	Alpha (kBq)	Beta ⁽²⁾ (kBq)	Iodine-131 (MBq)	Tritium (GBq)	Noble Gases ⁽³⁾ (TBq)	Other Nuclides (MBq)			
3	N.D. ⁽⁴⁾	N.D.	0.21						
15A	N.D.	130	1.0	770	31	Hg-197 11.0	Hg-203 0.86	As-76 22.0	Br-82 1.2
15M	N.D.	N.D.	0.083	31	1.7				
19S	N.D.	N.D.	3.4						
19D	N.D.	N.D.	0.078						
20	N.D.	N.D.	0.28	20					
21A	N.D.	N.D.	0.026						
21B	N.D.	N.D.	0.042						
23A	N.D.	430	330						
23B	N.D.	N.D.	0.22						
41A	N.D.	N.D.	6.2						
41B	N.D.	N.D.	0.71						
54	N.D.	N.D.	3100		38	I-132 23000	I-133 310		
56	N.D.	N.D.	3.4						
57	N.D.	N.D.	0.91	230					

Notes:

1. See **Figure 2** for the location of the discharge stacks and **Appendix B** for explanations of the different types of airborne discharges.
2. Any long-lived beta activity is assumed to be Strontium-90, although this nuclide is not a likely candidate.
3. Noble gases emitted from building 54 stack are short-lived radioactive isotopes of Xenon and Krypton from Tc-99 production. HIFAR emits mainly Argon-41 produced by the neutron activation of air inside the reactor irradiation facilities.
4. "N.D." indicates that the radioactivity was not detected.

TABLE 19d

AIRBORNE RADIOACTIVITY DISCHARGES FROM INDIVIDUAL DISCHARGE POINTS at LHSTC,
October – December 2000

STACK ⁽¹⁾	Alpha (kBq)	Beta ⁽²⁾ (kBq)	Iodine-131 (MBq)	Tritium (GBq)	Noble Gases ⁽³⁾ (TBq)	Other Nuclides (MBq)			
3	N.D. ⁽⁴⁾	N.D.	N.D.						
15A	N.D.	110	1.5	570	34	Hg-197 11.0	Hg-203 1.7	As-76 26.0	Br-82 2.2
15M	N.D.	N.D.	0.16	32	1.5				
19S	N.D.	N.D.	1.4						
19D	N.D.	N.D.	0.029						
20	N.D.	N.D.	0.21	11					
21A	N.D.	N.D.	N.D.						
21B	N.D.	N.D.	0.057						
23A	N.D.	170	310						
23B	N.D.	N.D.	0.11						
41A	N.D.	N.D.	0.77						
41B	N.D.	N.D.	0.18						
54	N.D.	N.D.	4400		40	I-132 22000	I-133 1300		
56	N.D.	N.D.	N.D.						
57	N.D.	N.D.	0.2	11					

Notes:

1. See **Figure 2** for the location of the discharge stacks and **Appendix B** for explanations of the different types of airborne discharges.
2. Any long-lived beta activity is assumed to be Strontium-90, although this nuclide is not a likely candidate.
3. Noble gases emitted from building 54 stack are short-lived radioactive isotopes of Xenon and Krypton from Tc-99 production. HIFAR emits mainly Argon-41 produced by the neutron activation of air inside the reactor irradiation facilities.
4. "N.D." indicates that the radioactivity was not detected.

TABLE 20
RADIOACTIVITY IN GROUNDWATER
FROM THE VICINITY OF BUILDING 27 ⁽¹⁾, 2000

Date Sampled	RADIOACTIVITY (Bq/L)	
	Gamma-emitters ^(2,3)	Tritium ⁽⁴⁾
27-1-00	N.D.	280 ± 20
28-2-00	N.D.	410 ± 10
30-3-00	N.D.	340 ± 10
1-5-00	N.D.	370 ± 10
26-5-00	N.D.	370 ± 10
5-7-00	N.D.	290 ± 20
18-7-00	N.D.	360 ± 20
21-8-00	N.D.	440 ± 10
20-9-00	N.D.	480 ± 30
25-10-00	N.D.	360 ± 10
28-11-00	N.D.	360 ± 10
21-12-00	N.D.	390 ± 20

Notes:

1. See Figure 2 for the location of the groundwater sump near building 27. Building 27 houses the intermediate waste and spent fuel storage facility.
2. Gamma spectrometry was performed on a 500mL acidified sample in a Marinelli beaker.
3. N.D:- no significant gamma peaks were detected.
4. The average of tritium levels recorded in the groundwater for 2000 was 370 Bq/L. This is < 5% of the WHO reference concentration for tritium in drinking water (7800 Bq/L).

TABLE 21

RADIOACTIVITY IN LIQUID EFFLUENT DISCHARGED FROM LHSTC
TO THE SYDNEY WATER SEWER, 2000

MONTH	TOTAL VOLUME Discharged m ³	AVERAGE CONCENTRATION IN DISCHARGES			Average MONTHLY Concentration QUOTIENT ⁽³⁾
		ALPHA ⁽¹⁾ Bq/m ³	BETA ⁽²⁾ Bq/m ³	TRITIUM Bq/m ³	
January	6868	$< 6.5 \times 10^2$	3.37×10^3	2.10×10^6	< 0.09
February	5336	$< 6.4 \times 10^2$	5.48×10^3	1.58×10^7	< 0.18
March	10201	$< 6.4 \times 10^2$	6.06×10^3	9.94×10^6	< 0.15
April	5718	$< 7.5 \times 10^2$	1.02×10^4	7.86×10^6	< 0.18
May	6216	$< 9.6 \times 10^2$	2.49×10^4	6.56×10^7	< 0.61
June	6083	$< 9.6 \times 10^2$	3.96×10^4	2.42×10^7	< 0.52
July	6791	$< 1.0 \times 10^3$	1.25×10^4	7.05×10^7	< 0.54
August	6181	$< 8.6 \times 10^2$	1.28×10^4	1.90×10^7	< 0.27
September	7209	$< 1.1 \times 10^3$	3.03×10^4	3.63×10^7	< 0.52
October	7120	$< 1.2 \times 10^3$	6.96×10^3	4.42×10^6	< 0.17
November	6001	$< 1.1 \times 10^3$	4.43×10^3	2.19×10^6	< 0.14
December	7075	$< 1.0 \times 10^3$	6.57×10^3	3.59×10^6	< 0.15
Average	6733	$< 9.0 \times 10^2$	1.35×10^4	2.18×10^7	< 0.29
Activity Concentration Equivalent at ANSTO ⁽⁴⁾		1.25×10^4 (as ²²⁶ Ra)	1.25×10^5 (as ⁹⁰ Sr)	1.95×10^8	1.00

Notes:

1. A mixture of unidentified alpha-emitting nuclides, assumed to be all radium-226 (ie. the worst possible case) when calculating the concentration quotient.
2. A mixture of unidentified beta-emitting nuclides, assumed to be all strontium-90 (ie. the worst possible case) when calculating the concentration quotient.
3. Concentration Quotient: the sum of the average monthly concentrations of alpha, beta and tritium radioactivity in the liquid effluent divided by the Activity Concentration Equivalent for that radionuclide. The final quotient term must be no greater than one to comply with the requirements of the Sydney Water Trade Waste Service Agreement.
4. All discharges for 2000 were below the Activity Concentration Equivalents at ANSTO (which are based on the WHO Guidelines for Drinking-Water Quality).

TABLE 22
NON-RADIOACTIVE COMPONENT OF LIQUID EFFLUENT
DISCHARGED FROM LHSTC TO THE SYDNEY WATER SEWER,
1997 – 2000

Component mg/L	YEARLY AVERAGE ⁽¹⁾				Standard for Acceptance mg/L ⁽²⁾
	1997	1998	1999	2000	
Suspended Solids	22	22	19	19	200
pH	7.3	7.6	7.3	7.3	7 – 10
Ammonia	16.0	10.7	10	6.7	50
B.O.D.	23	12	14	7	85 ⁽³⁾
Grease	13	12	7	5	50
Chromium ⁽⁴⁾	1.4	1.2	0.8	0.01	3
Zinc	-	-	-	0.39	5

Notes:

1. Yearly averages are slightly overestimated since "less-than" values were included.
2. Of the samples analysed, 95% must be less than or equal to the Standards for Acceptance of Liquid Trade Wastes to Sewers, specified in the Sydney Water Trade Waste Policy and Management Plan (1995).
3. The standards for acceptance do not stipulate a specific limit for biological oxygen demand (BOD), therefore the agreed limit is applicable in this case.
4. Chromium was removed from the effluent analysis schedule in May 2000 and replaced by zinc.

TABLE 23a

AIRBORNE EMISSIONS OF IODINE-123 FROM THE
NATIONAL MEDICAL CYCLOTRON, 2000

Month	Total ¹²³ I Emission ⁽¹⁾ (GBq/month)	Average ¹²³ I Concentration (Bq/m ³)
January	0.27	9.3
February	1.19	44.1
March	0.90	31.2
April	0.23	8.2
May	1.25	43.4
June	2.81	100.4
July	1.22	42.4
August	0.22	7.8
September	2.84	101.7
October	0.78	26.9
November	0.69	24.8
December	0.80	27.8
NSW EPA Limits	N/A ⁽²⁾	1000

Notes:

1. Iodine-123 has a half-life of 13.1 hours.
2. N/A:- not applicable since the limit is based on concentration not total emission.

TABLE 23b

AVERAGE CONCENTRATION OF RADIONUCLIDES IN LIQUID EFFLUENT FROM THE
NATIONAL MEDICAL CYCLOTRON, 2000

Month	Monthly Average Concentration in Liquid Effluent (MBq/m ³)					
	²⁰¹ Tl	²⁰² Tl	⁶⁷ Ga	⁵⁷ Co	⁶⁵ Zn	¹²³ I
January	0.63	0.82	2.56	25.82	2.03	N.D.
February	N.D.	0.06	0.08	6.73	0.44	N.D.
March	N.D.	0.01	0.02	1.74	1.80	N.D.
April	0.06	0.01	N.D.	0.51	0.55	N.D.
May	1.30	0.22	0.49	3.88	1.30	N.D.
June	0.80	0.18	0.08	0.82	0.36	N.D.
July	N.D.	0.07	0.10	1.13	1.36	N.D.
August	N.D.	0.02	0.12	0.07	0.02	N.D.
September	0.38	0.07	0.80	0.30	0.09	N.D.
October	0.21	0.09	0.03	0.08	0.03	N.D.
November	1.87	0.44	0.34	0.20	0.16	0.01
December	0.09	0.04	0.13	0.12	0.03	0.02
NSW EPA Limits	200	100	600	400	1008	6.00
Half-life (days)	3.0	12.2	3.3	270.9	244.4	0.54

TABLE 24

ESTIMATED EFFECTIVE DOSES FROM LHSTC AIRBORNE DISCHARGES, 2000

Receptor Location	Percent of site dose constraint ⁽¹⁾	Percent of annual public dose limit ⁽²⁾	2000 Estimated Effective Dose mSv/yr
Nearest resident	0.46	0.14	0.0014
LHSTC Library	0.64	0.19	0.0019
LHSTC Building 9	1.16	0.35	0.0035
LHSTC Main gate	0.42	0.13	0.0013
Stevens Hall Motel	1.22	0.37	0.0037
LH Waste Service (tip)	0.30	0.09	0.0009
BMX track	0.14	0.04	0.0004
Woronora Valley	0.13	0.04	0.0004
At 1.6 kilometre radius from HIFAR			
NORTH	1.09	0.33	0.0033
NNE	0.66	0.20	0.0020
NE	0.70	0.21	0.0021
ENE	0.67	0.20	0.0020
EAST	0.51	0.15	0.0015
ESE	0.31	0.09	0.0009
SE	0.34	0.10	0.0010
SSE	0.38	0.12	0.0012
SOUTH	0.26	0.08	0.0008
SSW	0.25	0.07	0.0007
SW	0.51	0.15	0.0015
WSW	0.41	0.12	0.0012
WEST	0.18	0.05	0.0005
WNW	0.16	0.05	0.0005
NW	0.34	0.10	0.0010
NNW	0.56	0.17	0.0017
At 4.8 kilometre radius from HIFAR			
NORTH	0.25	0.07	0.0007
NNE	0.15	0.04	0.0004
NE	0.17	0.05	0.0005
ENE	0.15	0.05	0.0005
EAST	0.11	0.03	0.0003
ESE	0.06	0.02	0.0002
SE	0.07	0.02	0.0002
SSE	0.08	0.02	0.0002
SOUTH	0.06	0.02	0.0002
SSW	0.05	0.02	0.0002
SW	0.11	0.03	0.0003
WSW	0.09	0.03	0.0003
WEST	0.04	0.01	0.0001
WNW	0.03	0.01	0.0001
NW	0.07	0.02	0.0002
NNW	0.12	0.04	0.0004

Notes:

1. The site dose constraint is 0.3 mSv/year.
2. The NH&MRC annual dose limit for members of the public is 1 mSv/year.

TABLE 25

ANNUAL EFFECTIVE DOSES TO ADULTS
FROM NATURAL SOURCES ⁽¹⁾

Source of exposure	Annual effective dose (mSv)	
	Typical ⁽²⁾	Elevated ⁽³⁾
Cosmic rays	0.39	2.0
Terrestrial gamma rays	0.46	4.3
Radionuclides in the body (except radon)	0.23	0.6
Radon and its decay products	1.3	10
Total (rounded)	2.4	-

Notes:

1. Table taken from UNSCEAR (1993) Table 1, page 18.
2. "Typical" values are from areas of normal background.
3. "Elevated" values are from areas of higher exposure and are representative of large regions. Even higher values occur locally.

APPENDIX A: PREVIOUS ENVIRONMENTAL SURVEY REPORTS

- Giles, M.S., Stockdale, J.A., (1966). *The Lucas Heights Environmental Sampling Programme*. AAEC/TM336.
- Giles, M.S., Stockdale, J.A., (1966). *Results of the Lucas Heights Biological Survey, December 1959 to December 1964*. AAEC/E-151 Supplement No.1.
- Cook, J.E., Dudaitis, A., Giles, M.S., (1969). *Environmental survey at AAEC Research Lucas Heights. Results for 1965, 1966 and 1967*. AAEC/E-151, Supplement No.1.
- Cook, J.E., Dudaitis, A., (1970). *Environmental Survey at the AAEC Research Establishment, Lucas Heights. Results for 1968*. AAEC/E-151, Supplement No.2.
- Cook, J.E., Dudaitis, A., (1970). *Environmental Survey at the AAEC Research Establishment, Lucas Heights. Results for 1969*. AAEC/E-151, Supplement No.3.
- Conway, N.F., Dudaitis, A. (1972). *Environmental Survey at the AAEC Research Establishment, Lucas Heights. Results for the Period January-July 1970*. AAEC/E-246.
- Dudaitis, A., (1973). *Environmental Survey at the AAEC Research Establishment, Lucas Heights. Results for the Period August 1970 to December 1971*. AAEC/E-271.
- Dudaitis, A., (1974). *Environmental Survey at the AAEC Research Establishment, Lucas Heights. Results for 1972*. AAEC/E-301.
- Davy, D.R., Dudaitis, A., (1974). *Environmental Survey at the Research Establishment, Lucas Heights. Results for 1973*. AAEC/E-335.
- Davy, D.R., Dudaitis, A., (1976). *Environmental Survey at the Research Establishment, Lucas Heights. Results for 1974*. AAEC/E-375.
- Hespe, E.D., (1979). *Environmental Survey at the AAEC Research Establishment, Lucas Heights. Results for 1975, 1976 and 1977*. AAEC/E-467.
- Hespe, E.D., (1979). *Results of the 1978 Environmental Survey at the AAEC Research Establishment, Lucas Heights*. AAEC/E-494.
- Giles, M.S., Dudaitis, A., (1980). *Environmental Survey at the Research Establishment, Lucas Heights. Results for 1979*. AAEC/E-508.
- Giles, M.S., Dudaitis, A., (1982). *Environmental Survey at the Research Establishment, Lucas Heights. Results for 1980*. AAEC/E-542.
- Williams, A.R., Dudaitis, A., (1983). *Environmental Survey at the Research Establishment, Lucas Heights, 1981*. AAEC/E-563.
- Giles, M.S., Dudaitis, A., (1984). *Environmental Survey at the Research Establishment, Lucas Heights, 1982*. AAEC/E-591.
- Giles, M.S., Dudaitis, A., (1985). *Environmental Survey at the Research Establishment, Lucas Heights, 1983*. AAEC/E-622.
- Giles, M.S., Dudaitis, A., (1986). *Environmental Survey at the Research Establishment, Lucas Heights, 1984*. AAEC/E-638.
- Giles, M.S., Foy, J.J., Hoffmann, E.L., (1988). *Environmental Survey at the Research Establishment, Lucas Heights, 1985*. AAEC/E-677.
- Giles, M.S., Foy, J.J., Hoffmann, E.L., (1989). *Environmental Survey at Lucas Heights Research Laboratories, 1986*. ANSTO/E-687.

- Giles, M.S., Foy, J.J., Hoffmann, E.L., (1989). *Environmental Survey at Lucas Heights Research Laboratories, 1987*. ANSTO/E-688.
- Giles, M.S., Foy, J.J., Hoffmann, E.L., (1990). *Environmental Survey at Lucas Heights Research Laboratories, 1988*. ANSTO/E-689.
- Hoffmann, E.L., Arthur, A., (1990). *Environmental Survey at Lucas Heights Research Laboratories, 1989*. ANSTO/E-694.
- Hoffmann, E.L., (1991). *Environmental Survey at Lucas Heights Research Laboratories, 1990*. ANSTO/E-704.
- Hoffmann, E.L., Loosz, T., (1994). *Environmental Survey at Lucas Heights Research Laboratories, 1991*. ANSTO/E-708.
- Hoffmann, E.L., Loosz, T., (1994). *Environmental Survey at Lucas Heights Research Laboratories, 1992*. ANSTO/E-709.
- Hoffmann, E.L., Loosz, T., (1995). *Environmental Survey at Lucas Heights Research Laboratories, 1993*. ANSTO/E-716.
- Hoffmann, E.L., Camilleri, A., Loosz, T., Farrar, Y., (1995). *Environmental and Effluent Monitoring at Lucas Heights Research Laboratories, 1994*. ANSTO/E-717.
- Hoffmann, E.L., Loosz, T., Farrar, Y., (1996). *Environmental and Effluent Monitoring at Lucas Heights Science & Technology Centre, 1995*. ANSTO/E-725.
- Hoffmann, E.L., Loosz, T., Farrar, Y., (1997). *Environmental and Effluent Monitoring at Lucas Heights Science & Technology Centre, 1996*. ANSTO/E-730.
- Hoffmann, E.L., Loosz, T., Farrar, Y., (1998). *Environmental and Effluent Monitoring at Lucas Heights Science & Technology Centre, 1997*. ANSTO/E-732.
- Hoffmann, E.L., Loosz, T., Farrar, Y., Mohkber-Shahin, L., (1999). *Environmental and Effluent Monitoring at Lucas Heights Science & Technology Centre, 1998*. ANSTO/E-737.
- Hoffmann, E.L., Loosz, T., Mohkber-Shahin, L., (2000). *Environmental and Effluent Monitoring at ANSTO Sites, 1999*. ANSTO/E-740.

APPENDIX B: STACK DISCHARGES OF RADIOACTIVITY AT LUCAS HEIGHTS

RADIONUCLIDE	HALF-LIFE	STACK	RELEASE FORM
IODINE-131	8 DAYS	ALL	VAPOUR
All stacks are continuously sampled for iodine-131, even though only a few are routinely releasing it. This is partly because of the importance of iodine in any accidental release of mixed fission products and partly because it has sometimes been used in tracer experiments, so small amounts might occasionally appear in any stack effluent.			
STRONTIUM-90	29 YEARS	ALL	PARTICULATE
The same sampler that measures the iodine release discharges, also measures the particulate activity, both alpha and beta. The filter paper which traps the airborne particles is counted the day after its removal from the stack and again after a delay of 4 weeks to allow the short-lived alpha and beta activity to decay. Any long-lived beta activity on the filters is assumed to be strontium-90 as a worst case, however this nuclide is not a likely candidate. Note that all the exhaust gases have passed through high efficiency particulate air filters which are 99.97% effective for particle sizes > 0.3 microns.			
ARGON-41	1.8 HOURS	HIFAR	GAS
Air is used to cool some of the irradiation rigs in HIFAR. The naturally occurring argon-40 in air becomes activated in passing through the reactor by the absorption of a neutron to form radioactive argon-41, which decays to stable potassium-41. The argon-41 does not deposit on any surface or react with any known substance, since it is a noble gas. It is a beta-gamma emitter, which is easy to detect electronically and by film badges.			
TRITIUM	12 YEARS	HIFAR	WATER VAPOUR
The primary coolant and neutron moderator in HIFAR is "heavy water" or deuterium oxide. Deuterium is a naturally occurring isotope of hydrogen with an additional neutron over the common isotope of hydrogen. In the reactor, a few of the deuterium atoms capture another neutron, to form tritium, which is slightly radioactive. The tritiated water vapour is released by evaporation from equipment wet with coolant, when it is removed from the reactor. If a person was exposed to tritiated water vapour, some of the tritium could enter the body fluids by diffusion through the lungs and skin. However, the rate of turnover of water in the body is so high, that the effective or biological half-life is only about 12 days.			
OTHER ACTIVITY:			
MERCURY-197	64 HOURS	HIFAR	VAPOUR
MERCURY-203	46 DAYS		
ARSENIC-76	26 HOURS		
Slight traces of mercury and arsenic vapour in the air within the HIFAR containment are activated in passing through the HIFAR reactor. The mercury probably comes from a thermometer dropped at some time in the containment building. The arsenic vapour is being slowly emitted from wood, treated with preservative, which was used when renewing the thermal cladding of the containment building.			

RADIONUCLIDE	HALF-LIFE	STACK	RELEASE FORM
TRITIUM	12 YEARS	BLD 20	WATER VAPOUR
Bld 20 is the decontamination centre and occasionally handles coolant pumps removed from the reactor for maintenance.			
TRITIUM	12 YEARS	BLD 57	WATER VAPOUR
Bld 57 is where the spent resin beds, used to purify the HIFAR coolant water, are regenerated or replaced. Most of the tritiated water on the resin beds is trapped before the drying gas is discharged to the stack.			
NOBLE GASES:			
XENON-133	5.3 DAYS	BLD 54	GAS
XENON-135	9.1 HOURS		
XENON-135M	15 MINS		
KRYPTON-87	76 MINS		
KRYPTON-85M	4.5 HOURS		
KRYPTON-88	2.8 HOURS		
These are all fission product noble gases. The radionuclide most often used as a diagnostic tracer in nuclear medicine is technetium-99m, extracted from fresh fission products. Small uranium targets are irradiated in HIFAR for a few days before they are dissolved in nitric acid in a fully enclosed apparatus in one of the heavily shielded "Hot Cells" in Bld 54. The noble gases that are released during dissolution are delayed on a large charcoal bed in the next cell. When the targets are completely dissolved the charcoal bed is isolated and the noble gases are allowed to decay. However, additional noble gases are formed in the nitric acid solution, from radioactive gases released from the apparatus as the liquid is manipulated into different parts of the equipment by means of vacuum lines. The exhaust gases from the vacuum lines pass through small charcoal beds to trap most of the iodine-131. About 90% of the noble gases are delayed during dissolution leaving only 10% to be released during processing.			
IODINE-131	8 DAYS	BLD 54	ORGANIC IODINE VAPOUR
Iodine-131 is also released during technetium-99m extraction from fresh fission products. Iodine is very volatile even at room temperature and about 3% escapes from the enclosed apparatus, despite efforts to contain it. To prevent this quantity of iodine being released to the atmosphere, the exhaust from the hot cells passes through sixteen beds filled with a specially impregnated charcoal, which was developed in England to trap all forms of airborne iodine, even at high humidity. The beds are tested regularly and are replaced as necessary. The most penetrating form of airborne radio-iodine has been found to be the vapour of an organic compound, methyl iodide, formed when the extremely dilute radioactive iodine reacts with traces of organic vapours.			
IODINE-131	8 DAYS	BLD 23	VAPOUR
Iodine-131 is an important medical isotope in its own right, being used in the treatment of thyroid cancer. It is produced by the irradiation of a tellurium target in HIFAR, before being processed in a small shielded hot cell in Bld 23. The exhaust from the group of cells passes through three charcoal beds similar to the ones in Bld 54.			

APPENDIX C: SYMBOLS AND PREFIXES

Symbol	Name	Half-life
α	alpha	
β	beta	
γ	gamma	
²⁴¹ Am	americium-241	432.2 years
⁷ Be	beryllium-7	53 days
¹⁴⁴ Ce	cerium-144	284.9 days
¹³⁴ Cs	caesium-134	2.06 years
¹³⁷ Cs	caesium-137	30.14 years
⁵¹ Cr	chromium-51	27.7 days
⁵⁷ Co	cobalt-57	271.8 days
⁶⁰ Co	cobalt-60	5.3 years
⁶⁷ Ga	gallium-67	3.3 days
³ H	tritium	12.3 years
¹²³ I	iodine-123	13.2 hours
¹³¹ I	iodine-131	8.02 days
¹³² I	iodine-132	2.3 hours
¹³³ I	iodine-133	20.8 hours
K	stable potassium	
⁴⁰ K	potassium-40	1.3×10^9 years
²⁴⁰ Pu	plutonium-240	6.56×10^3 years
⁹⁰ Sr	strontium-90	28.6 years
²⁰¹ Tl	thallium-201	3.04 days
²⁰² Tl	thallium-202	12.23 days
²³² Th	thorium-232	1.4×10^{10} years
²³⁸ U	uranium-238	4.5×10^9 years
⁶⁵ Zn	zinc-65	244.1 days

SI UNITS

Quantity	SI Unit and Abbreviation
Absorbed Dose	Gray (Gy)
Dose Equivalent	Sievert (Sv)
Radioactivity	Becquerel (Bq)

MULTIPLES AND SUBMULTIPLES OF SI UNITS

10^3 kilo (k)	10^{-3} milli (m)
10^6 mega (M)	10^{-6} micro (μ)
10^9 giga (G)	10^{-9} nano (n)
10^{12} tera (T)	10^{-12} pico (p)

APPENDIX D: ENVIRONMENTAL SAMPLE COLLECTION AND ANALYTICAL PROCEDURES

SAMPLE COLLECTION

Potter Point Biological Samples

As part of the environmental monitoring program at Potter Point ocean outfall, samples of fish (*Girella* sp., commonly called 'Blackfish'), macrophytic green algae (*Enteromorpha intestinalis*) and surf barnacles (*Tessieroperla rosea*) were collected.

Fish were caught off the rocks at Potter Point using a fishing line baited with weed, while the green algae and barnacles were scraped off the rocks. Fish were filleted and scaled, the algae and barnacles were left whole. None of the samples were washed. All samples were oven-dried at 70 °C. Dried samples were powdered using a ring grinder, then weighed into plastic petri dishes for gamma counting.

Soils and Sediments

Soils were sampled to a depth of 4 cm until approximately 1 kg was collected. Samples were oven-dried overnight at 100 °C, then passed through a coarse sieve to remove large stones and organic matter. Once the dry weight was recorded, the sample was ignited at 450 °C in a muffle furnace, cooled and re-weighed. The whole, ashed sample was sub-sampled for gamma spectrometry and gross beta counting. The remainder of the ashed sample was sieved to yield a fraction with particle sizes ranging from 125 to 250 microns for the gross alpha analysis.

Sediment samples from creek beds and stormwater bunds were prepared and counted in the same manner as soils.

Waters

All water samples were collected in polyethylene bottles. Samples were acidified to a pH less than 2 using nitric acid, except those for tritium analysis which were analysed as soon as possible after arrival in the laboratory (usually the same day).

Groundwater

Groundwater from bores at Little Forest Burial Ground was collected by first pumping out the contents of each bore, then allowing all the bores to recharge with fresh groundwater over a period of at least two days. The samples were then collected by pumping water from the centre of each bore into a sample bottle, using a petrol-fuelled pump. The sampling method was modified in December 1996 to reduce disturbance of sediment in the bores, consequently the sediment loading of the samples has decreased.

Air Samples: Ambient iodine-131

Four (4) continuous air sampling stations are situated along the eastern fence boundary of the site (where suburban residences are closest) in order to monitor concentrations of iodine-131 in air. The locations of these samplers are shown on Figure 2.

At each station the air is sampled by means of a vacuum pump drawing air through a pair of Maypacks (activated charcoal filter cartridges), so that duplicate samples are available. Air is sampled at a rate of approximately 35 m³ per day.

Filters are replaced and analysed weekly, with air flow rates through the filters being checked at the same time.

Airborne Particulates - LFBG

An Ecotech portable high-volume air sampler is mounted on a trailer with a petrol powered generator and is deployed in the centre of the trench area for about 4 hours, every two weeks.

The air sampling flow rate is set at 60 m³ per hour and the airborne particulates are progressively accumulated over a period of three months on cellulose fibre filter papers. The amount of air sample collected in this manner is approximately 1440 m³ per quarter.

The particulate sampling method used at the LFBG is conservative, since a size-selective inlet is not used and larger particles in excess of respirable size may also be collected. The particles collected at LFBG would be up to about 50 microns equivalent aerodynamic diameter (EAD). Particles below 10 microns EAD are respirable and hence considered a potential health hazard. Such particulate matter is generated by industrial processes, combustion of fuels, burning of vegetation and incineration. These particles are also present in motor vehicle emissions, wind blown dust and salt air (Standards Association of Australia).

Activities at the nearby clay/shale quarries and Lucas Heights Waste Management Centre may occasionally generate airborne dust which could impact on the sampling of particulates at LFBG.

The exposed filters (measuring 175 x 225 mm) are divided into four equal portions: two are used for stable beryllium and plutonium analyses; the remaining two are stored. A beryllium analyses is carried out for every sampling period (3 months). One of the filter portions is digested using Method 3050 of the US Environment Protection Authority and analysed with an Inductively Coupled Plasma Mass Spectrometer (Method 3120B of the American Public Health Authority). The analyses are performed by the ANSTO Environment Division chemistry group.

To maximise the probability of detecting any plutonium, an annual composite sample is used for the alpha spectrometry analysis, which is performed by ANSTO's Environment Division Radiochemistry Laboratory. The annual composite contains 25% of each filter sample collected during the year.

Environmental Radiation - ARPANSA dosimeters

External radiation levels at the perimeter of LHSTC and in some surrounding suburban areas were measured using thermoluminescent dosimeters (TLD) issued by the ARPANSA. These dosimeters consist of calcium sulphate thermoluminescent material with three filtered areas and an open window.

ANSTO also used environmental dosimeters from Bicron NE Technology model Harshaw 6600, which contain lithium fluoride and calcium fluoride thermoluminescent materials with energy compensation filters. They were analysed at ANSTO using an automatic reader. Results agreed well with those of the ARPANSA TLD.

Measurements were made over four consecutive exposure periods of approximately three months duration, and the ARPANSA-issued TLD badges were sent back to ARPANSA to be analysed. The results were normalised to exposure rates per day to allow for differences in the length of monitoring periods, and calculated in terms of annual absorbed dose to air in milligrays (mGy). For this report the readings were then converted to effective dose (mSv) using a conservative conversion factor of 1. The uncertainty for the annual dose is the 95% confidence level estimated from the standard deviation of the results for several dosimeters placed at the same locations.

ANALYSIS METHODS

Environmental Radiochemistry Laboratory

Australian or International Standard methods for radiological analyses are used, where they are available. Methods for gamma spectrometry, gross alpha, gross beta and tritium analyses of waters are documented and incorporate techniques based on those used by ARPANSA.

Blanks and standards are either counted regularly or included with each batch of samples counted. Instruments and detectors are regularly calibrated against certified standard materials. During tritium, gross alpha and gross beta analyses, samples were counted up to five times. Long counting times (23 hours) were employed for low-level gamma spectrometry samples.

Results are reported with the appropriate number of significant figures. All data entries are double-checked before results are released.

Tritium in Waters

Water samples to be analysed for tritium were prepared by distillation according to the International Organization for Standardization (ISO) standard method 9698:1989(E). Aliquots of five millilitres (one millilitre in previous years) were taken from the distilled samples and combined with 11 mL of Packard *Starscint* scintillant cocktail in polyethylene counting vials.

The samples were counted in a Packard Tri-carb Liquid Scintillation Analyser, model 2700TR. The first counts are discarded in order to allow the samples several hours to equilibrate in the dark. Three tritium standards (prepared monthly using a certified Amersham tritium solution) and a distilled water blank were counted with the samples, to check the operation and background radioactivity of the counter.

A series of quenched standards were counted to determine the relationship between the spectral index of the external standard and the counting efficiency. Sample activity was corrected for chemical quenching. Total counting time was 100 minutes per vial, comprising five 20-minute counts. Results were calculated in terms of Bq/litre along with a minimum detectable activity (at 95% confidence level).

Gross Alpha/Beta Activity in Soils

Soils/sediments were counted for gross beta activity in a Geiger-Mueller tube with a 25mm diameter end-window. Alpha counting of these samples was done on a fraction with a grain size of 125 to 250 microns, in an AERE type alpha-drawer assembly (a zinc sulphide scintillator screen monitored by a photomultiplier tube). Beta and alpha activities were assumed to have energies similar to potassium-40

and natural uranium respectively. Analytical grade potassium chloride was used to standardise the detector for beta activity because of its natural potassium-40 content. Sand, coated with uranyl nitrate and of the same particle size as the sample, was used to standardise the alpha detector.

Gross Alpha/Beta Activity in Waters - changeover to ISO methods

Most water samples were screened for gross alpha/beta activities to determine whether further tests for individual radionuclides were necessary. All of the water samples for 1999 were analysed using ISO methods 9696 & 9697(1992).

Prior to 1997, gross alpha/beta analyses of waters were performed using either the Standards Association of Australia method AS 3550.5(1990) or the AAEC/ANSTO tablet method. These methods are described, together with their advantages and disadvantages, in Appendix D of report ANSTO/E-730 (1997).

ISO 9696 & 9697 (1992) - Planchette Thick Source Methods

In this method, the water sample is acidified, evaporated almost to dryness, converted to the sulphate form by addition of excess sulphuric acid and then ignited at 350 °C. A portion of the ignited residue is transferred and fixed to a stainless steel counting planchette. As alpha particles are absorbed by matter, it is necessary to optimise the thickness of the source to enable the maximum amount of sample to be counted with a minimum of absorption. The amount of sample residue dispensed onto the planchette was standardised at 100 mg.

Standard sources of 100 mg thickness were used to calibrate the Canberra 2400 thin-window gas-flow proportional alpha/beta counting system. Standard sources of 100 mg mass were prepared as described in the relevant ISO method, using calcium sulphate spiked with americium-241 for alpha activity and potassium sulphate for beta activity (due to the natural potassium-40 content).

ARPANSA gel method for preparation of gamma sources

Water samples that were concentrated before analysis via gamma spectrometry were prepared by the following method. Sample volumes ranging from two to twelve litres were evaporated on a hotplate to about 150 mL. The pH of the cooled solution was adjusted to 3-4 with the addition of 10 molar sodium hydroxide. The sample was further evaporated down to about 50 mL, quantitatively transferred to a 65 mm petri dish, mixed with about 2 grams of agar and allowed to set. The lid was sealed with silicone glass sealant and the sample counted for gamma-emitters. This method was adapted (by permission) from a technique used at the ARPANSA laboratories in Melbourne. Results are expressed in Bq/litre. The building 27 Sump sample was not concentrated prior to counting, this allows for a more rapid determination.

Gamma Spectrometry - waters, soil, vegetation, fish, algae, barnacles & Maypacks

Gamma spectra are obtained by placing prepared samples onto a high-purity germanium (HPGe) low-background detector, and acquiring counts over a 23-hour period. A multi-channel analyser sorts the spectra according to the energy of the gamma photons. Peak areas in the sample spectra are calculated using an Ortec software package, Maestro II. Background spectra are acquired with no sample present to determine the radioactivity due to the environment and detector components, as distinct from the sample activity. Peaks at certain energies in the spectrum are used to identify the isotope and the amount present in the sample. A

spectrum report is printed for each sample, showing the sample description, the peaks identified, gross and net areas of the peaks and associated counting errors.

The gamma detector energy spectrum is calibrated periodically using certified point sources. The counting efficiency of the detector is determined over a range of energies using several gamma sources, prepared from IAEA reference materials. These standard reference materials have a similar matrix to the types of samples usually encountered and are prepared in the same geometry. Background spectra are acquired with no sample present and are counted for the same length of time as the samples.

Prepared samples for gamma spectrometry are presented in a uniform geometry, ie packed into petri dishes of 65mm diameter. The types of samples counted are mainly concentrated water samples set in agar gel, ashed vegetation or biota; dried/ashed sediments or powdered material.

Marinelli beakers are also used for direct counting of unconcentrated liquid samples. They are plastic containers, which fit over and around the detector and contain 500 mL of sample. Calibration of the detector efficiency is done using a Marinelli beaker filled with standard solution containing gamma-emitting radionuclides.

Potassium-40 beta activity

In many cases, the beta activity of a sample is almost entirely due to the natural potassium-40 contribution. In calculating the net beta activity of soils or waters, the activity due to natural potassium-40 may be subtracted. The potassium-40 activity can be calculated in two ways: either by direct calculation from the 1460 keV peak in the gamma spectrum of the sample, or by chemical analysis of the sample's potassium content and a subsequent calculation of the potassium-40 activity. The latter method is more accurate. The specific activity of potassium is 27.6 Bq of potassium-40 per gram of stable potassium (NH&MRC/AWRC, 1996).

Air samples - Ambient Iodine-131

One set of Maypacks are set aside each week in case random independent checking is required by officers of the ARPANSA. The other set is analysed at ANSTO, by placing the four cartridges simultaneously under a large (8 x 4 inch) sodium-iodide gamma detector and counting for 5 hours. If an iodine-131 peak is detected then the filters are analysed individually using a high-purity germanium gamma detector to determine which filters contain the activity.

Results are reported in units of iodine-131 activity per volume of air sampled (Bq/m^3). The results are calculated in an extremely conservative manner, using the following assumptions:

- all the activity was released on the first day of the seven-day sampling period, ie any iodine-131 results are corrected for decay (due to the 8 day half-life) back to the first day of the sampling period; and
- all the measured activity was released at one point (there are actually four locations being measured).

COUNTING STATISTICS

Most of the results from the environmental monitoring program were reported using the principles of counting decision levels endorsed by Gilmore & Hemingway in Practical Gamma-ray Spectrometry (1995), Chapter 5, Section 5.6, pages 119-124, for determining the statistical significance of a sample count based on the uncertainties of the background.

After a sample has been "counted" or measured for radioactivity, it is important to determine whether or not the level of activity is statistically significant. Since a sample count (or peak area in the case of gamma spectrometry) becomes non-significant by being 'lost' in the background, the uncertainties in the background counts must be taken into account.

Gilmore & Hemingway have established the definitions of statistically determined decision levels in terms of the following questions:

- Critical limit (L_C) - 'Is the net count significantly above the background?'
- Upper Limit (L_U) - 'Given that this count is not significant, what is the maximum statistically justifiable count which could be attributed to the radionuclide of interest?'
- Minimum Detectable Activity (MDA) - 'What is the least amount of activity measurable?'

In practice, these decision limits are applied as follows:

- i) The sample (C) and background (B) counts (or peak areas in gamma spectrometry) were examined, and the net counts (N) calculated: $N = C - B$.
- ii) The critical limit (L_C) is defined as the count at which there is only a 5 per cent probability that a radionuclide would be judged to be present in a sample when in reality it was not. L_C is calculated from the formula $2.33(B)^{1/2}$ (equation 5.54, page 120 of Gilmore and Hemingway), and compared with the net sample count or peak area. If the sample's net count (or peak area) is greater than L_C we can say that there is less than a 5 per cent probability that the observed peak was due to a random fluctuation in the background. This being so, the peak is attributed to the radionuclide and its activity concentration (together with the experimental uncertainty) is calculated.
- iii) If the sample's net count (or peak area) is less than L_C , there is deemed to be no statistical evidence for the radionuclide and an upper count limit, L_U is calculated (Gilmore and Hemingway, Section 5.6.2, page 121). The L_U value is the upper activity level of the radionuclide which yields a count rate which is embedded in (ie cannot be separated from) the background. This activity level is equated with the minimum detectable activity.

APPENDIX E: AIRBORNE EFFLUENT SAMPLE COLLECTION AND ANALYSIS

Sampling For Gases, Vapours and Particulates

The authorised airborne effluent discharges from LHSTC stacks are monitored weekly by ANSTO's Safety Division. For the gas, vapour and particulate emissions, filter cartridges called Maypacks are used. The Maypacks consist of an activated charcoal section to trap gases and vapours, and a particulate filter.

The sample holder containing the Maypack intrudes into the stack flow to be sampled. A vacuum pump is used to draw a proportion of the effluent airstream through the Maypack sampler. The flow-rate through the sample holder, and therefore the Maypack sampler, is controlled by a critical orifice in series with the sampler. The flow-rate is thus limited to 10 litres per minute. The sampling flow-rates are checked weekly using a calibrated flow meter, at the time when the Maypack filters are changed.

The stack flow rates are measured every three months using a 'hot wire anemometer', and whenever the ventilation system is altered in any way (ie new fans, change of filters, changes to ducting).

The Maypack is counted using a gamma spectrometer with a sodium-iodide detector in a shielded space. Both sides of the Maypack are counted, and the geometric mean of the two readings taken. The filter paper is cut off the Maypack and counted for alpha and beta emitting particulates. After initial analysis both components of the Maypacks are stored for four weeks when some of the particulate filters are measured again for gross alpha and beta activity. This is to confirm whether any particulate activity previously measured was principally due to short-lived radioisotopes.

Sampling for Tritiated Water

Tritiated water in the airborne effluent is sampled using a tritium trap. A proportion of the stack airstream is drawn through a series of four Dreschel bottles filled with 200 mL of demineralised water, thus trapping the tritiated water with an efficiency of about 99%. The flow rate is limited to 1 litre per minute by a Millipore critical orifice. The four samples are transferred to a litre flask, topped-up to 1 litre, then 1mL sub-samples taken for testing. A liquid scintillation counter is then used to measure the tritium level in the sample.

Sampling for Noble Gases

Noble gases are measured in situ by a gamma spectrometer. As the effluent passes through a 250 mL sampling flask at 4 litres per minute, a gamma spectrometer with a sodium iodide crystal (NaI) detector is used to count the noble gas activity.

APPENDIX F: ANSTO HEALTH, SAFETY AND ENVIRONMENT POLICY

 Policy Manual	Rev.: 2	APOL 2.1
	Date: 26 May 2000	Page: 1 of 1
	Title: ANSTO Health, Safety and Environment Policy	

Purpose
This policy provides the framework to manage ANSTO's activities with due regard for health, safety and the environment.

Policy Statement
ANSTO will undertake its activities in a manner that:

- Places the protection of human health and safety and the environment, as its highest priority;
- Promotes a positive safety culture and environmental awareness; and
- Strives for continual improvement in safe work practices and prevention of pollution.

Strategy
This policy shall be supported by management systems, which ensure ANSTO:

- Complies with relevant Commonwealth laws and regulations;
- Takes account of relevant NSW laws and regulations on health, safety and the environment;
- Takes account of relevant health, safety and environment standards, codes, guides and good practices;
- Operates in compliance with appropriate occupational health and safety principles;
- Uses radiation and radioactive sources and operates its facilities in compliance with appropriate radiation protection and nuclear safety principles;
- Sets and reviews safety and environmental objectives and targets appropriate to the organisation's activities, products and services;
- Ensures that doses are as low as reasonably achievable (ALARA), taking into account economic and social factors;
- Provides training to ensure staff understand and implement the policy; and
- Provides verifiable evidence of the fulfilment of this policy through a program of monitoring and audit, and regular public reporting of results.

ANSTO Safety Directives specify the arrangements of the Safety Management System.

Commitment
ANSTO, through appropriate management practices and the provision of adequate resources, is committed to:

- Ensuring that all its activities comply with the Safety Management System;
- The implementation of an ISO 14001 compliant Environmental Management System; and
- On-going staff, stakeholder and community dialogue on this policy and its implementation.

Responsibility and Authority

- All staff are responsible for undertaking their duties in compliance with this Policy and ANSTO's Safety Directives and procedures.
- Responsibility for the implementation of this policy rests with the Board, myself, the Division Directors and all other staff. Specific authorities relevant to this policy are set out in the Delegations Manual.

Approved:
Name:**Helen M Garnett**..... Date: 26 May, 2000.
Professor Helen M Garnett, Executive Director.

APPENDIX G: THE ANSTO QUALITY POLICY

 Policy Manual	Rev.: 2	APOL 1.1
	Date: 26/08/98	Page: 1 of 1
	Title: ANSTO Quality Policy	

Note: This is a web copy of a controlled document.

Purpose
This policy provides the framework to manage ANSTO's activities in accordance with quality principles.

Policy Statement
ANSTO will undertake its activities in a manner that:

- promotes a quality culture for planning and undertaking research and development, the provision of items and services and the reporting there on,
- is in accordance with national and international quality management standards,
- promotes a culture to achieve its activities in an efficient, effective, safe manner,
- promotes a culture to meet its environmental objectives, and
- meets, at a minimum, customer and stakeholder requirements.

Strategy
This policy will be supported by ANSTO procedures and directives which:

- are in accordance with Commonwealth legislation and policy,
- take account of NSW regulations applicable to ANSTO's processes and services,
- take account of AS/NZS ISO 9001: "Quality Systems – Model for quality assurance in design, development, production, installation and servicing", and
- take account of applicable international regulations and codes.
- training to ensure staff understand and implement the policy, and
- provision of necessary resources.

Commitment
ANSTO is committed to:

- achieving and demonstrating achievement of this policy through a program of:
- peer reviews of analysis of research and development data and ensuing papers and reports, and
- management system audits to assess conformance to defined requirements which includes the reporting of findings.
- on-going dialogue on this policy and its implementation with staff, customers and stakeholders.

Responsibility and Authority

- All staff are responsible for the ownership and undertaking of their functions in accordance with this Policy and for its implementation within the framework of ANSTO's procedures and directives.
- Division Directors have the responsibility and authority to implement the Policy and monitor its implementation in the everyday activities of their respective Divisions.
- Respective responsibility for the achievement of this policy rests with the Board, myself, the Division Directors and all staff.

Approved:
Name:Helen M Garnett..... Date: 26 / 08 / 1998
Professor Helen M Garnett Chief Executive

APPENDIX H: ERRATA

- An error occurs in *Appendix A* of the following reports:

ANSTO/E-708, published in 1994

ANSTO/E-709 published in 1994

ANSTO/E-716 published in 1995

ANSTO/E-717 published in 1995

ANSTO/E-725 published in 1996

ANSTO/E-730 published in 1997

ANSTO/E-732 published in 1998

ANSTO/E-737 published in 1999

ANSTO/E-740 published in 2000

An incorrect report number was cited for the following reference:

Dudaitis, A., (1974). *Environmental Survey at the AAEC Research Establishment, Lucas Heights. Results for 1972.*

The correct report number is AAEC/E-301.

- In the report *Environmental and Effluent Monitoring at ANSTO Sites 1999*, (ANSTO/E-740) page 84, *Table 24*, column three:

The effective dose for Stevens Hall Motel should read “0.010” not “0.0010”.

GLOSSARY OF TERMS

Absorbed dose: The energy imparted to matter by ionising radiation per unit mass of irradiated material at the place of interest. The unit of absorbed dose is joules per kilogram, called the gray (Gy). See radiation dose.

Activity (of a substance): The number of disintegrations per unit of time taking place in a radioactive material. The unit of activity is the becquerel (Bq), one disintegration per second.

Alpha particle: A positively charged particle emitted from the nucleus of an atom during radioactive decay. Consists of two protons and two neutrons, *ie* a helium-4 nucleus. Although alpha particles are normally highly energetic, they travel only a few centimetres in air and are stopped by a sheet of paper or outer layer of dead skin.

Alpha radiation: The emission of alpha particles when the nucleus of an atom is unstable and radioactive.

Background radiation: The ionising radiation in the environment to which we are all exposed. It comes from many sources - outer space, the sun, the rocks and soil under our feet, the buildings we live in, the air we breathe, the food we eat, and from our own bodies.

Becquerel (Bq): Unit of radioactivity, equal to one radioactive disintegration per second. This SI unit may be used instead of the curie (Ci):

1 curie = 3.7×10^{10} becquerels.

Beta particle (ray): A particle emitted from an atom during radioactive decay. Beta particles are either electrons with a negative charge or positrons with a positive electric charge. High-energy beta particles can travel metres in air and several millimetres into the human body. Low energy betas are unable to penetrate the skin. Most beta particles can be stopped by a small thickness of light material, eg aluminium or plastic sheeting.

Beta radioactivity: Radioactive transformation of a nuclide in which high energy electrons are emitted and the mass number remains unchanged, but the atomic number changes by 1 with the emission of a beta particle.

Biological half-life of an isotope: The time required for one-half of an absorbed radioisotope to be excreted from the body. Also called biological turnover.

Buffer zone: A 1.6 km boundary around ANSTO (measured radially from the HIFAR reactor) within which no residential development is allowed to occur.

Concentration factor (biological): the ratio of an element in an organism, to that of its environment or what is consumed, *ie*

Concentration in consumer organism ÷ Concentration in environment or food.

Critical orifice: A device which restricts air-flow through a sampling assembly to a constant rate, provided the required vacuum is applied.

Decay, radioactive: The disintegration of an atomic nucleus resulting in the release of alpha or beta particles, and/or gamma radiation.

Dilution ratio: The ratio of effluent concentration at release, to the maximum concentration at the destination.

Dose constraint : For public exposure, the dose constraint is the maximum annual dose that members of the public may be allowed to receive from the planned operation of any specific source of radioactivity. The exposure to which the dose constraint applies is the annual dose to any critical group summed over all exposure pathways arising from the predicted operation of the controlled source. The dose constraint for each source is intended to ensure that the sum of doses to the critical group from all controlled sources remains within the public dose limit.

Dose limits: The maximum radiation dose that a person may receive over a stated period of time. Internationally recommended limits adopted by Australia are that radiation workers should not accumulate more than 20 mSv per year. Members of the public should not receive more than 1 mSv per year (NH&MRC 1995).

Effective dose: A physical quantity used in the measurement of ionising radiation dose to humans, taking into account the harmfulness of different types of radiation and the susceptibility to harm of different organs of the body. The effective dose is the sum of weighted equivalent doses to all organs and tissues of the body, where the equivalent dose to each organ and tissue is multiplied by the weighting factor for that organ or tissue. The unit of effective dose is joules per kilogram, termed the sievert (Sv), or more commonly the millisievert (mSv) (one-thousandth of one sievert).

Electromagnetic radiation: Waves of energy that are caused by the acceleration of charged particles. Includes radio waves, infrared, visible light and ultraviolet radiation (all non-ionising radiation), and x-rays and gamma rays (ionising radiation).

Equivalent dose: A weighted radiation dose to an organ or tissue, which is the product of absorbed dose in the organ or tissue and the radiation weighting factor (determined by the type and energy of the radiation to which the organ or tissue is exposed). This measurement enables the dose received by exposed persons to be expressed on a scale common to all ionising radiation. The unit of equivalent dose is joules per kilogram, termed the sievert (Sv). Dose is most commonly expressed as millisieverts (mSv).

Fission: Usually, the division of a heavy nucleus into two similar but generally unequal masses, with the emission of neutrons, gamma radiation and a great deal of energy.

Fission product decay: The process by which radioactive atoms from fission become stable through the emission of radioactive particles.

Fission products: The atoms formed as a result of fission. Most fission products are very unstable, have short half-lives and are highly radioactive, emitting copious quantities of beta rays and gamma rays over a range of energies. A small number emit delayed neutrons.

Gamma radiation: Gamma radiation is short wavelength electromagnetic radiation of the same physical nature as light, x-rays, radio waves, etc. However, gamma radiation is highly penetrating (more so than x-rays) and, depending on its energy, can require a considerable thickness of lead or concrete to absorb it. Because gamma radiation causes ionisation, it constitutes a biological hazard.

Gamma radioactivity: Electromagnetic radiation of high quantum energy emitted after nuclear reactions or by radioactive atoms when the nucleus is left in an excited state after emission of alpha or beta particles.

Half-life, radioactive: For a single radioactive decay process, the time required for the activity to decrease to half its original value by that process. Half-lives vary, according to the radioisotope, from less than one-millionth of a second to more than one billion years.

Heavy Water: Deuterium oxide (D₂O) or water containing significantly more than the natural proportion of heavy hydrogen atoms. Heavy water is used as a moderator in the HIFAR reactor because it slows down neutrons effectively.

HIFAR (high flux Australian reactor): Nuclear reactor of the DIDO class operated by ANSTO and located at Lucas Heights.

Hot cell: A heavily shielded enclosure for highly radioactive materials. It can be used for their handling or processing by remote means, or for their storage.

Ionisation: Any process by which an atom, molecule or ion gains or loses electrons.

Ionising radiation: Radiation capable of causing ionisation of the matter through which it passes. Ionising radiation may damage living tissue.

Isotope: Atoms of an element having the same number of protons but different numbers of neutrons in the nuclei. Different isotopes of the same element have the same chemical properties, but somewhat different physical properties.

Low level waste: Any waste material that contains measurable quantities of radioactivity, requiring minimum standards of protection for personnel when the waste is handled, transported or stored.

Noble gases: Also known as inert gases, the noble gases (helium, argon, krypton, xenon and radon) have filled electron shells and normally do not react chemically with other elements. There are some radioactive isotopes of noble gases.

Nuclear reactor: A structure in which a fission chain reaction can be maintained and controlled. It usually contains fuel, coolant, moderator, control absorbers and safety devices and is most often surrounded by a concrete biological shield to absorb neutron and gamma ray emissions.

Planchette: A lipped, flat dish used for holding samples to be counted under a detector, commonly around 50 mm in diameter. Water samples may be evaporated directly onto the planchette. Usually made of stainless steel or aluminium.

Progeny: A nuclide formed from the radioactive decay of another, called the parent.

Potassium-40: A naturally occurring radioisotope with a 1.30×10^9 year half-life. A major contributor to the internal part of radiation dose arising from natural background radiation. A beta/gamma emitter.

Radiation dose: A measure of radiation received or 'absorbed' by a target. The quantities termed absorbed dose, organ dose, equivalent dose, effective dose, committed equivalent dose or committed effective dose are used depending on the context.

Radiation exposure pathways: The routes by which radioactive materials can reach and irradiate people. These include the carrying of radioactive materials by air and water followed by inhalation or ingestion, the carrying of radioactive materials through food or animals that absorb the materials, or direct radiation from sources external to the body.

Radioactivity: The property of certain nuclides of spontaneously emitting particles or gamma radiation, or of emitting x-radiation following orbital electron capture, or of undergoing spontaneous fission. The SI (International System) unit of radioactivity is the becquerel (Bq). One becquerel is equal to one nuclear disintegration per second. This is a direct measure of the amount of radioactivity in a sample.

Radionuclide: Any nuclide (isotope of an element) that is unstable and undergoes a natural radioactive decay.

Sievert: The unit of measurement of dose, effective dose or equivalent dose. It is equal to the absorbed dose (in grays) multiplied by a factor related to a particular part of the body. It is the unit used to assess the effects of ionising radiation on living cells. Usually measured in millisieverts, the whole-body dose that every person receives from natural background radiation in one year is about 2.4 millisieverts. Replaces the rem: $1 \text{ Sv} = 100 \text{ rem}$.

Transit time for the passage of effluent: The time interval from the midpoint of an effluent release to the time at which the maximum concentration of the effluent is detected at the destination.

Tritium: The 'heavy' hydrogen isotope of mass 3. It is naturally occurring but can also be made in a number of ways, including neutron absorption in lithium, deuterium or heavy water. It is radioactive (a very weak beta-emitter) with a half-life of 12.3 years.